

PROJECT MANUAL
For
ENCINITA ELEMENTARY SCHOOL
RELOCATION OF 2 RELOCATABLES
At

ROSEMEAD SCHOOL DISTRICT
Rosemead, CA

Prepared by



837 North Spring Street, Third Floor
Los Angeles, CA 90012-2323

For
ROSEMEAD SCHOOL DISTRICT
Park Rosemead
3907 Rosemead Boulevard
Rosemead, California 91770-1951


FEBRUARY 06, 2023



NAC|ARCHITECTURE
ARCHITECT



EXP. 03/31/23
FOR BRANDOW & JOHNSTON

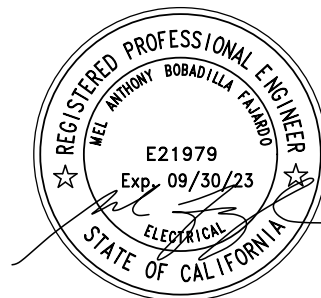

PACIFIC ENGINEERS GROUP
Consulting Electrical Engineers

BIDDING DOCUMENTS
TABLE OF CONTENTS

DIVISION 01 - GENERAL REQUIREMENTS

01000	Abbreviations, Symbols and Acronyms	05
01005	Summary of the Work	03
01050	Schedule of Values	02
01080	Application for Payment	03
01100	Coordination	02
01120	Cutting and Patching	05
01160	Request for Clarification	01
01200	Project Meetings	04
01300	Submittals	07
01340	Construction and Demolition Waste Management	04
01365	Construction Schedule.....	06
01420	Testing and Inspection.....	03
01600	Materials and Equipment	06
01640	Substitutions	02
01700	Contract Closeout	11
01740	Warranties	03

DIVISION 2 - SITE WORK

024113	Site Demolition.....	07
--------	----------------------	----

DIVISION 3 – CONCRETE-*NOT USED*

DIVISION 4 – MASONRY – *NOT USED*

DIVISION 5 – METALS – *NOT USED*

DIVISION 6 - WOOD AND PLASTICS

DIVISION 7 - THERMAL AND MOISTURE PROTECTION – *NOT USED*

DIVISION 8 - DOORS AND WINDOWS – *NOT USED*

DIVISION 9 – FINISHES - *NOT USED*

DIVISION 10 – SPECIALTIES – *NOT USED*

DIVISION 11 – EQUIPMENT – *NOT USED*

DIVISION 12 – FURNISHINGS – *NOT USED*

DIVISION 13 - SPECIAL CONSTRUCTION – *NOT USED*

DIVISION 14 - CONVEYING SYSTEMS – *NOT USED*

DIVISION 15 – MECHANICAL – *NOT USED*

DIVISION 26 – ELECTRICAL

260100	Basic Material and Methods.....	10
260519	Wire and Cable rated 600 Volt.....	05
260533	Conduit.....	08
260534	Boxes.....	04
283100	Fire Alarm Systems.....	22

DIVISION 31 – EARTHWORK

311000	Site Clearing.....	06
312000	Earthwork.....	16
312219	Finish Grading.....	02

DIVISION 32 – EXTERIOR IMPROVEMENTS

321216	Asphalt Paving.....	11
321313	Concrete Paving.....	15

DIVISION 33 – UTILITIES

331000	Water Distribution.....	10
333100	Sanitary Sewer.....	05

END OF TABLE OF CONTENTS

SECTION 01000

ABBREVIATIONS, SYMBOLS AND ACRONYMS

PART 1 - GENERAL

1.01 SECTION INCLUDES

- A. List of abbreviations, symbols, and acronyms of societies, institutes, and associations generally appearing in the Contract Documents.

1.02.1 RELATED SECTIONS

- A. Division 01: General Requirements

PART 2 - PRODUCTS

PART 3 - EXECUTION

3.01 ABBREVIATIONS

ac	Alternating current
amp	ampere
BTU	British thermal unit
cfh	Cubic feet per hour
cfm	Cubic feet per minute
cm	Centimeter
Co.	Company
COP	Coefficient of performance
Corp.	Corporation
d	Penny
db.	Decibel
DB	Dry bulb
dc	Direct current
EER	Energy efficiency ratio
F	Degrees Fahrenheit
fpm	Feet per minute
ft	Foot or feet
gph	Gallons per hour
gpm	Gallons per minute
HP	Horsepower
HVAC	Heating, ventilating and air conditioning
Hz	Hertz
Inc.	Incorporated
KHz	Kilohertz
Kip	thousand pounds
Ksf	Thousand pounds per square foot
Ksi	Thousand pounds per square inch
Kv	Kilovolt

KVA	Kilovolt amperes
KW	Kilowatt
KWH	Kilowatt hour
LF	Linear foot
lb	Pound
LED	Light emitting diode
MBH	1000 BTUs per hour
MHz	Mega hertz
mil	Thousandth of an inch
mm	Millimeter
mph	Miles per hour
oz.	Ounce
PCF	Pounds per cubic foot
pH	Acidity-alkalinity balance
psf	Pounds per square foot
psi	Pounds per square inch
psig	Pounds per square inch, gage
RF	Radio frequency
rpm	Revolutions per minute
SF	Square foot
SY	Square yard
V	Volt
WB	Wet bulb

3.02 SYMBOLS

#	Number or pound
'	Foot or feet
"	Inch(es)
%	Percent

3.03 ACRONYMS

AA	The Aluminum Association, Inc
AABC	Associated Air Balance Council
AAMA	American Architectural Manufacturers Association
AASHTO	American Association of State Highway and Transportation Officials
AATCC	American Association of Textile Chemists and Colorists
ABMA	American Boiler Manufacturers Association
ACI	American Concrete Institute
ADA	Americans with Disabilities Act
ADAAG	Americans with Disabilities Act Accessibility Guidelines
AGA	American Gas Association
AGCIH	American Conference of Governmental Industrial Hygienists
AI	Asphalt Institute
AIA	American Institute of Architects
AISC	American Institute of Steel Construction
AISI	American Iron and Steel Institute
AITC	American Institute of Timber Construction

AMCA	Air Movement and Control Association, Inc.
ANSI	American National Standards Institute
APA	APA – The Engineered Wood Association
ARI	Air-Conditioning and Refrigeration Institute
ASHRAE	American Society of Heating, Refrigeration and Air Conditioning Engineers
ASME	American Society of Mechanical Engineers
ASTM	American Society for Testing and Materials
ATBCB	Architectural & Transportation Barriers Compliance Board
AWI	Architectural Woodwork Institute
AWPA	American Wood Preservers Association
AWPI	American Wood Preservers Institute
AWS	American Welding Society
AWWA	American Water Works Association
BHMA	Builders Hardware Manufacturers Association
BIA	Brick Institute of America
CAL/OSHA	California Occupational Safety and Health Administration
CBC	California Building Code
CCR	California Code of Regulations
CEC	California Electrical Code
CFR	Code of Federal Regulations
CISPI	Cast Iron Soil Pipe Institute
CLFMI	Chain Link Fence Manufacturers Institute
CMC	California Mechanical Code
CQC	California Quality Control (CMA Standards)
CPC	California Plumbing Code
CRA	California Redwood Association
CRI	Carpet and Rug Institute
CRSI	Concrete Reinforcing Steel Institute
CS	Commercial Standards, U.S. Department of Commerce
CSFM	California State Fire Marshal
CSI	Construction Specifications Institute
CTIOA	Ceramic Tile Institute of America
CTI	Cooling Tower Institute
DHI	Door and Hardware Institute
DSA	Division of the State Architect
EPA	Environmental Protection Agency
ETL	ETL Testing Laboratories
FCC	Federal Communication Commission
FM	Factory Mutual
FS	Federal Specifications
GA	Gypsum Association
GANA	Glass Association of North America

HMMA	Hollow Metal Manufacturer's Association
HPVA	Hardwood Plywood & Veneer Association
IACS	International Annealed Copper Standards
IAMPO	International Association of Plumbing and Mechanical Officials
ICBO	International Conference of Building Officials
ICEA	Insulated Cable Engineers Association
IEEE	Institute of Electrical & Electronic Engineers, Inc.
IES	Illuminating Engineering Society
IMI	International Masonry Institute
IRI	Industrial Risk Insurers
ISO	International Organization for Standardization
MLSFA	Metal Lath/Steel Framing Association
MSS	Manufacturers Standardization Society of the Valve & Fittings Industry.
NAAMM	National Association of Architectural Metal Manufacturers
NBFU	National Board of Fire Underwriters
NBS	National Bureau of Standards
NCMA	National Concrete Masonry Association
NEBB	National Environmental Balancing Bureau
NEMA	National Electrical Manufacturers Association
NEC	National Electrical Code
NFPA	National Fire Protection Association
NFPA	National Forest Products Association
NIOSH	National Institute for Occupational Safety and Health
NIST	National Institute of Standards and Technology
NOFMA	National Oak Flooring Manufacturers Association
NPCA	National Paint and Coatings Association
NPDES	National Pollutant Discharge Elimination System
NRCA	National Roofing Contractors Association
NSF	National Sanitation Foundation
NTMA	National Terrazzo & Mosaic Association
NUSIG	National Uniform Seismic Installation Guidelines
NWMA	National Woodwork Manufacturers Association
PCA	Portland Cement Association
PCI	Precast/Prestressed Concrete Institute
PDI	Plumbing and Drainage Institute
PEI	Porcelain Enamel Institute
PS	Product Standard, U.S. Department of Commerce
RIS	Redwood Inspection Service
RFCI	Resilient Floor Covering Institute
SCAQMD	South Coast Air Quality Management District
SDEI	Steel Deck Institute
SDI	Steel Door Institute

SFM	State Fire Marshal
SFPA	Southern Forest Products Association
SIGMA	Sealed Insulating Glass Manufacturers Association
SJI	Steel Joist Institute
SMACNA	Sheet Metal and Air Conditioning Contractors National Association
SSPC	Steel Structures Painting Council
SWI	Steel Window Institute
TCA	Tile Council of America
UBPPA	Uni-Bell PVC Pipe Association
UCI	Uniform Construction Index
UFAS	Uniform Federal Accessibility Standards
UL	Underwriters' Laboratories, Inc.
WCLIB	West Coast Lumber Inspection Bureau
WDMA	Window and Door Manufacturers Association
WIC	Woodwork Institute of California
WWPA	Western Wood Products Association

END OF SECTION

SECTION 01005

SUMMARY OF THE WORK

PART 1 - GENERAL

1.01 SECTION INCLUDES

- A. The furnishing of all labor, materials, equipment, services, and incidentals necessary for Work to be performed. Work includes but is not limited to dismantling of 2 existing classroom relocatables, demolishing the 2 foundations and ramps, relocating the classroom portions to the side, over-ex and compaction per soils report, installation of new foundations, ramps and refurbishing of 1 relo to accommodate new restrooms. Installation of classroom portions onto foundations. New accessible concrete ramp at path of travel, new ac paving patch, new accessible signage and striping.

1.02 RELATED SECTIONS

- A. Section 01010: Phasing of the Work
- B. Section 01100: Coordination
- C. Section 01500: Construction Facilities and Temporary Controls

PART 2 - PRODUCTS

PART 3 - EXECUTION

3.01 USE OF PREMISES

- A. CONTRACTOR shall coordinate the Work of all trades, with OWNER and/or Separate Work Contract. CONTRACTOR shall sequence, coordinate, and perform the Work to impose minimum hardship on the operation and use of the existing facilities and/or Project site. CONTRACTOR shall install all necessary protection for existing improvements, Project site, property, and new Work against dust, dirt, weather, damage, vandalism, and maintain and relocate all protection to accommodate progression of the Work.
- B. CONTRACTOR shall confine entrance and exiting to the Project site and/or facilities to routes designated by the OAR
- C. Within existing facilities, OWNER will remove specific items from Work areas prior to the start of Work. CONTRACTOR shall remove remaining items in areas of the Work
- D. CONTRACTOR shall utilize all available means to prevent generation of unnecessary noise and maintain noise levels to a minimum. When required by the OAR,, CONTRACTOR shall immediately discontinue noise-generating activities and/or provide alternative methods to minimize noise generation. CONTRACTOR shall

install and maintain air compressors, vehicles, and other internal combustion engine equipment with mufflers, including unloading cycle of compressors. CONTRACTOR shall discontinue operation of equipment producing objectionable noise as required by the OAR.

- E. CONTRACTOR shall furnish, install, and maintain adequate supports, shoring, and bracing to preserve structural integrity and prevent collapse of existing improvements and/or Work modified and/or altered as part of the Work.
- F. CONTRACTOR shall secure building entrances, exits, and Work areas with locking devices as required by the OAR.
- G. CONTRACTOR assumes custody and control of OWNER property, both fixed and portable, remaining in existing facilities vacated during the Work.
- H. CONTRACTOR shall cover and protect surfaces of spaces in existing facilities turned over for the Work, including OWNER property remaining within as required to prevent soiling or damage from dust, dirt, water, and/or fumes. CONTRACTOR shall protect areas adjacent to the Work in a similar manner. Prior to OWNER occupancy, CONTRACTOR shall clean all surfaces including OWNER property.
- I. CONTRACTOR shall not use or allow anyone other than OWNER employees to use facility telephones and/or other equipment, except in an emergency. CONTRACTOR shall reimburse OWNER for telephone toll charges originating from the facility except those arising from emergencies or use by OWNER employees.
- J. CONTRACTOR shall protect all surfaces, coverings, materials, and finished Work from damage. Mobile equipment shall be provided with pneumatic tires.
- K. CONTRACTOR is advised OWNER will award Separate Work Contracts at this Project site.
- L. CONTRACTOR shall not permit the use of portable and/or fixed radio's or other types of sound producing devices including other similar devices.

3.02 PROPERTY INVENTORY

- A. Property, OWNER intends to remove, will be removed by OWNER before a space is vacated for the Work. Before performing Work in each space, OAR and CONTRACTOR shall prepare a detailed initial written inventory of OWNER property remaining within, including equipment and the condition thereof. OAR and CONTRACTOR shall retain a signed copy of the inventory dated and signed by both parties. Prior to subsequent OWNER occupancy of each such room or space, OAR and CONTRACTOR shall perform a final inventory of OWNER property and all discrepancies between the initial inventory and final inventory shall be the responsibility of CONTRACTOR.

3.03 FURNITURE, FIXTURES, AND EQUIPMENT

- A. If designated in the Contract Documents to be OWNER furnished CONTRACTOR installed (OFICI), CONTRACTOR shall unload, store, uncrate, assemble, install, and connect OWNER supplied furniture, fixtures, and equipment.
- B. CONTRACTOR shall, within ten (10) days after delivery, uncrate and/or unpack equipment in presence of IOR who shall inspect the delivered items. IOR shall prepare an inspection report listing damaged or missing parts and accessories. IOR shall transmit one copy of the report to OAR and CONTRACTOR. OWNER will procure and/or replace missing and or damaged furniture, fixtures, and equipment.
- C. CONTRACTOR shall install equipment in the locations and orientation. CONTRACTOR shall verify exact locations with OAR prior to final installation of equipment.
- D. If required, OAR will furnish setting and or placement drawings for equipment.
- E. CONTRACTOR shall install equipment by proper means and methods to ensure an installation as recommended by the manufacturer. CONTRACTOR shall furnish and install all necessary fasteners and required blocking to properly install equipment.
- F. CONTRACTOR shall install furniture, fixtures, and equipment with manufacturer recommended fasteners for the type of construction the furniture, fixtures, and equipment is being fastened and/or anchored to.
- G. CONTRACTOR shall provide final connections of any electrical to the equipment. CONTRACTOR shall, prior to final connection, verify the operating characteristics of equipment are consistent with the designated supply.

END OF SECTION

SECTION 01080

APPLICATION FOR PAYMENT

PART 1 - GENERAL

1.01 SECTION INCLUDES:

- A. This Section specifies administrative and procedural requirements relative to a certified Application for Payment.
 - 1. Coordinate the certified Schedule of Values and certified Application for Payment with, but not limited to, the Construction Schedule, submittal log, and list of Subcontractors.

1.02 RELATED SECTIONS:

- 1. Section 01050: Schedule of Values
- 2. Section 01365: Construction Schedule
- 3. Section 01700: Contract Closeout

PART 2 - PRODUCTS

PART 3 - EXECUTION

3.01 APPLICATION FOR PAYMENT

- A. Each certified Application for Payment shall be consistent with previous applications and payments as reviewed by ARCHITECT and/or OAR, paid for by OWNER, and:
 - 1. The initial Application for Payment, the Application for Payment at time of Substantial Completion, and the final Application for Payment involve additional requirements.
- B. Payment Application Times: The period of Work covered by each Application for Payment is the payment date for each progress payment as specified in the General Conditions. The period covered by each Application for Payment is the previous month.
- C. Payment Application Forms: Use OWNER provided forms for the Application for Payment.

- D. Application Preparation: Complete every entry on the form. Include execution by a person authorized to sign legal documents on behalf of CONTRACTOR. ARCHITECT will return incomplete applications without action.
- E. Transmittal: Submit a minimum of four (4) signed and original copies of each certified Application for Payment to the ARCHITECT. All copies shall be complete, including releases and similar attachments.
1. Transmit each copy with a transmittal form listing attachments and recording appropriate information related to the application, in a manner acceptable to ARCHITECT.
- F. Initial Application for Payment: Administrative actions and submittals, that must precede or coincide with submittal for the first certified Application for Payment include, but are not limited to, the following:
1. Certified Schedule of Values
 2. Performance and payment bonds. List of principal suppliers and fabricators.
 3. Worker Compensation certificates, if applicable.
 4. Auto Insurance, if applicable.
 5. Hazardous Material Insurance Certificates, if applicable.
 6. Construction Schedule
 7. Submittal Schedule
 8. Emergency Contact List
 9. Copies of authorizations and licenses from governing authorities for performance of the Work
- G. Application for Payment at Substantial Completion: Following OAR issuance of the certificate of Substantial Completion, submit an Application for Payment:
1. Administrative actions, submittals and/or Work that shall precede or coincide with this application include:
 - a. Occupancy permits and similar approvals by authorities having legal jurisdiction over the Work.
 - b. Removal of temporary facilities and services.
 - c. Removal of surplus materials, rubbish, and similar elements.
 - d. OWNER training and orientations.
 - e. Change over information related to OWNER occupancy, use, operation, and maintenance.
 - f. Final cleaning.
 - g. Ensure that incomplete Work is not accepted and will be completed without undue delay.
 - h. Advice on shifting insurance coverage.

- i. List of defective Work, recognized as exceptions to certificate of Substantial Completion.
 - j. Change of door locks to OWNER system.
- H. Final Payment Application: Administrative actions and submittals that must precede or coincide with submittal of the final Application for Payment include, but are not limited to, the following:
 - 1. Completion of Contract Closeout requirements.
 - 2. Project record documents.
 - 3. Completion of final punch list items.
 - 4. Delivery of extra materials, products and or stock.
 - 5. Identification of unsettled claims.
 - 6. Proof that taxes, fees, and similar obligations are paid.
 - 7. Operating and maintenance instruction manuals.
 - 8. Consent of surety to final payment.
 - 9. Waivers and releases.
 - 10. Warranties, guarantees and maintenance agreements.

END OF SECTION

SECTION 01100

COORDINATION

PART 1 - GENERAL

1.1 SECTION INCLUDES

- A. This Section specifies administrative and procedural requirements necessary for coordinating Work operations including, but not limited to, the following:
 - 1. General coordination procedures.
 - 2. Coordination drawings.

PART 2 – PRODUCTS (NONE)

PART 3 - EXECUTION

3.01 COORDINATION

- A. CONTRACTOR shall coordinate operations included in various sections of the Contract Documents to assure efficient and orderly installation of each part of the Work. Coordinate Work operations included under related sections of the Contract Documents that depend on each other for proper installation, connection, and operation of the Work, including but not limited to:
 - 1. Schedule construction operations in the sequence required where installation of one part of the Work depends on installation of other components, before or after its own installation.
 - 2. Coordinate installation of different components to assure maximum accessibility for required maintenance, service, and repair.
 - 3. Provide provisions to accommodate items scheduled for later installation.
 - 4. Prepare and administer provisions for coordination drawings.
- B. Where necessary, prepare memoranda for distribution to each party involved, outlining special procedures required for coordination. Include such items as required in notices, reports, attendance at meetings, and:

1. Prepare similar memoranda for OAR and Separate Work Contract where coordination of their Work is required.
- C. Administrative Procedures: Coordinate scheduling and timing of required administrative procedures with other construction activities to avoid conflicts and assure orderly progress of the Work. Such administrative activities include, but are not limited to, the following:
1. Preparation of schedules.
 2. Installation, relocation, and removal of temporary facilities.
 3. Delivery and processing of submittals.
 4. Progress meetings.
 5. Project closeout activities.
- D. Conservation: Coordinate Work operations to assure operations are carried out with consideration given to conservation of energy, water, materials, and:
1. Salvage materials and equipment involved in performance of, but not actually incorporated into the Work.

3.02 SUBMITTALS

- A. Coordination Drawings: CONTRACTOR shall prepare coordination drawings for coordination of installation of landscape scope. Prepare coordination drawings for those areas where limited space availability necessitates maximum utilization of space for efficient installation of different components.
1. All coordination meetings will be held in the Project field office of CONTRACTOR. CONTRACTOR is required to distribute Shop Drawings, cut sheets and submittals to Subcontractors where appropriate. Reviewed coordination drawings will be maintained in the Project field office of CONTRACTOR.

END OF SECTION

SECTION 01120
CUTTING AND PATCHING

PART 1 - GENERAL

1.01 SECTION INCLUDES

- A. This Section specifies administrative and procedural requirements for cutting and patching.

1.02 RELATED SECTIONS

- A. Section 01050: Schedule of Values
- B. Section 01100: Coordination
- C. Section 01300: Submittals
- D. Section 01740: Warranties

PART 2 - PRODUCTS

PART 3 - EXECUTION

3.01 SUBMITTALS

- A. The word “cutting” as used in the Contract Documents includes, but is not limited to, cutting, drilling, chopping, and other similar operations and the word “patching” includes, but is not limited to, patching, rebuilding, reinforcing, repairing, refurbishing, restoring, replacing, or other similar operations.
- B. Cutting and Patching Proposal: CONTRACTOR shall submit a proposal describing procedures well in advance of the time cutting and patching will be performed if the Contract Documents requires approval of these procedures before proceeding. Include the following information, as applicable, in the proposal:
 - 1. Describe the extent of cutting and patching required. Denote how it will be performed and indicate why it cannot be avoided.
 - 2. Describe anticipated results in terms of changes to existing construction. Include changes to the building’s appearance or other significant visual elements.

3. List products to be used and firms or entities that will perform this Work.
4. Indicate dates when cutting and patching will be performed.
5. Utilities: List utilities that cutting and patching operations will disturb or affect. List utilities to be relocated and those that will be temporarily out-of-service. Indicate how long service will be disrupted.
6. Where cutting and patching involves adding reinforcement to structural elements, submit an RFI for resolution by the AOR.
7. Review by ARCHITECT prior to proceeding with cutting and patching does not waive ARCHITECT right to later require complete removal and replacement of defective Work.

3.02 QUALITY ASSURANCE

- A. Operational Limitations: Do not cut and patch operating elements or related components in a manner that would result in reducing their capacity to perform as intended. Do not cut and patch operating elements or related components in a manner that would result in increased maintenance or decreased operational life or safety.
 1. Obtain review of the cutting and patching proposal before cutting and patching the following operating elements or safety related systems:
 - a. Primary operational systems and equipment
 - b. Water, moisture, or vapor barriers
 - c. Membranes and flashings
 - d. Fire protection systems
 - e. Noise and vibration control elements and systems
 - f. Control systems
 - g. Communication and/or data systems
 - h. Electrical wiring systems
- B. Visual Requirements: Do not cut and patch construction exposed on the exterior or in occupied spaces in a manner that would, in the opinion of ARCHITECT, reduce the building's aesthetic qualities. Do not cut and patch construction in a manner that would result in visual evidence of cutting and patching. Remove and replace Work cut and patched in a visually unsatisfactory manner.
 1. If possible, retain the original installer or fabricator to cut and patch the exposed Work listed below. If it is impossible to engage the original

installer or fabricator, engage another recognized experienced and specialized firm.

- a. Firestopping
- b. Masonry (exterior and interior where exposed)

3.03 WARRANTY

- A. Existing Warranties: Replace, patch, and repair material and surfaces cut or damaged by methods and with materials in such a manner as not to void any warranties required or existing.

3.04 INSPECTION

- A. Examine surfaces to be cut and patched and conditions under which cutting and patching is to be performed before cutting. If unsafe or unsatisfactory conditions are encountered, take corrective action before proceeding.
 - 1. Before proceeding, meet at the Project site with parties involved in cutting and patching, including mechanical and electrical trades. Review areas of potential interference and conflict. Coordinate procedures and resolve potential conflicts before proceeding.

3.05 PREPARATION

- A. Temporary support: Provide adequate temporary support of existing improvements or Work to be cut.
- B. Protection: Protect existing improvements and Work during cutting and patching to prevent damage. Provide protection from adverse weather conditions for portions of existing improvements or Work that might be exposed during cutting and patching operations.
- C. Avoid interference with operation of adjoining areas or interruption of free passage to adjoining areas.

3.06 PERFORMANCE

- A. General: Employ skilled workmen to perform cutting and patching. Proceed with cutting and patching at the earliest feasible time and complete without delay. Verify compatibility and suitability of existing substrates before starting the Work.

- B. Cutting: Cut existing construction using methods least likely to damage elements retained or adjoining Work.
1. In general, where cutting, provide hand or small power tools designed for sawing or grinding, not hammering and chopping. Cut holes and slots as small as possible, neatly to size required, and with minimum disturbance of adjacent surfaces. Temporarily cover openings when not in use.
 2. To avoid marring existing finished surfaces, cut or drill from the exposed or finished side into concealed surfaces.
 3. Cut through concrete and masonry using a cutting machine, such as a carborundum saw or a diamond-core drill. Saw cut reinforcing bars and paint ends with bituminous paint except where bonded into new concrete or masonry.
 4. Comply with requirements of applicable Division 2 Sections where cutting and patching requires excavating, backfill, or re-compaction.
- C. Patching: Patch with durable seams that are as invisible as possible. Comply with required tolerances.
1. Where feasible, inspect and test patched areas to demonstrate integrity of the installation. Verify conditions of existing substrates prior to executing Work.
 2. Restore exposed finishes of patched areas and extend finish restoration into retaining adjoining construction in a manner that will eliminate all evidence of patching and refinishing.

3.07 CLEANING

- A. Clean areas and spaces where cutting and patching are performed. Completely remove paint, mortar, oils, putty, and similar items. Thoroughly clean piping, conduit, and similar features before applying paint or other finishing materials. Restore damaged coverings to their original condition.

END OF SECTION

SECTION 01160
REQUEST FOR CLARIFICATION

PART 1 - GENERAL

1.01 SECTION INCLUDES

- A. Procedure for requesting clarification of the intent of the Contract Documents.

1.02 RELATED SECTIONS

- A. Section 01005: Summary of the Work
- B. Section 01100: Coordination
- C. Section 01365: Construction Schedule
- D. Section 01700: Contract Closeout

PART 2 - PRODUCTS

PART 3 - EXECUTION

3.01 PROCEDURE

- A. ARCHITECT response is a clarification of the intent of the Contract Documents and does not authorize changes in the Contract Amount, Milestones and/or Contract Time.
- B. A Request for Clarification may be returned with a stamp or notation "Not Reviewed," if:
 - 1. The requested clarification is ambiguous or unclear;
 - 2. The requested clarification is equally available to the requesting party by researching and/or examining the Contract Documents;
 - 3. CONTRACTOR has not reviewed the Request for Clarification prior to submittal.
- C. Allow a minimum of nine (8) days for review and response time, after receipt by ARCHITECT and OAR. CONTRACTOR shall verify and is responsible in verifying ARCHITECT and OAR receipt of a Request for Clarification.
- D. Changes or alterations to the approved drawings or specifications shall be made by means of addenda or change orders as per section 4-338 of the California Building Standards Administrative Code and approved by DSA.

END OF SECTION

ENCINITA ELEMENTARY SCHOOL
CLASSROOM BUILDINGS O&P

ROSEMEAD SCHOOL DISTRICT

REQUEST FOR CLARIFICATION
01160-1

SECTION 01200

PROJECT MEETINGS

PART 1 - GENERAL

1.01 SECTION INCLUDES

- A. This Section specifies administrative and procedural requirements for Project meetings, including but not limited to, the following:
 - 1. Job start meeting.
 - 2. Pre-installation conferences.
 - 3. Progress meetings.
 - 4. Meetings as required by the OAR.

1.02 RELATED SECTIONS

- A. Section 01010: Phasing of the Work
- B. Section 01100: Coordination
- C. Section 01300: Submittals
- D. Section 01365: Construction Schedule

PART 2 – PRODUCTS

PART 3 - EXECUTION

3.01 JOB START MEETING

- A. In accordance with General Condition Article 2.6, OAR will schedule a job start meeting before starting the Work, at a time and date determined by OAR. Meeting shall be held at the Project site or another location as determined by OAR. Meeting will be held in order to review responsibilities, procedures, and other administrative requirements contained within the Contract Documents.
- B. Authorized representatives of OWNER, IOR, ARCHITECT, CONTRACTOR and other parties shall attend the meeting. All participants at the meeting shall be familiar with the Project and authorized to conclude matters relating to the Work.
- C. Agenda items shall include significant items which could affect progress of the Work, including, but not limited to the following:
 - 1. Preliminary Construction Schedule

2. Critical work sequencing
3. Designation of responsible personnel
4. Identification of OAR
5. Procedures for processing field decisions
6. Request for Proposal
7. Construction Directive and Change Order
8. Procedures for processing Applications for Payment
9. Prevailing wages
10. Submittal of Shop Drawings, Product Data, material lists, and Samples
11. Preparation of project record documents
12. Use of the Project site and/or premises
13. Parking availability
14. Office, work, and storage areas
15. Equipment deliveries and priorities
16. Safety procedures
17. First Aid
18. Security
19. Housekeeping
20. Working hours
21. Insurance Services including OCIP
22. Environmental Health & Safety

- D. OAR shall prepare and issue meeting minutes to attendees and interested parties no later than five (5) calendar days after the meeting date.

3.02 PRE-INSTALLATION CONFERENCES

- A. CONTRACTOR shall coordinate and conduct pre-installation conferences at the Project site as required by related Sections of the Contract Documents.
- B. CONTRACTOR, manufacturers, and fabricators involved in or affected by the installation and its coordination or integration with other pre-ceding and/or subsequent installations of Work shall attend the meeting. CONTRACTOR shall advise OAR, IOR, and ARCHITECT of scheduled meeting dates in order to secure their attendance.
1. CONTRACTOR shall review the progress of construction activities and preparations for the particular activity under consideration at each pre-installation conference, including requirements for the following:
 - a. Contract Documents
 - b. Options
 - c. Related Construction Directives and Change Orders
 - d. Purchases
 - e. Deliveries

- f. Shop Drawings, Product Data, and quality-control samples
- g. Review of mockups
- h. Possible conflicts
- i. Compatibility problems
- j. Time schedules
- k. Weather limitations
- l. Manufacturer's recommendations
- m. Warranty requirements
- n. Compatibility of materials
- o. Acceptability of substrates
- p. Temporary facilities
- q. Space and access limitations
- r. Governing regulations
- s. Safety
- t. Inspecting and testing requirements
- u. Required performance results
- v. Recording requirements
- w. Protection

- 2. CONTRACTOR shall record significant discussions and directives received from each conference. CONTRACTOR shall, within three (3) calendar days after the meeting date, distribute the minutes of the meeting to all concerned parties, including but not limited to, OAR, IOR, and ARCHITECT.

3.03 PROGRESS MEETINGS

- A. Progress meetings will be held at the Project site on a weekly basis.
- B. In addition to representatives of CONTRACTOR, OWNER, and ARCHITECT, each Subcontractor, supplier, or other entity concerned with current progress or involved in planning, coordination, or performance of the Work shall, if requested by OAR, be represented at these meetings. All participants at the conference shall be familiar with the Project and authorized to conclude all matters relating to the Work.
- C. Failure of the CONTRACTOR to be so represented at any progress meeting which is held at a mutually agreed time or for which a written notice is given, shall not relieve CONTRACTOR from abiding by any and all OAR or ARCHITECT determinations or directives issued at such meeting.
- D. OAR will review and correct or approve minutes of the previous progress meeting and will review other significant items affecting progress. Topics for discussion as appropriate to the status of the Project include but are not limited to:

1. Interface requirements
2. Construction Schedule
3. Sequence and coordination
4. Status of submittals / RFC's
5. Deliveries
6. Off-site fabrication
7. Access
8. Site utilization
9. Temporary Construction Facilities and Controls
10. Hours of work
11. Hazards and risks
12. Housekeeping
13. Quality and workmanship
14. Unforeseen conditions
15. Testing and Inspection
16. Defective Work
17. Construction Directive
18. Request for Proposal
19. Change Order Proposals and Change Orders
20. Documentation of information for payment requests
21. Application for Payment
22. Other items as required or as brought forth.

E. No later than three (3) calendar days after each progress meeting, OAR will prepare and distribute minutes of the meeting to each present and absent party. Include a brief summary, in narrative form, of progress, decisions, directives, actions taken, and all other issues since the previous meeting and report.

1. Schedule Updating: If required, CONTRACTOR shall revise the Construction Schedule after each progress meeting where revisions to the schedule have been made or recognized. Issue the revised schedule concurrently with the next scheduled progress meeting.

3.04 ADDITIONAL MEETINGS

A. OAR, upon giving notice to the intended parties and without further obligation, may require additional meetings to discuss Work and/or Project related activities.

END OF SECTION

SECTION 01300

SUBMITTALS

PART 1 - GENERAL

1.01 SECTION INCLUDES

- A. Administrative and procedural requirements for submittals required for the Work, including but not limited to; Shop Drawings, Product Data, Samples, material lists, and quality control items as required by the Contract Documents.
- B. Wherever possible, throughout the Contract Documents, the minimum acceptable quality of workmanship and products has been defined by the name and catalog number of a manufacturer and by reference of recognized industry standards.
- C. To ensure that specified products are furnished and installed in accordance with the design intent, procedures have been established for submittal of design data and for its review by ARCHITECT, OAR and/or others.

1.02 RELATED SECTIONS

- A. Section 01100: Coordination
- B. Section 01120: Cutting and Patching
- C. Section 01365: Construction Schedule
- D. Section 01640: Substitutions
- E. Section 01700: Contract Closeout
- F. Section 01740: Warranties

PART 2 – PRODUCTS

PART 3 - EXECUTION

3.01 PROCEDURES

- A. CONTRACTOR shall package each submittal appropriately for transmittal and handling. CONTRACTOR shall transmit each submittal to ARCHITECT with concurrent copy of the transmittal to the OAR. ARCHITECT and/or OAR will not accept submittals received from sources other than from CONTRACTOR.
- B. After ARCHITECT review, ARCHITECT will transmit submittals to OAR and OAR shall further distribute to CONTRACTOR, IOR and/or others as required.

ENCINITA ES
CLASSROOM BUILDINGS O &P

ROSEMEAD SCHOOL DISTRICT

SUBMITTALS
01300-1

Work shall not commence, unless otherwise approved by OAR, until approved submittals are transmitted to CONTRACTOR.

- C. CONTRACTOR shall clearly identify any deviations from the Contract Documents on each submittal. Any deviation not so noted even though stamped reviewed is not acceptable.
- D. CONTRACTOR shall coordinate each submittal with fabrication, purchasing, testing, delivery, other submittals, and related activities requiring sequential activity.
- E. Timing of Submittals:
 - 1. In accordance with General Conditions, CONTRACTOR shall submit to ARCHITECT, with copy of transmittal to the OAR, those Shop Drawings, Product Data, diagrams, materials lists, Samples and other submittals required by the Contract Documents.
 - 2. The schedule of submittals shall provide adequate time between submittals in order to allow for proper review without negative impact to the Construction Schedule.
 - 3. Schedule of submittals shall be related to Work progress, and shall be so organized as to allow sufficient time for transmitting, reviewing, corrections, resubmission, and re-reviewing.
 - 4. CONTRACTOR shall coordinate submittal of related items and ARCHITECT reserves the right to withhold action on a submittal requiring coordination with other submittals until all related submittals are received by ARCHITECT.
 - 5. CONTRACTOR shall revise, update and submit submittal schedule to ARCHITECT and OAR on the first of each month, or as required by OAR.
 - 6. CONTRACTOR shall allow in the Construction Schedule, at least sixteen (16) days for ARCHITECT review following ARCHITECT receipt of submittal. For plumbing, Landscape, and other submittals requiring joint review with OAR, CONTRACTOR shall allow a minimum of eighteen (18) days following ARCHITECT receipt of submittal.
 - 7. No adjustments to the Contract Time and/or Milestones will be authorized because of a failure to transmit submittals to ARCHITECT sufficiently in advance of the Work to permit review and processing.

8. In case of product substitution, Shop Drawing preparation shall not commence until such time ARCHITECT and OAR reviews said submittal relative to the General Conditions.
- G. If required, resubmit submittals in a timely manner. Resubmit as specified for initial submittal but identify as such. Review times for re-submitted items shall be as per the time frames for initial submittal review.
- H. Shop Drawing preparation shall not commence until such time as CONTRACTOR receives Product Data approval.
- I. ARCHITECT, or authorized agent, will stamp each submittal with a uniform, action stamp. ARCHITECT, or authorized agent, will mark the stamp appropriately to indicate the action taken, as follows:
 1. Final Unrestricted Release: When ARCHITECT, or authorized agent, marks a submittal “Reviewed,” the Work covered by the submittal may proceed provided it complies with requirements of the Contract Documents. Final payment depends on that compliance.
 2. Final-But-Restricted Release: When ARCHITECT, or authorized agent, marks a submittal “Reviewed as Noted,” the Work covered by the submittal may proceed provided it complies with notations or corrections on the submittal and requirements of the Contract Documents. Final payment depends on that compliance.
 3. Returned for Re-submittal: When ARCHITECT, or authorized agent, marks a submittal “Rejected, Revise and Resubmit,” do not proceed with Work covered by the submittal, including purchasing, fabrication, delivery, or other activity. Revise or prepare a new submittal according to the notations; resubmit without delay. Repeat as necessary to obtain different action mark. In case of multiple submittals covering same items of Work, CONTRACTOR is responsible for any time delays, schedule disruptions, out of sequence Work, or additional costs due to multiple submissions of the same submittal item. Do not use, or allow others to use, submittals marked “Rejected, Revise and Resubmit” at the Project site or elsewhere where Work is in progress.
 4. Other Action: Where a submittal is for information or record purposes or special processing or other activity, the ARCHITECT, or authorized agent, will return the submittal marked “Action Not Required”.

3.02 SHOP DRAWINGS

ENCINITA ES
CLASSROOM BUILDINGS O & P

ROSEMEAD SCHOOL DISTRICT

SUBMITTALS
01300-3

- A. Shop Drawings are original drawings prepared by CONTRACTOR, Subcontractor, supplier, or distributor illustrating some portion of Work by showing fabrication, layout, setting, or erection details. Do not reproduce Contract Documents or copy standard information as the basis of Shop Drawings.
- B. Produce Shop Drawings to an accurate scale that is large enough to indicate all pertinent features and methods. Except for templates, patterns, and similar full-size drawings, submit Shop Drawings on sheets at least 8-1/2 x 11 inches but no larger than 24 x 36 inches.
- C. Shop Drawings shall include fabrication and installation drawings, setting diagrams, schedules, patterns, templates, and similar drawings. Include the following information:
 - 1. Dimensions
 - 2. Identification of products and materials included by sheet and detail number.
 - 3. Compliance with specified standards.
 - 4. Notation of coordination requirements.
 - 5. Notation of dimensions established by field measurement.
- D. Provide a space of approximately 4 by 5 inches on the label or beside the title block on Shop Drawings to record CONTRACTOR and ARCHITECT review, and the action taken. Include the following information on the label for processing and recording action taken:
 - 1. Project name.
 - 2. Date.
 - 3. Name and address of ARCHITECT.
 - 4. Name and address of CONTRACTOR.
 - 5. Name and address of Subcontractor.
 - 6. Name and address of supplier.
 - 7. Name and address of manufacturer.
 - 8. Name and title of appropriate Specification section.
 - 9. Drawing number and detail references, as appropriate.
- E. Unless otherwise agreed to or indicated in individual Specification sections, submit a sufficient number to allow for adequate CONTRACTOR, Subcontractor, supplier, manufacturer and fabricators distribution plus two sets to be retained by ARCHITECT, one set to IOR and one set to OAR. .

3.03 PRODUCT DATA

ENCINITA ES
CLASSROOM BUILDINGS O &P

ROSEMEAD SCHOOL DISTRICT

SUBMITTALS
01300-4

- A. Collect Product Data into a single submittal for each element of Work or system. Product Data includes printed information, such as manufacturer's installation instructions, catalog cuts, standard color charts, roughing-in diagrams and templates, wiring diagrams, schedules, illustrations, or performance curves.
 - 1. Mark each copy to show or delineate pertinent materials, products, models, applicable choices, or options. Where Product Data includes information on several products that are not required, clearly mark copies to indicate the applicable information. Include the following information:
 - a. Manufacturer's printed recommendations.
 - b. Compliance with trade association standards.
 - c. Compliance with recognized testing agency standards.
 - d. Application of testing agency labels and seals.
 - e. Notation of dimensions verified by field measurement.
 - f. Notation of coordination requirements.
 - g. Notation of dimensions and required clearances.
 - h. Indicate performance characteristics and capacities.
 - i. Indicate wiring diagrams and controls.
 - 2. Do not submit Product Data until compliance with requirements of the Contract Documents has been confirmed.
- C. Required Copies and Distribution: Same as denoted in sub - section 3.02, E.

3.04 SAMPLES

- A. Procedure:
 - 1. Submit Samples of sufficient size, quantity, cured and finished and physically identical to the proposed product or material. Samples include partial or full sections or range of manufactured or fabricated components, cuts or containers of materials, color range sets, and swatches denoting color, texture, and/or pattern.
 - a. Mount or display Samples in the manner to facilitate review of qualities indicated. Include the following:
 - 1. Specification section number and reference.
 - 2. Generic description of the Sample.
 - 3. Sampling source.
 - 4. Product name or name of manufacturer.
 - 5. Compliance with recognized standards.
 - 6. Availability and delivery time.

2. Submit Samples for review of size, kind, color, pattern, and texture. Submit Samples for a final check of these characteristics with other elements and a comparison of these characteristics between the final submittal and the actual component as delivered and installed.
 - a. Where variations in color, pattern, texture, or other characteristic is inherent in the material or product represented, submit at least three (3) multiple units that show the approximate limits of the variations.
 - b. Refer to other Specification sections for requirements for Samples that illustrate workmanship, fabrication techniques, assembly details, connections, operation, and similar construction characteristics.
 - c. Refer to other sections for Samples to be returned to CONTRACTOR for incorporation into the Work. Such Samples must be undamaged at time of installation. On the transmittal indicate special requests regarding disposition of Sample submittals.
 - d. Samples not incorporated into the Work, or otherwise not designated as OWNER property, remain the property of CONTRACTOR and shall be removed from the Project site prior to Substantial Completion.
 3. Color and Pattern: Whenever a choice of color or pattern is available in a specified product, submit accurate color chips and pattern charts to OAR for review and selection.
 4. Number Required: Submit 5 of each. Two will be returned to CONTRACTOR with one to ARCHITECT, OAR, and IOR.
- B. When specified, erect field Samples and mock-ups at the Project site to illustrate products, materials, or workmanship and to establish standards by which completed Work shall be judged.
- C. Maintain sets of Samples, as returned, at the Project site, for quality comparisons throughout the course of the Work. Sample sets may be used to obtain final acceptance of the Work associated with each set.

3.05 QUALITY CONTROL SUBMITTALS

ENCINITA ES
CLASSROOM BUILDINGS O & P

ROSEMEAD SCHOOL DISTRICT

SUBMITTALS
01300-6

- A. Submit quality control submittals, including design data, certifications, manufacturer's field reports, and other quality control submittals as required under other sections of the Contract Documents.
- B. When other sections of the Contract Documents require manufacturer's certification of a product, material, and/or installation complies with specified requirements, submit a notarized certification from the manufacturer certifying compliance with specified requirements.
- C. Certification shall be signed by an officer of the manufacturer or other individual authorized to sign documents on behalf of the represented company.
- D. Requirements for submittal of inspection and test reports are specified in other sections of the Contract Documents.

END OF SECTION

SECTION 01340

CONSTRUCTION & DEMOLITION WASTE MANAGEMENT

PART 1 - GENERAL

1.01 SUMMARY

A. Section Includes:

1. Preparation and implementation, including reporting and documentation, of a Waste Management Plan for reusing, recycling, salvage or disposal of non-hazardous waste materials generated during demolition and/or new construction (Construction & Demolition (C&D) Waste), to foster material recovery and reuse and to minimize disposal in land fills.

B. Related Sections

1. Section 01300: Submittals
2. Section 01700: Contract Closeout

1.02 REFERENCES

- A. California Integrated Waste Management Act of 1989 (AB 939)
- B. California Code of Regulations Title 14, Section 18700 et seq.

1.03 SYSTEM DESCRIPTION

- A. Collection and separation of all C&D waste materials generated on-site, reuse or recycling on-site, transportation to approved recyclers or reuse organizations, or transportation to legally designated landfills, for the purpose of recycling salvaging and/or reusing a minimum of 75% of the C&D waste generated.

1.04 SUBMITTALS

- A. C&D Waste Management Plan (Exhibit 1): Within 10 calendar days after the Notice to Proceed and prior to any waste removal, submit the following to the OAR for review and approval. Update quarterly. Include:
 1. Materials to be recycled, reused, or salvaged, either onsite or offsite.
 2. Estimates of C&D waste quantity (in tons) by type of material. (If waste is measured by volume, give factors for conversion to weight in tons.)
 3. Procedures for recycling/ reuse program.
 4. Permit or license and location of Project waste-disposal areas.D
 5. Site plan for placement of waste containers.

ENCINITA ES
CLASSROOM BUILDINGS O & P

ROSEMEAD SCHOOL DISTRICT

CONSTRUCTION AND DEMOLITION WASTE MANAGEMENT
01340-1

- B. C&D Waste Management Monthly Progress Report (Exhibit 2): Summary of waste generated by Project, monthly with Application for Payment. Include:
 - 1. Firms accepting the recovered or waste materials.
 - 2. Type and location of accepting facilities (landfill, recovery facility, used materials yard, etc.). If materials are reused or recycled on the Project site, location should be designated as “on-site reuse / recycling”.
 - 3. Type of materials and net weight (tons) of each.
 - 4. Value of the materials or disposal fee paid.
 - 5. Attach weigh bills and other documentation confirming amount and disposal location of waste materials.
- C. C&D Waste Management Final Compliance Report: Final update of Waste Management Plan to provide summary of total waste generated by Project.

PART 2 – PRODUCTS (Not Applicable)

PART 3 – EXECUTION

3.01 IMPLEMENTATION

- A. Implement approved Waste Management Plan including collecting, segregating, storing, transporting and documenting each type of waste material generated, recycled or reused, or disposed in landfills.
- B. Designate an on-site person to be responsible for instructing workers and overseeing the sorting and recording of waste/ recyclable materials.
- C. Include waste management and recycling in worker orientation and as an agenda item for regular Project meetings.
- D. Recyclable and waste bin areas shall be limited to areas approved on the Waste Management Plan. Keep recycling and waste bins neat and clearly marked to avoid contamination of materials.

3.02 ATTACHMENTS

- A. Exhibit 1: Waste Management Plan
- B. Exhibit 2: Waste Management Monthly Progress Report.

EXHIBIT 1

WASTE MANAGEMENT PLAN CONSTRUCTION/ MAINTENANCE/ALTERATION & DEMOLITION PROJECTS

PROJECT NAME:	«PROJECTTITLE» «CONTRACTTITLE»
PROJECT NO:	«Project Number»
NAME OF COMPANY:	
CONTACT PERSON:	
TELEPHONE:	
PROJECT SITE LOCATION:	
PROJECT TYPE:	<input type="checkbox"/> NEW CONSTRUCTION <input type="checkbox"/> DEMOLITION <input type="checkbox"/> MAINTENANCE/ALTERATION PROJECTS
PROJECT SIZE (SQ. FT.):	
DATE & ESTIMATED PERIOD	

(1) Material Type	(2) Tons Estimated Recycle	(3) Tons Estimated Reuse	(4) Tons Estimated Salvage	(5) Tons Estimated Landfill	(6) Proposed Disposal or Recycling Facility (e.g., Onsite, Name of Facility)
Total					
Diversion Rate: Columns [(2)+(3)+(4)] / [(2)+(3)+(4)+(5)]					=

Signature	Title	Date
-----------	-------	------

- Column 1 "Material Types" – Enter type of materials targeted for recycling, reuse, and/or salvage, either on- or off-site, and include a category for waste materials requiring disposal.
- Columns 2 thru 4 "Estimated Generation" - Enter estimated quantities (tons) of recyclable, reusable, or salvageable waste materials anticipated to be generated and state number of salvageable items.
- Column 5 "Estimated Landfill" - Enter quantities (tons) of materials to be disposed in landfill.
- Column 4 "Disposal Location" - Enter end-destination of recycled, salvaged, and disposed materials.
- General : (1) Attach proposed Recycling & Waste Bin Location Plan.

ENCINITA ES
CLASSROOM BUILDINGS O & P

ROSEMEAD SCHOOL DISTRICT

CONSTRUCTION AND DEMOLITION WASTE MANAGEMENT
01340-3

(2) Attach name and contact data for each recycling or disposal destination to be used.

ENCINITA ES
CLASSROOM BUILDINGS O & P

ROSEMEAD SCHOOL DISTRICT

CONSTRUCTION AND DEMOLITION WASTE MANAGEMENT
01340-4

EXHIBIT 2

WASTE MANAGEMENT PROGRESS REPORT CONSTRUCTION/ MAINTENANCE/ALTERATION & DEMOLITION PROJECTS

PROJECT NAME:	«PROJECTTITLE» «CONTRACTTITLE»
PROJECT NO:	«Project Number»
NAME OF COMPANY:	
CONTACT PERSON:	
TELEPHONE:	
PROJECT SITE LOCATION:	
PROJECT TYPE:	<input type="checkbox"/> NEW CONSTRUCTION <input type="checkbox"/> DEMOLITION <input type="checkbox"/> MAINTENANCE/ALTERATION PROJECTS
PROJECT SIZE (SQ. FT.):	
PERIOD	to

(1) Material Type	(2) Tons Actual Recycle	(3) Tons Actual Reuse	(4) Tons Actual Salvage	(5) Tons Actual Landfill	(6) Disposal or Recycling Facility (e.g., Onsite, Name of Facility)
Total					
Diversion Rate: Columns [(2)+(3)+(4)] / [(2)+(3)+(4)+(5)]					=

Signature	Title	Date
-----------	-------	------

- Column 1 "Material Types" – Enter type of materials targeted for recycling, reuse, and/or salvage, either on- or off-site, and include a category for waste materials requiring disposal.
- Columns 2 thru 4 "Estimated Generation" - Enter estimated quantities (tons) of recyclable, reusable, or salvageable waste materials anticipated to be generated and state number of salvageable items.
- Column 5 "Estimated Landfill" - Enter quantities (tons) of materials disposed.
- Column 4 "Disposal Location" - Enter end-destination of recycled, salvaged, and disposed materials.
- General : (1) Attach proposed Recycling & Waste Bin Location Plan.
(2) Attach name and contact data for each recycling or disposal destination to be used.

ENCINITA ES
CLASSROOM BUILDINGS O & P

ROSEMEAD SCHOOL DISTRICT

CONSTRUCTION AND DEMOLITION WASTE MANAGEMENT
01340-5

END OF SECTION

ENCINITA ES
CLASSROOM BUILDINGS O & P

ROSEMEAD SCHOOL DISTRICT

CONSTRUCTION AND DEMOLITION WASTE MANAGEMENT
01340-6

SECTION 01365

CONSTRUCTION SCHEDULE

PART 1 - GENERAL

1.01 SECTION INCLUDES

- A. Construction Schedule procedures, preparation, submittal, updates, and revisions.

1.02 RELATED SECTIONS

- A. Section 01005: Summary of the Work
- B. Section 01300: Submittals.
- C. Section 01700: Contract Closeout.

1.03 PROCEDURES

- A. Within 7 calendar days after date of Notice to Proceed, CONTRACTOR shall submit to OWNER for review, a detailed Construction Schedule setting forth all requirements for complete execution of the Work.
- B. Seven (7) calendar days after receipt of the OWNER'S review comments, submit a final Construction Schedule acceptable to OWNER.
- C. If a Construction Schedule is considered by OWNER to not be in compliance with any requirement of the Contract, CONTRACTOR will be notified to review and revise the Construction Schedule and bring it into compliance. Failure of CONTRACTOR to submit a Construction Schedule in full compliance with the Contract Documents will result in a delay in progress payment processing. The Construction Schedule is to be used in evaluating progress for payment approval.
- D. Subsequently with each Progress Payment Request, CONTRACTOR shall deliver to OWNER an updated Construction Schedule reflecting Work progress to the end of the Progress Payment Request period. Each such Construction Schedule shall indicate actual progress to date in execution of the Work, together with a projected schedule for completion of all the Work.
- E. All schedule submittals are subject to review and acceptance by OWNER. OWNER retains the right to withhold progress payments until CONTRACTOR submits a Construction Schedule acceptable to OWNER.

ENCINITA ES
CLASSROOM BUILDINGS O & P

ROSEMEAD SCHOOL DISTRICT

CONSTRUCTION SCHEDULE FOR SMALL PROJECTS
01365-1

- F. Concurrent with OWNER'S acceptance of CONTRACTOR'S submitted Construction Schedule, shall be CONTRACTOR'S signature of acceptance.

1.04 SCHEDULE SUBMITTAL PREPARATION GUIDELINES

- A. The Contract Work shall be scheduled and progress monitored using a Critical Path Method (CPM) network type scheduling system. Schedule shall be broken into sub-activities which shall, as a minimum, include major suppliers, all submittal approvals, all major trades, plumbing, mechanical, electrical, security, fire, and elevators/escalators. Scheduling system shall indicate all inter-relationships between trades and suppliers.
- B. Construction Schedule shall represent a practical plan to complete the Work within the Contract time requirement.
 - 1. A schedule extending beyond Contract time or less than Contract time will not be acceptable.
 - 2. A schedule found unacceptable by OWNER shall be revised by CONTRACTOR and resubmitted.
- C. Construction schedule shall clearly indicate sequence of construction activities, grouped by applicable phase and sorted by areas, buildings, or facilities within phase, and shall specifically indicate:
 - 1. Start and completion of all Work items, their major components, and interim milestone completion dates, as determined by CONTRACTOR and OWNER.
 - 2. Activities for procurement, delivery, installation of equipment, materials, and other supplies, including:
 - a. Time for submittals, resubmittals, and reviews. Include decision dates for selection of finishes.
 - b. Time for manufactured products for the Work fabrication and delivery.
 - c. Interdependence of procurement and construction activities.
 - d. As applicable, dates for testing, balancing equipment, and final inspection.

- D. Schedule shall be in sufficient detail to assure adequate planning and execution of the Work.
1. Each task activity shall range in duration from a 1 workday minimum to a 15 workday maximum and shall be total of actual days required for completion. The activity duration shall not include consideration of weather impact on completion of that activity.
 2. Schedule shall be suitable, in judgment of OWNER, to allow monitoring and evaluation of progress in performance of the Work; it shall be calendar time-scaled.
 3. Activities shall include:
 - a. Description; what is to be accomplished and where.
 - b. Workday duration.
 - c. Scheduled activities shall indicate continuous flow, from left to right.
 4. CONTRACTOR shall setup up the schedule calendar to identify workdays per week and shifts per day worked, non-work days, weekends and holidays.
- E. Failure to include any element of Work required for performance of this Contract shall not excuse CONTRACTOR from completing Work required to comply with the Contract Documents, notwithstanding acceptance of Construction Schedule.
- F. Submittal of Construction Schedule shall be understood to be CONTRACTOR'S confirmation that the schedule meets requirements of the Contract Documents, and that the Work will be executed in sequence indicated in schedule.

1.05 REVIEWS, UPDATES, AND REVISIONS

- A. OWNER will review and return the initial submittal of CONTRACTOR'S Construction Schedule, with summary comments, within 7 calendar days. If revisions are required, CONTRACTOR shall resubmit Schedule within 7 calendar days following receipt of OWNER'S comments.

- B. CONTRACTOR shall analyze and update the Project Construction Schedule:
1. As part of monthly payment application, CONTRACTOR shall submit to and participate with OWNER in a schedule review to include:
 - a. Actual start dates for Work items started during report period.
 - b. The percent (%) complete on activities that have actual start dates.
 - c. Actual completion dates for Work items completed during report period.
 - d. Estimated remaining duration for Work items in progress, which will not exceed original duration for activity.
 - e. Estimated start dates for Work items scheduled to start during month following report period, if applicable.
 - f. Changes in duration of Work items.
 2. In case of a change to CONTRACTOR'S planned sequence of Work, CONTRACTOR shall include a narrative report with updated progress schedule which shall include, but not be limited to, a description of problem areas, current and anticipated delaying factors, and any proposed revisions for a recovery plan.
 3. All Change Orders affecting the schedule shall be clearly identified as separate and new activities integrated into the schedule at the appropriate time and in the appropriate sequence as reviewed and approved by OWNER.
 4. The Project Construction Schedule Review will not relieve CONTRACTOR of responsibility for accomplishing all Work in accordance with the Contract Documents.
- D. Updates: CONTRACTOR shall submit to OWNER, with each payment application, an up-to-date Project Construction Schedule to include following:
1. Work Item Report: Detailing Work items and dependencies as indicated on the Schedule.
 2. Separate listing of activities completed during reporting period.

3. Separate listing of activities which are currently in progress, indicating their remaining duration and percentages completed.
 4. Separate listing of activities which are causing delay in Work progress.
- E. Scheduling of change or extra Work orders is responsibility of CONTRACTOR.
1. CONTRACTOR shall revise the Project Construction Schedule to incorporate all activities involved in completing change orders or extra Work orders and submit it to OWNER for review.
- F. If OWNER finds CONTRACTOR is entitled to extension of any completion date, under provisions of the Contract, OWNER'S determination of total number of days of extension will be based upon an analysis of the current Project Construction Schedule, and upon data relevant to the extension.
- G. CONTRACTOR acknowledges and agrees that delays to non-critical activities will not be considered a basis for a time extension unless activities become critical. Non-critical activities are those activities which, when delayed, do not affect an interim or Substantial Completion date.
- H. Any claim for extension of time shall be made in writing to OWNER not more than 7 days after commencement of delay; otherwise, it shall be deemed waived for all purposes. CONTRACTOR shall provide an estimate of the probable effect of such a delay on progress of Work as part of claim.

1.06 CONTRACTOR'S RESPONSIBILITY

- A. Nothing in these requirements shall be deemed to be an usurpation of CONTRACTOR'S authority and responsibility to plan and schedule Work as CONTRACTOR sees fit, subject to all other requirements of Contract Documents.
- B. CONTRACTOR shall provide at all times sufficient competent labor, materials, and equipment to properly carry on Work and to insure completion of each part in accordance with Construction Schedule and within time agreed.
- C. CONTRACTOR shall be responsible for ensuring that all submittals to the OWNER are accurate and consistent. Damage, including extra time and cost, caused by inaccuracies from CONTRACTOR will be compensated by CONTRACTOR.

1.07 SUSPENSION OF PAYMENTS

- A. Initial Submittal: If CONTRACTOR fails to comply with the specified requirements, OWNER reserves the right to engage an independent scheduling consultant to fulfill these requirements. Upon additional notice to CONTRACTOR, OWNER shall retain against CONTRACTOR all incurred costs for additional services.
- B. Update Submittals: OWNER has the right to withhold progress payments if CONTRACTOR fails to update and submit the Project Construction Schedule and reports as required by OWNER.

1.08 RECORD COPY

- A. Prior to the Contract Completion, CONTRACTOR shall submit the Project Construction Schedule showing the as-built sequence. The as-built schedule shall have all activities with actual start and end dates.

PART 2 - PRODUCTS - NOT USED

PART 3 - EXECUTION - NOT USED

END OF SECTION

SECTION 01420

TESTING AND INSPECTION

PART 1 - GENERAL

1.01 SECTION INCLUDES

- A. Testing and inspection services to meet requirements of the California Building Code (CBC), Title 24, Parts 1 and 2, as indicated on the Drawings.
- B. One or more DSA certified inspectors employed by the OWNER in accordance with the requirements of California Building Standards Administrative Code will be assigned to the Work with their duties as specifically defined in Section 4-333(b).
- C. Tests of materials are required by a DSA certified testing agency as set forth in Section 4-335 of the California Building Standards Administrative Code.

1.02 RELATED SECTIONS

- A. Section 01120: Cutting and Patching
- B. Section 01300: Submittals
- C. Section 01365: Construction Schedule
- D. Section 01450: Test and Balance
- E. Section 01600: Materials and Equipment
- F. Section 01700: Contract Closeout
- G. Section 01740: Warranties

PART 2 – PRODUCTS (Not applicable)

PART 3 – EXECUTION

3.01 TESTS

- A. OWNER will select an independent testing agency to conduct tests, sampling, and testing of materials. Selection of material to be tested shall be by the agency and not by CONTRACTOR.
- B. Any material shipped from the source of supply prior to having satisfactorily passed such testing and inspection or prior to the receipt of notice from IOR such testing and inspection is not required shall not be incorporated into the Work.

- C. OWNER will select and directly reimburse testing agency the costs for all DSA and/or DSA required tests and inspections, but may be reimbursed by CONTRACTOR for such costs as noted in related sections of the Contract Documents.
- D. The independent testing agency is not authorized to release, revoke, alter, or enlarge requirements of the Contract Documents or approve or accept any portion of the Work. The agency shall not perform any duties of CONTRACTOR.

3.02 TEST REPORTS

- A. Test reports shall include all tests performed, regardless of whether such tests indicate the material is satisfactory or unsatisfactory. Samples taken but not tested shall also be reported. Records of special sampling operations as required shall also be reported. Reports shall indicate the material or materials were sampled and tested in accordance with requirements of CBC, Title 24, Parts 1 and 2, as indicated on the Drawings. Test reports shall indicate specified design strength. They shall also definitely state whether or not material or materials tested comply with the specified requirements.

3.03 VERIFICATION OF TEST REPORTS

- A. Each testing agency shall submit to the Division of the State Architect a verified report in duplicate covering tests which are required to be performed by that agency during progress of the Work. Such report shall be furnished each time construction on the Work is suspended, covering tests up to that time, and prior to Final Completion of the Work, covering all tests.

3.04 INSPECTION BY OWNER

- A. OWNER and its representatives shall at all times have access, for purpose of inspection, to all parts of the Work and to shops wherein the Work is in preparation, and CONTRACTOR shall at all times maintain proper facilities and provide safe access for such inspection.
- B. OAR shall have the right to reject materials and/or workmanship deemed defective Work, and to require correction. Defective workmanship shall be corrected in a satisfactory manner and defective materials shall be removed from the premises and legally disposed of, all without charge to OWNER. If CONTRACTOR does not correct such defective Work within a reasonable time, fixed by written notice and in accordance with the terms and conditions of the Contract Documents, OWNER may correct such defective Work and proceed in accordance with related Articles of the Contract Documents.

- C. CONTRACTOR is responsible for compliance to all applicable local, state, and federal regulations regarding codes, regulations, ordinances, restrictions, and requirements.

3.05 INSPECTOR OF RECORD

- A. Inspector of Record is employed by OWNER in accordance with requirements of Title 24 of the California Code of Regulations with their duties specifically defined therein.
- B. Inspection of Work shall not relieve CONTRACTOR from any obligation to fulfill all of the terms and conditions of the Contract Documents.
- C. CONTRACTOR shall be responsible for scheduling times of inspection, tests, sample taking, and similar activities of the Work.

3.06 TESTS AND INSPECTIONS

The following tests and inspections do not limit inspection of the Work but are required by DSA, other agencies, or are required in related Sections of the Contract Documents.

See DSA Testing and Inspection form DSA 103 for all required testing for this project.

END OF SECTION

SECTION 01600

MATERIALS AND EQUIPMENT

PART 1 - GENERAL

1.1 SECTION INCLUDES

- A. This Section includes administrative and procedural requirements governing selection of products for incorporation into the Work.

1.2 RELATED SECTIONS

- A. Section 01100: Coordination
- B. Section 01300: Submittals
- C. Section 01640: Substitutions
- D. Section 01740: Warranties

1.3 DEFINITIONS

- A. Definitions used in this Section are not intended to change the meaning of other terms used in the Contract Documents, such as “specialties,” “systems,” “structure,” “finishes,” “accessories,” and other similar terms. Such terms are self-explanatory and have well-recognized meanings in the construction industry.
 - 1. “Products” are items purchased for incorporation into the Work, whether purchased for the Work or taken from previously purchased stock. The term “product” includes the terms “material” and “equipment” and terms of similar intent.
 - a. “Named Products,” are items identified by the manufacturer’s product name, including make, model number or other designation, shown or listed in the manufacturer’s published product literature, current as of the date of the Contract.
 - b. “Foreign Products,” as distinguished from “domestic products,” are items substantially manufactured (50 percent or more of value) outside the United States and its possessions. Products produced or supplied by entities substantially owned (more than 50 percent) by persons who are not citizens of, nor living within, the United States and its possessions are also considered to be foreign products.

2. “Materials,” are products substantially shaped, cut, worked, mixed, finished, refined or otherwise fabricated, processed, or installed to form a part of the Work.
3. “Equipment,” is a product with operational parts, whether motorized or manually operated, that requires service connections, such as wiring or piping.

1.4 SUBMITTALS

- A. Material list: Prepare a list in tabular form acceptable to ARCHITECT and/or OAR showing proposed products. Include generic names. Include the manufacturer’s name and proprietary names for each item listed.
 1. Coordinate material list with the Construction Schedule and the submittal schedule.
 2. Form: Prepare material list with information on each item tabulated under the following column headings.
 - a. Related Specification Section number
 - b. Generic name used in Contract Documents
 - c. Proprietary name, model number, and similar designations
 - d. Manufacturer’s name and address
 - e. Supplier’s name and address
 - f. Installer’s name and address
 - g. Projected delivery date or time span of delivery period
 3. Initial Submittal: Within ten (10) days after execution of each subcontract agreement, as set forth in General Condition Article 6.25, submit three (3) copies of an initial material list to the ARCHITECT with a copy to the OAR. Provide a written explanation for omissions of data and for known variations from the Contract Documents.
 4. ARCHITECT Action: ARCHITECT will respond in writing to OAR within fourteen (14) days and OAR will forward response to CONTRACTOR within sixteen (16) days of receipt of the completed material list. No response outside this period constitutes no objection to listed items but does not constitute a waiver of the requirement that selected items comply with the Contract Documents. ARCHITECT response will include a list of unacceptable item selections, containing a brief explanation of reasons for this action.

1.5 QUALITY ASSURANCE

- A. Source Limitations: To the fullest extent possible, provide products of the same kind from a single source.
 - 1. CONTRACTOR is to verify necessary lead times for all materials; however, when specified products are available only from sources that do not, or cannot, produce a quality adequate to complete Work in a timely manner, consult with the ARCHITECT to determine the most important product qualities before proceeding. Qualities may include attributes, such as visual appearance, strength, durability, or compatibility. When a determination has been made, select products from sources producing these qualities, to the fullest extent possible.
- B. Compatibility of Options: When the CONTRACTOR is given the option of selecting between two or more products for use in the Work, the product selected shall be compatible with products previously selected, even if previously selected products were also options.
- C. Foreign Product Limitations: Except under one or more of the following conditions, provide domestic products, not foreign products, for inclusion into the Work:
 - 1. No available domestic product complies with the Contract Documents.
 - 2. Domestic products that comply with the Contract Documents are available only at prices or terms substantially higher than foreign products that comply with the Contract Documents.
- D. Nameplates: Except for required labels and operating data, do not attach or imprint manufacturer's or producer's nameplates or trademarks on exposed surfaces of products that will be exposed in view in occupied spaces or on the exterior.
 - 1. Labels: Locate required product labels and stamps on concealed surfaces or, where required for observation after installation, on accessible surfaces that are not conspicuous.
 - 2. Equipment Nameplates: Provide a permanent nameplate on each item of service-connected or power-operated equipment. Locate on an easily accessible surface that is inconspicuous in occupied spaces. The nameplate shall contain the following information and other essential operating data:
 - a. Name of product and manufacturer

- b. Model and serial number
- c. Capacity
- d. Speed
- e. Ratings

1.6 PRODUCT DELIVERY, STORAGE, AND HANDLING

- A. Deliver, store, and handle products according to the manufacturer's recommendations, using means and methods that will prevent damage, deterioration, and loss, including theft.
 - 1. Schedule delivery to minimize long-term storage at the Project site and to prevent overcrowding of Work spaces.
 - 2. Coordinate delivery with installation time to assure minimum holding time for items that are flammable, hazardous, easily damaged, or sensitive to deterioration, theft, and other losses.
 - 3. Deliver products to the Project site in an undamaged condition in the manufacturer's original sealed container or other packaging system, complete with labels and instructions for handling, storing, unpacking, protecting, and installing.
 - 4. Inspect products upon delivery to ensure compliance with the Contract Documents and to ensure that products are undamaged and properly protected.
 - 5. Store products at the Project site in a manner that will facilitate inspection and measurement of quantity or counting of units.
 - 6. Store heavy materials away from structures in a manner that will not endanger the structure's supporting construction.
 - 7. Store products subject to damage by the elements above ground, under cover in a weather-tight enclosure, with ventilation adequate to prevent condensation. Maintain temperature and humidity within range required by manufacturer's instructions.

PART 2 - PRODUCTS

2.1 MATERIAL SELECTION

- A. General Product Requirements: Provide products that comply with the Contract Documents, that are undamaged and, unless otherwise indicated, new at the time of installation.
 - 1. Provide products complete with accessories, trim, finish, safety guards, and other devices and details needed for a complete installation and the intended use and effect.
 - 2. Standard Products: Where available, provide standard products of types that have been produced and used successfully in similar situations on other Projects.
- B. Product Selection Procedures: The Contract Documents and governing regulations govern product selection. Procedures governing product selection include the following:
 - 1. Proprietary Specification Requirements: Where Specifications name only a single material or manufacturer, provide the product indicated. No substitutions will be permitted.
 - 2. Semi-proprietary Specification Requirements: Where Specifications name two or more products or manufacturers, provide one of the products indicated. No substitutions will be permitted.
 - a. Where Specifications specify products or manufacturers by name, accompanied by the term “or equal” comply with General Condition Article 6.14 to obtain approval for use of an unnamed product.
 - 3. Descriptive Specification Requirements: Where Specifications describe a product or assembly, list exact characteristics required, with or without use of a brand or trade name, provide a product or assembly that provides the characteristics and otherwise complies with the Contract Documents.
 - 4. Performance Specification Requirements: Where Specifications require compliance with performance requirements, provide products that comply with these requirements and are recommended by the manufacturer for the application indicated.
 - a. Manufacturer’s recommendations may be contained in published material literature or by the manufacturer’s certification of performance.

5. Compliance with Standards, Codes, and Regulations: Where Specifications only require compliance with an imposed code, standard or regulation, select a product that complies with the standards, codes, or regulations specified.
6. Visual Matching: Where Specifications require matching an established Sample, decision of the ARCHITECT will be final on whether a proposed product matches satisfactorily.
7. Visual Selection: Where specified product requirements include the phrase "... as selected from manufacturer's standard or premium colors, patterns, textures..." or a similar phrase, select a product and manufacturer that complies with other specified requirements. The ARCHITECT will select the color, pattern, and texture from the product line selected.

PART 3 - EXECUTION

3.1 INSTALLATION OF PRODUCTS

- A. Comply with manufacturer's instructions and recommendations for installation of products in the applications indicated. Anchor each product securely in place, accurately located, and aligned with other Work.
 1. Clean exposed surfaces and protect as necessary to ensure freedom from damage and deterioration until Substantial Completion.

END OF SECTION

SECTION 01640

SUBSTITUTIONS

PART 1 - GENERAL

1.1 SECTION INCLUDES

- A. This Section includes administrative and procedural requirements for handling requests for substitutions submitted eleven (11) days or more after the date established in the Notice to Proceed.

1.2 RELATED SECTIONS

- A. Section 01300: Submittals
- B. Section 01600: Materials and Equipment

PART 2 - PRODUCTS

PART 3 - EXECUTION

3.1 APPLICATION

- A. CONTRACTOR proposed changes in products or materials required by the Contract Documents eleven (11) days or more after the date established in the Notice to Proceed, are considered to be requests for substitutions. OAR will consider requests for substitution if a product is no longer manufactured and/or cannot be acquired from existing inventories. The following are not considered to be valid requests for substitutions:
 - 1. Revisions to the Contract Documents requested by OAR or ARCHITECT.
 - 2. Specified options of products included in the Contract Documents.
 - 3. Substitutions requested on a “or equal” basis.

3.2 SUBMITTALS

- A. Transmit submittals as described in related Sections for each request for substitution.
 - 1. Identify the product to be replaced in each request. Include related Specification Section and Drawing number.

2. Provide complete documentation denoting compliance with the requirements for substitutions, and the following information, as appropriate.
 - a. A detailed comparison of significant qualities of the proposed substitution with those specified in the Contract Documents. Significant qualities may include elements, such as performance, weight, size, durability, and visual effect.
 - b. Product Data, including Drawings, descriptions of products, fabrication, and installation procedures.
 - c. Samples, where applicable or requested.
 - d. CONTRACTOR certification the proposed substitution conforms to requirements of the Contract Documents in every respect and is appropriate for the applications indicated.
 - e. CONTRACTOR waiver of rights to an increase in the Contract Amount, Milestones and/or Contract Time that may subsequently become necessary because of the failure of the substitution to adequately perform.
3. If required, ARCHITECT will request additional information or documentation for evaluation. OAR will notify CONTRACTOR of acceptance or rejection of the substitution.
4. ARCHITECT will review and consider request for substitution and provide a recommendation to OAR
5. Where a proposed substitution involves and/or effects more than one Subcontractor, CONTRACTOR shall ensure each Subcontractor cooperates with the other Subcontractor involved to coordinate the Work, provide uniformity and consistency, and assure compatibility of all products.
6. CONTRACTOR submittal and ARCHITECT review of Shop Drawings, Product Data, material lists or Samples do not constitute an acceptable or valid request for substitution.

END OF SECTION

SECTION 01700
CONTRACT CLOSEOUT

PART 1 - GENERAL

1.01 SECTION INCLUDES

- A. This Section includes administrative and procedural requirements for Contract Closeout, including but not limited to, the following:
 - 1. Inspection procedures.
 - 2. Project record documents submittal.
 - 3. Operation and maintenance manual submittal.
 - 4. OWNER orientation and instruction.
 - 5. Final cleaning.
- B. Closeout requirements for specific Work activities are included in the appropriate Sections in Divisions 01 through 16.

1.02 RELATED SECTIONS

- A. Section 01080: Application for Payment
- B. Section 01300: Submittals
- C. Section 01365: Construction Schedule
- D. Section 01740: Warranties

PART 2 – PRODUCTS

PART 3 - EXECUTION

3.01 SUBSTANTIAL COMPLETION

- A. Inspection Procedures: On receipt of a request for a certificate of Substantial Completion, OAR will either authorize commencement of inspection or advise CONTRACTOR of unfilled requirements. IOR, OAR, CONTRACTOR and ARCHITECT will inspect the Work and IOR shall prepare a comprehensive punch list of items to be completed.
 - 1. IOR will repeat inspection when requested and assure the Work is complete.
 - 2. Results of the completed inspection will form a partial basis of the requirements for Final Completion.

- B. Re-inspection Procedures: IOR, OAR, CONTRACTOR and ARCHITECT will inspect the Work upon notice the Work, including final inspection list items from earlier inspections, has been completed, except for items whose completion is delayed under circumstances acceptable to OAR.
1. Upon completion of inspection, OAR will recommend Final Completion. If the Work is incomplete, OAR will advise CONTRACTOR of Work that is incomplete or of obligations that have not been fulfilled but are required for Final Completion.
 2. If necessary, re-inspection will be repeated, but may be assessed against CONTRACTOR if OWNER is subject to additional professional service and or additional costs of inspection.

3.02 PROJECT RECORD DOCUMENT SUBMITTAL

- A. General: Do not use project record documents for construction purposes. Protect record documents from deterioration and loss. Provide access to record documents for ARCHITECT, IOR and OAR reference during normal working hours. Project record document shall be updated on a weekly basis. Prior to submitting each application for payment, secure IOR and ARCHITECT approval of project record documents.
- B. Record Drawings: Maintain a clean, undamaged set of blue or black line white prints of Drawings and Shop Drawings. Mark the set to show the actual installation where the installation varies substantially from the Work as originally shown. Mark which Drawing is most capable of showing conditions fully and accurately. Where Shop Drawings are used, record a cross-reference at the corresponding location on the Drawings. Provide detailed and accurate field dimensions for concealed elements that would be difficult to measure and record at a later date.
1. Mark record sets with red erasable pencil. Use other colors to distinguish between variations in separate categories of the Work. Date and number entries in the same format as submitted. Call attention to entry by a “cloud” around the affected areas.
 2. Mark new information important to OWNER but was not shown on Drawings or Shop Drawings.
 3. Utility location and depth below finished grade and/or above ceilings and attic spaces shall be fully dimensioned and indicated on record drawings. Dimensions shall be measured from building lines or permanent landmarks and shall be triangulated to those features.

4. Note related Change Order or Construction Directive numbers where applicable. RFC submissions shall be referenced on each affected sheet, Drawing and/or Shop Drawing.
 5. Organize record drawing sheets into manageable sets. Bind sets with durable-paper cover sheets; print suitable titles, dates, and other identification on the cover of each set.
 6. Prior to Final Completion of the Work, and review of the project record drawings by ARCHITECT, prepare a final set of project record drawings incorporating all mark ups and information noted. Provide a hardline drawing set of record drawings printed on reproducible white bond paper. Submit final set of Record Drawings to ARCHITECT.
- C. Record Specifications: Maintain two complete copies of the Specifications, including Addenda. Include with the Specifications two copies of other written Contract Documents, such as Change Orders and/or Construction Directives issued during construction.
1. Mark these record documents to show substantial variations in actual Work performed in comparison with the text of the Specifications and modifications.
 2. Give particular attention to substitutions and selection of options and information on concealed Work that cannot otherwise be readily discerned later by direct observation.
 3. Note related record document information with Product Data.
 4. Prior to Final Completion of the Work, submit record Specifications to ARCHITECT for OWNER records.
- D. Record Product Data: Maintain two copies of each Product Data submittal. Note related Change Orders and Construction Directives and mark-up of record drawings and Specifications.
1. Mark these documents to illustrate significant variations in actual Work performed in comparison with information submitted. Include variations in products delivered to the Project site and from the manufacturer's installation instructions and recommendations.
 2. Provide detailed and accurate information regarding concealed products and portions of Work that cannot otherwise be readily discerned later by direct observation.

3. Prior to Final Completion of the Work, submit complete set of record Product Data to the ARCHITECT for OWNER records.
- E. Record Samples: Immediately prior to Substantial Completion, CONTRACTOR shall meet with ARCHITECT and OAR at the Project site to determine which Samples are to be transmitted to OWNER for record purposes. Comply with OAR instructions regarding delivery to OWNER storage area.
- F. Miscellaneous Records: Refer to other Specification sections for requirements of miscellaneous record keeping and submittals in connection with actual performance of the Work. Immediately prior to the date of Final Completion, complete and compile miscellaneous records and place in good order. Identify miscellaneous records properly and bind or file, ready for continued use and reference. Submit to ARCHITECT for OWNER records.
- G. Maintenance Manuals: Prior to Substantial Completion, organize operation and maintenance data into suitable two sets of manageable size. Bind properly indexed data in individual, heavy-duty, 2-3", 3-ring, vinyl-covered binders, with pocket folders for folded sheet information. Mark appropriate identification on front and spine of each binder. Submit to OAR for ARCHITECT and for OWNER records. Include the following types of information.
 1. Emergency instructions
 2. Spare parts list
 3. Copies of warranties
 4. Wiring diagrams
 5. Recommended "turn-around" cycles
 6. Inspection procedures
 7. Shop Drawings and Product Data
 8. Fixture lamping schedule
- H. Verified Reports: Construction progress of the Work shall be reported to DSA via a duly verified report as per Sections 4-336 and 4-343 of the California Building Standards Administrative Code.

3.03 CLOSEOUT PROCEDURES:

- A. Operation and Maintenance Instructions: Prior to Substantial Completion, arrange for each installer of equipment that requires regular operation and maintenance to meet with designated OWNER personnel to provide instruction in proper operation and maintenance. Provide instruction by manufacturer's representatives if installers are not experienced in operation and maintenance procedures. Include a detailed review of the following items:

1. Maintenance manuals
2. Record documents
3. Spare parts and materials
4. Tools
5. Lubricants
6. Fuels
7. Identification systems
8. Hazards
9. Cleaning
10. Warranties and bonds
11. Maintenance agreements and similar continuing commitments

3.04 FINAL CLEANING

- A. General: Related sections of the Contract Documents specify general cleaning during performance of the Work. General cleaning is included in Division 01 Section "Construction Facilities and Temporary Controls".
- B. Cleaning: Employ experienced workers or professional cleaners for final cleaning. Clean each surface or unit to the condition expected in a normal, commercial cleaning and maintenance program. Comply with manufacturer's instructions.
 1. Complete the following cleaning operations before requesting inspection for a certificate of Substantial Completion.
 - a. Clean exposed exterior hard-surfaced finished to a dust-free condition, free of stains, films, and similar foreign substances. Restore reflective surfaces to their original condition. Leave concrete floors broom clean.
 - b. Clean the Project site, including landscape development areas, of rubbish, litter, and other foreign substances. Sweep paved areas broom clean; remove stains, spills, and other foreign deposits. Rake grounds that are neither paved nor planted to a smooth, even-textured surface.

END OF SECTION

SECTION 01740

WARRANTIES

PART 1 - GENERAL

1.1 SECTION INCLUDES

- A. This Section includes administrative and procedural requirements for warranties required by the Contract Documents, including manufacturers and/or installer's standard warranties on products and special product warranties.
 - 1. Refer to the General Conditions for terms of the guarantee period for the Work.

1.2 RELATED SECTIONS

- A. Section 01600: Materials and Equipment
- B. Section 01700: Contract Closeout
- C. All Necessary work related sections division 2-16

PART 2 - PRODUCTS

PART 3 - EXECUTION

3.1 WARRANTY REQUIREMENTS

- A. Disclaimers and Limitations: Manufacturer's disclaimers and limitations on product warranties shall not relieve CONTACTOR of the warranty of the Work incorporating such materials, products, and/or equipment. Manufacturer's disclaimers and limitations on warranties do not relieve suppliers, manufacturers, installers, and Subcontractors of the requirement to countersign special warranties with CONTRACTOR.
- B. Standard warranties are preprinted written warranties published by individual manufacturers for particular products and are specifically endorsed by the manufacturer to OWNER.
- C. Special warranties are written warranties required by or incorporated in the Contract Documents, either to extend time limits provided by standard warranties or to provide greater rights for OWNER.

- D. Related Damages and Losses: When correcting failed or defective warranted Work, remove and replace Work that has been damaged as a result of such failure or which must be removed and replaced to provide access for correction of warranted Work.
- E. Reinstatement of Warranty: When Work covered by a warranty has failed and been corrected by replacement or rebuilding, reinstate the warranty by written endorsement with the reinstated warranty equal to the original warranty.
- F. Replacement Cost: Upon determination the Work covered by a warranty has failed and/or is defective, replace or rebuild the Work to an acceptable condition complying with requirements of the Contract Documents. CONTRACTOR is responsible for the cost of replacing or rebuilding defective Work regardless of whether OWNER has benefited from use of the Work through a portion of its anticipated useful service life.
- G. OWNER Recourse: Expressed warranties made to OWNER are in addition to implied warranties and shall not limit the duties, obligations, rights, and remedies otherwise available under the law. Expressed warranty periods shall not be interpreted as limitations on the time in which OWNER can enforce such other duties, obligations, rights, or remedies.
- H. Rejection of Warranties: OAR reserves the right to reject warranties and to limit selection to products with warranties not in conflict with requirements of the Contract Documents.
- I. Where the Contract Documents require a special warranty, or similar commitment on the Work or part of the Work, OAR reserves the right to refuse to accept the Work until CONTRACTOR presents evidence the entities required to countersign such commitments have done so.

3.2 SUBMITTALS

- A. Submit written warranties to ARCHITECT prior to Final Completion of the Work. If the certificate of Substantial Completion designates a commencement date for warranties other than the date of Substantial Completion for the Work, submit written warranties as set forth in the certificate of Substantial Completion.
 - 1. When a designated portion of the Work is partially used and/or occupied by OWNER, submit properly executed warranties to ARCHITECT within fifteen (15) days of the Partial Use or Occupancy of the designated portion of the Work.

- B. When the Contract Documents require CONTRACTOR, or CONTRACTOR and a Subcontractor, installer, supplier or manufacturer to execute a special warranty, prepare a written document containing appropriate terms and identification, ready for execution by the required parties. Submit a draft to OAR, through the ARCHITECT, for approval prior to final execution.
 - 1. Refer to Divisions 02 through 16 for specific content requirements and particular requirements for submitting special warranties.
- C. Form of Submittal: Prior to Final Completion of the Work, compile two copies of each required warranty properly executed by CONTRACTOR, or by CONTRACTOR and Subcontractor, installer, supplier, or manufacturer. Organize the warranty documents into an orderly sequence based on the Specifications.
- D. Bind warranties and bonds in heavy-duty, commercial-quality, durable 3-ring, vinyl-covered loose-leaf binders, thickness as necessary to accommodate contents, and sized to receive 8½ by 11” (115 by 280 mm) paper.
 - 1. Provide heavy paper dividers with celluloid covered tabs for each separate warranty. Mark the tab to identify the item or installation. Provide a typed description of the product or installation, including the name of the product, and the name, address, and telephone number of the installer.
 - 2. Identify each binder on the front and spine with the typed or printed title “WARRANTIES,” Project title and/or name, and name of CONTRACTOR.
 - 3. When warranted Work requires operation and maintenance manuals, provide additional copies of each required warranty, as necessary, for inclusion in each required manual.

END OF SECTION

SECTION 024113

SITE DEMOLITION

PART 1 - GENERAL

1.01 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Special Conditions and Division 01 Specification Sections, apply to this Section.

1.02 SUMMARY

- A. This Section includes the following
 - 1. Demolition and removal of site improvements and all other related contiguous improvements as required. Refer to Contract Drawings for items and location.
 - 2. Demolition, dismantling, cutting and alterations as indicated, specified, and required for completion of the Contract; for new construction, modernization and rehabilitation projects, as applicable. Includes items such as the following:
 - 1. Protecting existing work to remain.
 - 2. Salvageable items to be retained.
 - 3. Cleaning soiled materials that are to remain.
 - 4. Disconnecting and capping utilities.
 - 5. Removing debris and equipment.
 - 6. Removal of items indicated on drawings.
- B. Demolition of Existing Building Foundations
 - 1. Demolition and removal of all existing building foundations, footings, slabs, retaining walls, etc. shall be carried in a careful and orderly manner, and according to all applicable codes and regulations for demolition of structures, safety of adjacent structures, dust control and disposal of materials.
 - 2. Sprinkle Work with water to minimize dust. Provide hoses and water connections for that purpose.
- D. Demolition and Removal of Pavements
 - 1. Markup all existing utilities on site.
 - 2. Sawcut all Concrete Pavements, as indicated on Drawings.
 - 3. Remove all indicated pavements, walkways, curb and gutter, concrete ditches, landscape areas, etc.
 - 4. Protect all manhole and valve covers, lids, vaults and other site fixtures, marked to remain.
- E. Related Sections: The following Sections contain requirements that relate to this Section:
 - 1. Sections for "Photographic Documentation", "Special Environmental Procedures", "Temporary Facilities", "Tree and Plant Protection", "Cutting and Patching" as applicable.

2. Division 31 for "Site Clearing" and "Earthwork" as applicable.
3. Asbestos-Containing Materials (ACMs) and/or other Hazardous Materials Report.

1.03 DEFINITIONS

- A. Remove: Remove and legally dispose of items except those indicated to be reinstalled, salvaged, or to remain the owners' property.
- B. Asbestos-Containing Materials (ACMs) and other hazardous materials: As identified in the Report, remove asbestos-containing materials (ASMs) and other identified hazardous materials.
- C. Remove and Salvage: Items indicated to be removed and salvaged remain the Owner's property. Remove, clean, and pack or crate items to protect against damage. Identify contents of containers and deliver to Owner's designated storage area.
- D. Remove and Reinstall: Remove items indicated; clean, service, and otherwise prepare them for reuse; store and protect against damage. Reinstall items in locations indicated or as directed by Owner.
- E. Existing to Remain: Protect construction indicated to remain against damage and soiling during demolition. When permitted by the Architect and Owner, items may be removed to a suitable, protected storage location during demolition and then cleaned and reinstalled in their original locations.

1.04 MATERIALS OWNERSHIP

- A. Except for items or materials indicated to be reused, salvaged, or otherwise indicated to remain the Owner's property, demolished materials shall become the Contractor's property and shall be removed from the site with further disposition at the Contractor's option.
- B. Historical items indicated remain the Owner's property. Carefully remove and salvage each item in a manner to prevent damage and deliver promptly to the Owner.
- C. Historical items, archeological or paleontological findings, relics, and similar objects including, but not limited to, cornerstones and their contents, commemorative plaques and tablets, commemorative benches, antiques, and other items of interest or value to the Owner, which may be encountered during demolition, remain the Owner's property. If such items are encountered, all project operations shall cease in the area of discovery immediately. The Owner shall secure the services of an archeological consultant to assess the resources and determine a course of action.
 1. Cooperate with Owner's archaeological consultant or historical adviser. Mitigated Negative Declaration (MND) for related requirements.
- D. Human Remains: In the event that human remains are discovered, there shall be no disposition of such human remains, other than in accordance with the procedures and requirements set forth in the California Health and Safety Code and Public Resources Code. All project operations shall cease in the area of discovery immediately. In conjunction with the Owner, the Code provisions require immediate notification of the County Coroner and the Native American Heritage Commission.

1. Cooperate with the County Coroner, the Native American Heritage Commission representative and other related officials. Refer to the Mitigated Negative Declaration (MND) for related requirements.

1.05 SUBMITTALS

- A. General: Submit each item in this Article according to the Conditions of the Contract and Division 01 Specification Sections, for information only, unless otherwise indicated.
- B. Proposed dust-control measures.
- C. Proposed noise-control measures.
- D. Proposed signage.
- E. Schedule of demolition activities indicating the following:
 1. Detailed sequence of demolition and removal work, with starting and ending dates for each activity.
 2. Dates for shutoff, capping, and continuation of utility services.
- F. Inventory of items to be removed and salvaged.
- G. Inventory of items to be removed by Owner, if any.
- H. Photographs or videotape, sufficiently detailed, of existing conditions of adjoining construction and site improvements that might be misconstrued as damage caused by demolition operations.
- I. Record drawings at Project closeout according to Section "Project Record Documents".
 1. Identify and accurately locate capped utilities and other subsurface structural, electrical, or mechanical conditions.
- J. Landfill records for record purposes indicating receipt and acceptance of hazardous wastes by a landfill facility licensed to accept hazardous wastes.

1.06 QUALITY ASSURANCE

- A. Demolition Firm Qualifications: Engage an experienced firm that has successfully completed demolition Work similar to that indicated for this Project.
- B. Regulatory Requirements: Comply with governing EPA & SCAQMD notification regulations before starting demolition. Observe applicable Best Practices and implementation of the Storm Water Pollution Prevention Plan (SWPPP). Comply with hauling and disposal regulations of authorities having jurisdiction.
- C. Pre-demolition Conference: Conduct conference at Project site to comply with pre-installation conference requirements of Division 01 Section "Project Meetings."

1.07 PROJECT CONDITIONS

- A. Conditions existing at time of inspection for bidding purpose will be maintained by Owner as far as practical. Bidders shall make themselves fully aware of the existing conditions within the site. Scope limits scheduled for demolition and items/areas to remain protected in supplement to the Bid Drawings and Documents.

- B. If conditions are encountered that vary from those indicated on plan, notify the Architect for instructions prior to proceeding.
- C. Buildings immediately adjacent to demolition area will be occupied. Conduct building demolition so operations of occupied buildings will not be disrupted.
 - 1. Provide not less than 72 hours' notice of activities that will affect operations of adjacent occupied buildings.
 - 2. Maintain access to existing walkways, exits, and other facilities used by occupants of adjacent buildings. Do not close or obstruct walkways, exits, or other facilities used by occupants of adjacent buildings without written permission from owner.
- D. Contractor to obtain all necessary encroachment and excavation permits from the local jurisdiction of authority for demolition of existing improvements in public right-of-way.

1.08 SCHEDULING

- A. Arrange demolition schedule so as not to violate city construction ordinances.
- B. Arrange demolition schedule with Owner.

PART 2 - PRODUCTS

2.01 SOIL MATERIALS

- A. Requirements for satisfactory soil materials are specified in Division 31 Section "Earthwork". Refer to the Geotechnical Investigation Report, dated [June 29, 2022](#) prepared by [Associated Soils Engineering Inc.](#), for site soil requirements
 - 1. Obtain approved borrow soil materials off-site when sufficient satisfactory soil materials are not available on-site.

PART 3 - EXECUTION

3.01 EXAMINATION

- A. Verify that utilities have been disconnected and capped. Test lines as required.
- B. Survey existing conditions and correlate with requirements indicated to determine extent of demolition required.
- C. Inventory and record the condition of items to be removed and reinstalled and items to be removed and salvaged.
- D. Survey existing conditions of the improvements such as light standards and trees to determine the best method(s) for removal so as not to cause potential damage to persons and property during the course of removal.
- E. Perform surveys as the Work progresses to detect hazards resulting from demolition activities.

3.02 UTILITY SERVICES

- A. Maintain existing utilities indicated to remain in service and protect them against damage during demolition operations.
 - 1. Do not interrupt existing utilities serving occupied or operating facilities on or off the property, except when authorized in writing by Owner and authorities having jurisdiction. Provide temporary services during interruptions to existing utilities, as acceptable to Owner and to governing authorities.
 - a. Provide not less than 72 hours' notice to Owner if shutdown of service is required during changeover.
- B. Utility Requirements: Locate, identify, disconnect, and seal or cap off indicated utility services serving structures to be demolished.
 - 1. Arrange to shut off indicated utilities with utility companies.
- C. Utility Requirements: Refer to Division 33 Sections and Contract Drawings, for shutting off, disconnecting, removing, and sealing or capping utility services. Do not start demolition work until utility disconnecting and sealing have been completed and verified in writing.

3.03 PREPARATION

- A. Drain, purge, or otherwise remove, collect, and dispose of chemicals, gases, explosives, acids, flammables, or other dangerous materials before proceeding with demolition operations.
- B. Conduct demolition operations and remove debris to ensure minimum interference with roads, streets, walks, and other adjacent occupied and used facilities.
 - 1. Do not close or obstruct streets, walks, or other adjacent occupied or used facilities without permission from Owner and authorities having jurisdiction. Provide alternate routes around closed or obstructed traffic ways if required by governing regulations.
- C. Conduct demolition operations to prevent injury to people and damage to adjacent buildings and facilities to remain. Ensure safe passage of people around demolition area.
- D. Erect temporary protection, such as walks, fences, railings, canopies, and covered passageways, where required by authorities having jurisdiction.
- E. Protect existing site improvements, appurtenances, and landscaping to remain.
 - 1. Erect a plainly visible fence around drip line of individual trees or around perimeter drip line of groups of trees to remain.

3.04 CUTTING EXISTING CONCRETE

- A. Cutting of existing concrete shall be done by experienced workers familiar with the requirements and space necessary for placing concrete. Perform concrete cutting with concrete cutting wheels and hand chisels. Take care not to damage concrete that is intended to remain.

- B. Extent of cutting of concrete shall be as indicated on drawings and in accordance with standard plans for public works construction plan no. 132-3. Replace concrete that is removed in excess of amount indicated or required.
- C. Prior to cutting or coring concrete, determine locations of hidden utilities and take necessary measures to protect them from damage.
- D. If an existing pavement joint or cracked area is within two feet outside of a designated sawcut line shown on the Drawings, removal and resurfacing shall be to that joint, and/or shall include the crack or cracked area, unless otherwise approved by Architect.

3.05 EXPLOSIVES

- A. Explosives: Use of explosives will not be permitted.

3.06 POLLUTION CONTROLS

- A. Use water mist, temporary enclosures, and other suitable methods to limit the spread of dust and dirt. Comply with governing environmental protection regulations.
 - 1. Do not create hazardous or objectionable conditions, such as ice, flooding, and pollution, when using water.
- B. Remove and transport debris in a manner that will prevent spillage on adjacent surfaces and areas.
 - 1. Remove debris from elevated portions of building by chute, hoist, or other device that will convey debris to grade level.
- C. Clean adjacent buildings and improvements of dust, dirt, and debris caused by demolition operations. Return adjacent areas to condition existing before start of demolition.

3.07 DEMOLITION

- A. Demolition: Demolish improvements completely and remove from the site. Use methods required to complete Work within limitations of governing regulations and as follows:
- B. Below-Grade Construction: Demolish foundation walls and other below-grade construction, as follows:
 - 1. Completely remove below-grade construction, including foundation walls and footings unless noted otherwise on the drawings.
 - 2. Break up and remove below-grade concrete slabs, unless indicated to remain.
- C. Filling Below-Grade Areas: Completely fill below-grade areas and voids resulting from demolition of buildings and pavements with soil materials according to requirements specified in Division 31 Section "Earthwork."
- D. Damages: Promptly repair damages to adjacent facilities caused by demolition operations.

3.08 DISPOSAL OF DEMOLISHED MATERIALS

- A. General: Promptly dispose of demolished materials. Do not allow demolished materials to accumulate on-site.
- B. Burning: Do not burn demolished materials.
- C. Disposal: Transport demolished materials off Owner's property and legally dispose them.

END OF SECTION

SECTION 260100

BASIC MATERIALS AND METHODS

PART 1: GENERAL

1.01 RELATED DOCUMENTS

- A. Addenda, Alternates, Drawings and general provisions of Contract, including General and Supplementary Conditions and Division-01 Specifications collectively apply to work of this Section.

1.02 WORK INCLUDED

- A. The specifications and drawings are intended to cover a complete installation of systems. The omission of expressed reference to any item of labor or material for the proper execution of the work in accordance with present practice of the trade shall not relieve the Contractor from providing such additional labor and materials.
- B. All labor, materials, appliances, tools, equipment, facilities, transportation and services necessary for and incidental to performing all operations in connection with furnishing, delivery and installation of electrical system, complete, as shown on the drawings and/or specified herein. Work includes but is not necessarily limited to the following:
 - 1. Conduits for all wiring systems, unless otherwise specifically noted.
 - 2. All electrical wiring and connections to equipment furnished under other sections of Specifications.
 - 3. All electrical wiring and connections to Owner furnished equipment.
 - 4. Pull wires in conduit runs indicated as conduit only (CO).
 - 5. Building electrical wiring, conduits, outlet boxes, junction boxes, convenience outlets, switches, plates and all miscellaneous items of electrical equipment, apparatus and material specified and/or shown on Drawings.
 - 6. All required grounds.
 - 7. All anchors, chases, sleeves and supports for electrical equipment.
 - 9. Excavation necessary for execution and completion of electrical work.

10. Complete Fire Alarm and Detection System.
11. Tests of entire system.
12. Guarantees.
13. Shop Drawings.
14. In these specifications, Fire Alarm, Clock and Class Change Signal, PA/Intercom, Television, Intrusion Alarm, etc. are referred to as Auxiliary Systems or Signal Systems.

1.03 GUARANTEE

- A. In addition to guarantee required in Division 01 or specifically specified elsewhere, all materials and equipment provided and installed under this Division of Specifications shall be guaranteed by Contractor in writing for a period of one year from date of acceptance of work by Owner. Should any trouble develop during this period due to defective materials or faulty workmanship, the Contractor shall furnish all necessary labor and materials to correct the trouble without costs to Owner.
- B. Guarantee complete and perfect operation of entire system and that all apparatus will perform in accordance with detailed drawings and Specifications.
- C. Guarantee that all equipment will be supported in such a way as to be free from objectionable vibration and noise.
- D. Guarantee that all licenses and royalties for use of any patented feature of system will be paid before acceptance of system.

1.04 GENERAL REQUIREMENTS

- A. Codes: Construct project in accordance with following codes and regulations.
 1. 2019 California Electrical Code, Title 24 C.C.R.
(2017 National Electrical Code of the National Fire Protection Association, NFPA)
 2. 2019 California Mechanical Code, Title 24 C.C.R.
(2018 Uniform Mechanical Code of the International Association of Plumbing and Mechanical Officials, IAPMO)
 3. 2019 California Plumbing Code, Title 24 C.C.R.
(2018 Uniform Plumbing Code of the International Association of Plumbing and Mechanical Officials, IAPMO)

4. 2019 California Energy Code, Title 24 C.C.R.
5. 2019 California Fire Code, Title 24 C.C.R.
(2018 International Fire Code of the International Code Council)
7. 2019 California Existing Building Code, Title 24 C.C.R.
(2018 International Existing Building Code of the International Code Council, with amendments)
8. 2019 California Green Building Standards Code (CALGreen Code), Title 24 C.C.R.
9. 2019 California Referenced Standards Code, Title 24 C.C.R.
10. Local codes and ordinances.
11. Division of State Architect.

Keep a copy of applicable code available at Site while performing work of this Section. Nothing in these Drawings and Specifications to be construed as authority to violate codes and ordinances. Conflict with applicable regulations to be resolved at Contractor's expense before installation.

B. Permits, Fees and Inspections: Obtain and pay for all necessary permits and fees required by any constituted authority having jurisdiction including utilities. Arrange and pay for all required inspections or examinations and deliver certificates of inspection to Architect.

C. Record Drawings:

1. Provide record drawings for work of this Section.
2. Keep up-to-date a complete "As-Built" record set of blue-line prints corrected daily and showing every change from original Drawings and Specifications and exact "As-Built" locations, sizes, and kinds of equipment.
3. Prints for this purpose may be obtained from Architect at cost of printing. Keep this set of Drawings on job and use only as a record set.
4. Drawings to serve as work progress sheets. Make neat and legible notations in red ink thereon daily as work proceeds, showing work as actually installed. Drawings to be available at all times for inspection, and kept at a location designated by Architect.

5. On completion of work, obtain one set of prints from Architect at cost of printing, and note neatly in scale all changes on record set. Deliver complete set of prints together with one set of blueline prints to Architect together with Contractor's name, address and phone number. Incorrect, non-legible or non-reproducible drawings will not be accepted.
- D. Selection and Ordering of Equipment and Materials: Within two weeks after award of Contract, arrange for purchase and delivery of all light fixtures, equipment and materials required in ample quantities and at proper time. Inform Architect immediately of any inability to obtain suitable delivery of any equipment or material. Send copy of letter verifying date of purchases to Architect.
- E. Shop Drawings and Material Lists:
1. Submit material lists and shop drawings as called for in Division 01, and as supplemented by this Division, and with sufficient promptness to ensure that overall work of project will not be delayed.
 2. Submit six copies of a list of materials and equipment manufacturers that Contractor intends to use.
 3. Provide shop drawings for following:
 - a. Fire Alarm Devices.
 - b. Fire Alarm Shop Drawings.
 4. Do not fabricate work until reviewed shop drawings for work have been received from Architect. Work fabricated or erected in advance of reviewed shop drawings will be at risk of Contractor.
 5. Architect's or Engineer's review of shop drawings does not relieve Contractor of responsibility for errors including details, dimensions, or materials, as well as conformance with requirements of Drawings and Specifications.
 6. Shop drawings will be checked by Architect and Engineer for conformance to design as a convenience to Contractor. Dimensions will not be checked. Should interferences become evident, notify Architect immediately so that matter may be resolved prior to proceeding with fabrication.
 7. No reimbursement based on a claim that work was placed in accordance with dimensions shown on a reviewed shop drawing will be allowed for removing or replacing work already in place.
 8. Make available a copy of every reviewed shop drawing at Project Site.

9. Submit shop drawings in coherent groups; e.g., all lighting fixtures at one time.
10. Submit actual samples of specified equipment or material to Architect for review when requested.

F. Substitution and Approval of Material:

1. Base all bids and proposals only upon materials, construction and equipment named or described in specification and/or shown on drawing. Should a Contractor wish to use other equipment than that specified, he shall submit proposed substitution by fully describing equipment he prefers to use and by listing credit or additional cost to his bid as a separate item should substitution be acceptable.
2. All equipment and materials proposed for substitution shall be similar in design and equal in quality and function to those specified herein or on drawings. Contractor (not sales vendor) shall demonstrate his proposed substitution and shall specifically note all differences between item specified and proposed substitution. Actual samples and test data, certified by an independent testing laboratory, shall be submitted when requested.
3. Each substitution will be given consideration, but without any obligation expressed or implied on part of Architect to change named requirements of specification. Only one substitution for each item of equipment will be permitted. Contractor assumes sole responsibility for performance and space requirements for substitute equipment. Decision of Architect shall be final as to whether or not substitution is acceptable.

G. Terminology:

1. Term "provide" used on Drawings and elsewhere in the Specifications shall be considered to mean "furnish and install".
2. Term "UL" means Underwriters Laboratories Inc.

H. Workmanship: See supplementary Conditions, Architect is sole judge of whether execution is in a workmanlike manner.

I. Safety Conditions: Be responsible in preventing energized switches, circuit breakers or circuits from being turned to "On" position during construction period. Be responsible for damages to personnel and/or property resulting from contact with energized circuits, switches, circuit breakers, busses or other electrical apparatus. Construct all electrical work with electrical system de-energized in area. At no time permit work on equipment or apparatus with energized circuits.

J. Verification of Dimensions: All scaled and figured dimensions are approximate and are given for estimating purposes only. Before proceeding with work carefully check and verify all dimensions and sizes and assume all responsibility for fitting of materials and equipment to other parts of equipment and to structure. Where apparatus and equipment have been indicated on drawings, dimensions have been taken from typical equipment of class indicated. Carefully check drawings and see that equipment will fit into spaces provided.

K. Locations:

1. Locations of conduits, outlets, apparatus and equipment indicated on drawings are approximate only and shall be changed to meet architectural and structural conditions as required.
2. Install conduit and equipment in a manner and in locations avoiding all obstructions, preserving headroom, keeping openings and passageways clear and readily accessible for maintenance and repairs. Make changes in locations of conduit or equipment which may be necessary to accomplish this. Drawings are essentially diagrammatic to extent that many offsets, bends, special fittings and exact locations are not indicated. Examine all drawings prepared by manufacturers, suppliers and installers of all equipment including air conditioning and plumbing fixture shelving, for requirements and locations of equipment and outlets.
3. Should any structural interferences prevent installation of outlets, setting of cabinets for lighting panelboards, running of conduits, or installation of other electrical equipment at locations shown on Drawings, necessary minor deviations therefore as determined by Engineer may be permitted. In event changes in indicated locations or arrangements are necessary due to developed conditions in building's construction or rearrangement of furnishings or equipment, Owner shall be permitted to move any junction box or utility outlet a distance of 10' and such changes shall be made without extra cost providing change is ordered before work is installed. Submit an estimate of cost or credit for other changes and proceed only upon written authority of Architect.
4. Be cautioned that diagrams showing electrical connections are diagrammatic only and must not be used for obtaining lineal runs of wiring or conduit. Wiring diagrams do not necessarily show exact physical arrangement of equipment.
5. Locations of outlets, lighting fixtures, cabinets, panelboards, apparatus, motors, mechanical equipment, etc., shown on Electrical Drawings is only approximate. Do not scale them from Electrical Drawings.

6. Verify locations of outlets, lighting fixtures, equipment etc., with Architectural Drawings of interior and exterior details and finish, and coordinate location of electrical work with mechanical and other equipment.
- L. These Specifications and attendant Drawings are intended to cover a complete and operable electrical system. Follow Drawings and Specifications and execute all work according to true intent and meaning. Should any error or omission exist in either or both of these Drawings and Specifications, or conflict one with another, have same explained and adjusted by Engineer before submitting bid price for electrical work; otherwise at own expense, supply proper materials and labor to completely install same, make good any damage to or defect in work of results obtained therefore caused by such error, omission or conflict. Most restrictive, greater quantity or size, better quality or other superior condition of all representations shall prevail. It is intended that outlets be located symmetrical with Architectural elements notwithstanding fact that locations indicated on Drawings may be distorted for clarity.
- M. Omission of expressed reference in Drawings or Specifications to any item of labor or material necessary for proper execution of work in accordance with present good practice of trade will not relieve Contractor from providing such additional labor and materials.
- N. Job Visits by Engineer: Periodic visits to job by Engineer is for express purpose of verifying compliance by Contractor with contract documents. Such visits by Engineer shall not be construed as construction supervision. Neither shall such visits be construed to make Engineer responsible for providing a safe place for performance of work by Contractor or Contractor's employees or safety of supplies of Contractor or his subcontractors.
- O. Cooperation with Others: Organize work that will harmonize with work of all trades so that all work may proceed as expeditiously as possible. Be responsible for correct placement of work and connection of work to all related trades.
- P. Protection of Finish: Provide adequate means for protecting all finished parts of materials and equipment against damage from any cause during progress of work and until acceptance by Architect. Cover all material and equipment in storage and during construction in such a manner that no finished surfaces will be damaged, marred or splattered with paint. Keep moving parts perfectly clean and dry. No paint spraying will be permitted in building. Replace or refinish damaged material or equipment including face plates or panels without additional costs to Owner.
- Q. Cleaning Equipment and Premises: Thoroughly clean all parts of materials, equipment and exposed parts such as receptacles and panelboards, of cement, plaster and other materials. Remove all oil and grease spots with a non-inflammable cleaning solvent. Brush exposed metal work with steel brushes to remove rust and

other spots and leave smooth and clean. During progress of work, carefully clean up and leave premises and all portions of building free from debris. At completion of work, remove all waste materials and debris resulting, leaving everything in a complete and satisfactory condition.

- R. Cutting and Patching: Include all cutting and patching in bid. Do not cut any structural members without first having received written permission from Architect. Cutting of round openings which can be done by use of a rotary drill shall be done by Contractor requiring same. Cutting and patching finish work shall be performed by workmen of the respective trade.
- S. Conditions at Site: Visit Job Site and become familiar with all existing conditions within scope of work and include in Bid Proposal allowance for these conditions. Verify exact locations of services prior to construction. Notify all other Contractors of these utility locations.
- T. Documents: Read all relevant documents, become familiar with job, scope of work, type of general construction, Architectural, Structural, Mechanical and Electrical Drawings and Specifications. Also become familiar with purpose for which these Drawings have been prepared and become cognizant of all details involved.
- U. Acceptance: Before work will be accepted, demonstrate to Owner and Architect that entire installation is complete and in proper operating condition and Contract has been fully and properly executed. Following items shall be prepared and submitted to Architect:
 - 1. Two copies of all test results required under this Division.
 - 2. Two copies of local and/or state code enforcing authorities' final inspection certificates.
 - 3. Copies of as-built record drawings as required.
 - 4. Notify Architect in writing when installation is complete and that a final inspection of this work can be performed. In event defects or deficiencies are found during this final inspection they shall be corrected to satisfaction of Architect before final acceptance can be issued.
 - 5. Two Maintenance and Operating Manuals as required.
- V. Field Inspections: Provide proper facilities for access of Owner or Owner's representative to conveniently examine and inspect all portions of work covered in this Contract at any and all reasonable hours.
- W. Completing Work: At completion of work, remove all waste materials and debris resulting from work, leaving everything in a complete and satisfactory condition.

- X. Electrical Superintendent: Include services of a qualified electrical foreman capable of interpreting intent of Drawings and Specifications, to study Plans, Specifications and references, and coordinate all requirements with other trades, authorized to make decisions and issue instructions; be constantly in charge of work and available at job site at all times and at final inspection. Instruct Owner's representative for proper operation and recommend maintenance of all systems.
- Y. Maintenance and Operating Manuals:
1. Before completion and acceptance of work, furnish Owner with two complete sets of operating and maintenance instruction manuals. Bind each set-in durable hardboard binder and index.
 2. Compile data for manuals upon approval of material list and sketches so as not to delay final approval of work installed. Operating manuals to contain all pertinent data relating to electrical installation such as fixture cuts, manufacturer's approval, shop drawings, sketches, wiring diagrams and equipment operating instructions.
 3. Instruct Owner's operating personnel with electrical operating procedures before work is considered complete.
- Z. Extra Work or Costs to This Contractor Due to Other Contractors or Trades: Adjusted between this Contractor and offending Contractor at no extra cost to Owner. Notify Architect before such extra work is done.
- AA. Tests:
1. Upon completion of work and adjustment of all equipment, all systems shall be tested under direction of Owner's representative to demonstrate that all equipment furnished and installed and/or connected under provision of these Specifications shall function electrically in manner required. All tests shall be completed prior to final inspection of project.
 2. All systems shall test free from short circuits and grounds and shall be free from mechanical and electrical defects. All circuits shall be tested for proper neutral connection.
 3. All instrumentation and personnel required for testing shall be furnished by Contractor.
- BB. Noise Control:
1. Perform electrical work to a manner in minimize transmission of noise and preserve acoustical properties of building structure.

2. Where conduits pass through sleeves in interior walls, floors, or ceilings, completely fill space between each conduit and its sleeve to provide an airtight seal.
 3. Use glass fiber material, "Duxseal" compound, for acoustic seals.
- CC. Seismic Bracing Standards: All pipes, cable trays, conduits, etc. shall be supported and braced in accordance with construction documents.
- DD. In hard ceiling space where access to j-boxes, detectors, etc is required, provide ceiling access panel, fire-rated typical.

END OF SECTION

SECTION 260519

WIRE AND CABLE-RATED 600 VOLT

PART 1: GENERAL

1.01 RELATED DOCUMENTS

- A. Addenda, Alternates, Drawings and general provisions of Contract, including General and Supplementary Conditions and Division-01 Specifications collectively apply to work of this Section.

1.02 DESCRIPTION

- A. Work includes but is not limited to the following:
 - 1. Building wire.
 - 2. Ground Conductors.
 - 3. Wiring connections and terminations.
 - 4. Conductor Identification.
- B. Related Work:
 - 1. Section 260100 - Basic Materials and Methods.
 - 2. Section 260533 - Conduit.
 - 3. Section 260553 - Electrical Identification.

PART 2: PRODUCTS

2.01 BUILDING WIRE

- A. Wires shall be single conductor type THHN or THWN insulated with polyvinyl chloride and covered with a protective sheath of nylon, rated at 600 volts. Wires may be operated at 90 degrees C. maximum continuous conductor temperature in dry locations, and 75 degrees C. in wet locations and shall be listed by UL Standard 83 for thermoplastic insulated wires, listed by Underwriters Laboratories (UL) for installation in accordance with Article 310 of the California Electrical Code (CEC). Conductors shall be solid copper for 12 AWG and smaller conductors, and stranded copper for 10 AWG and larger conductors. Conductors shall be insulated with PVC and sheathed with nylon. Wires shall be identified by surface markings indicating

manufacturer's identification, conductor size and metal, voltage rating, UL symbol, type designations and optional rating. Indentations for lettering are not permitted. Wires shall be tested in accordance with the requirements of UL standard for types THWN, or THHN.

- B. Conductors shall be solid Class B or stranded Class C, annealed uncoated copper in accordance with UL standards, or another Nationally Recognized Testing Laboratory (NRTL).
- C. Control Circuits: Copper, stranded conductor 600 volt insulation, THWN/THHN.
- D. Minimum branch circuit wiring: No. 12 AWG copper, 600 volt insulation.
- E. Minimum wire size except for control wiring: No. 14 AWG copper, 600 volt insulation.

2.02 GROUND CONDUCTORS

- A. Equipment ground: Insulated conductor green in color.
- B. Isolated circuit ground: Insulated conductor green in color.
- C. Ground Wires: Bare copper or with green colored insulation.

2.03 CONDUCTOR ARRANGEMENT AND IDENTIFICATION

- A. Ties: T & B "Ty-rap" or 3M Company.
- B. Lacing: Nylon twine.
- C. Markers: Adhesive type, Brady.

2.04 CONDUCTORS

- A. All Wire: New and delivered to job site in unbroken packages.
- B. Each package shall bear Underwriter's and Manufacturer's labels and seals indicating date of manufacture and maximum allowable voltage.

PART 3: EXECUTION

3.01 INSTALLATION

- A. Wires shall not be installed until debris and moisture is removed from conduits, boxes, and cabinets. Wires stored at site shall be protected from physical damage until they are installed and walls are completed.

- B. Wire-pulling compounds furnished as lubricants for installation of conductors in raceways shall be compounds approved and listed by UL, NRTL, or equal. Oil, grease, graphite, or similar substances are not permitted. Pulling of 2 AWG or larger conductors shall be performed with a cable pull machine. Any runs shorter than 50 feet are exempt. When pulling conductors, do not exceed manufacturer's recommended values
- C. At outlets for light, power, and signal equipment, pigtail splices with 8-inch circuit conductor leads for connection to fixtures, equipment, and devices.
- D. Pressure cable connectors, pre-insulated 3M Scotchluk, Hubbell Power, O-Z/Gedney or equal, Y, R or B spring-loaded twist-on type, may be furnished in splicing number 8 AWG or smaller wires for wiring systems; except public address and telephone systems.
- E. Joints, splices, taps, and connections to switchboard neutral, bonding or grounding conductors, conductors to ground busses, and transformer connections for wires 6 gage and larger shall be performed with high-pressure cable connectors approved for installation with copper conductors. Connectors shall be insulated with heavy wall heat shrink WCSM, or cold-applied roll-on sleeve RVS. Insulation level shall be a minimum of 600V and joints, splices, and taps shall be qualified to ANSIC 119.1, UL, NRTL, or equal listed mechanical pressure connections.
- F. Connections to any bussing and high-pressure cable connectors shall be securely bolted together with corrosion-resistant plated carbon steel, minimum grade five machine screws secured with constant pressure-type locking devices.
- G. Connection of any bonding or grounding conductors shall be securely bolted together with corrosion-resistant plated carbon steel, minimum grade five machine screws secured with constant pressure-type locking devices.
- H. Wire switchboards, panel cabinets, pull boxes, and other cabinets except public address, shall be neatly grouped and tied in bundles with nylon ties at 10-inch intervals. In switchboards, panels and terminal blocks, wires shall be fanned out to terminals. If bundles are longer than 24 inches, a maximum of nine current carrying conductors may be bundled together.
- I. Install conductor lengths with a minimum length within the wiring space. Conductors must be long enough to reach the terminal location in a manner that avoids strain on the connecting lug.
- J. Maintain the conductor required bending radius.
- K. Neutral conductors larger than 6 gage, which are not color identified throughout their entire length, shall be taped, painted white or natural gray, or taped white where they

appear in switchboards, cabinet, gutters or pull boxes. Neutral conductors 6 gage and smaller shall be white color identified throughout their entire length.

- L. Fire alarm and clock wiring shall be continuous from terminal cabinets or from equipment to each device. Splices are not permitted between devices and/or terminal cabinets at junction and pull boxes. Wiring shall be terminated at terminal blocks or devices only.
- M. Wiring systems shall be free from short circuits and grounds, other than required grounds. The contractor shall be responsible for the testing of feeder and branch circuit conductor's insulation resistance. The insulation of the conductors shall be tested prior to connections to any panelboards, switchboards, variable frequency drives, lighting control systems, ballasts, and wiring devices such as but not limited to GFI receptacles, TVSS receptacles, or equipment. Insulation testing of panelboards and switchboards shall be independently performed from the insulation testing of any conductors as specified in other sections of this specification.
 - 1. Utilize the services of an approved independent testing laboratory to perform megger time-resistance insulation testing of feeder conductors. Tests must be conducted with wires disconnected at both ends.
 - a. Provide calibration program records to assure the testing instrument to be within rated accuracy. The test equipment accuracy shall be in accord with the requirements stated by the National Institute of Standards and Technology (NIST).
 - b. Test equipment shall be provided with a label stating the date of last calibration. As a minimum the equipment shall have been calibrated within the past 12 months.
 - c. Test reports shall include the following:
 - 1) Identification of the testing organization.
 - 2) Equipment identification.
 - 3) Ambient conditions.
 - 4) Identification of the testing technician.
 - 5) Summary of project.
 - 6) Description of equipment being tested.
 - 7) Description of tests.
 - 8) Test results.
 - 9) Analysis, interpretation and recommendations.

3.02 COLOR CODES

- A. Signal Systems: Wires for signal systems shall be color-coded. Except where otherwise specified, color-coding shall be as follows:

<u>SYSTEM</u>	<u>COLOR CODE</u>
Fire Alarm Speakers	Pink (+) and Gray (-)
Fire Alarm Strobes	Orange (+) and Blue (-)
Un-Interruptible 24 Volt Power (Annunciator, Water Flow, and Audible Device)	Yellow (+) and White (-) Note: A single white wire may be common to both
Interruptible 24 Volt Power (4 wire smoke detectors, duct detectors)	Brown (+) and White (-) Note: A single white wire may be common to both
Switch-Leg Sprinkler Bell (Between water flow and audible device)	Violet (+) and White (-)
Door Holding Magnets (Non Power Limited)	Black (+) and White (-)

3.03 TAPE AND SPLICE KITS

- A. Splices, joints, and connectors joining conductors in dry and wet locations shall be covered with insulation equivalent to that provided on conductors. Free ends of conductors connected to energized sources shall be taped. Voids in irregular connectors shall be filled with insulating compound before taping. Thermoplastic insulating tape approved by UL, NRTL, or equal for installation as sole insulation of splices shall be furnished and shall be installed according to manufacturer's printed specifications.

3.04 PROTECTION

- A. Protect the Work of this section until Substantial Completion.

3.05 CLEANUP

- A. Remove rubbish, debris and waste materials and legally dispose of off the Project site.

END OF SECTION

SECTION 260533

CONDUIT

PART 1: GENERAL

1.01 RELATED DOCUMENTS

- A. Addenda, Alternates, Drawings and general provisions of Contract, including General and Supplementary Conditions and Division-01 Specifications collectively apply to work of this Section.

1.02 DESCRIPTION

- A. Work includes but is not limited to the following:
 - 1. Rigid metal conduit and fittings.
 - 2. Intermediate metal conduit and fittings.
 - 3. Electrical metallic tubing and fittings.
 - 4. Flexible metal conduit and fittings.
 - 5. Liquidtight flexible metal conduit and fittings.

PART 2: PRODUCTS

2.01 RIGID STEEL CONDUIT AND FITTINGS

- A. Rigid Steel Conduit: Hot dipped galvanized inside and out, galvanized threads, mild steel, zinc coated, inside and outside protective coating. Standard lengths: 10'-0".
- B. Bushings: Threaded insulated metallic type except sizes 1" and smaller may be non-metallic type. Setscrew bushings are not acceptable.
- C. Couplings, elbows, bends and other fittings: Same material and finish as rigid steel conduit. All shall be threaded type.

2.02 RIGID ALUMINUM CONDUIT AND FITTINGS

- A. Conduit: Extruded from 6063-T24 alloy of maximum 1/10% copper content and containing lubricating inside liners; rigid threaded type.
- B. Bushings: Insulated metallic except that sizes 1" and smaller may be non-metallic.

2.03 INTERMEDIATE METAL CONDUIT (IMC) AND FITTINGS

- A. Conduit: Galvanized steel, zinc coated, protective coating inside and out.
- B. Fittings and Conduit Bodies: Use fittings and conduit bodies specified above for rigid steel conduit.
- C. Conduit: May be used in lieu of rigid steel conduit where permitted by code, except in concrete, underground, runs longer than 100 feet for all power feeders with conduit greater than 2 inches.

2.04 ELECTRICAL METALLIC TUBING (EMT) AND FITTINGS

- A. Conduit: Hot dipped galvanized or sherardized inside and out, zinc coated with protective enamel coating inside. Provide bushings at ends of conduits.
- B. Connectors: Steel, insulated, bused tap-on or wrench tightened compression type. (Couplings similar) Indentor or screw type not acceptable.
- C. Conduit: May be used in lieu of rigid steel conduit where permitted by code, except exposed, in concrete and for runs more than 100' for all power feeders with conduit greater than 2 inches.

2.05 FLEXIBLE METAL CONDUIT AND FITTINGS

- A. Conduit: Steel single strip, hot dipped galvanized on all 4 sides prior to fabrication. Flexible aluminum conduit will not be allowed.
- B. Connectors: Die cast with ridges that thread into conduit. (Binding screw type connectors are not acceptable.)
- C. Conduit: May be used in lieu of rigid steel conduit where specifically indicated; at connections to vibrating equipment; at drops to light fixtures from J-boxes; at locations judged by Architect impractical to use rigid conduit. Maximum length for any application shall be 6 feet.

2.06 LIQUIDTIGHT FLEXIBLE CONDUIT AND FITTINGS

- A. Conduit: Steel, single strip, hot dipped galvanized on 4 sides prior to fabrication.
- B. Connectors: Insulated, special Appleton "STN" Series.
- C. Jacket: Liquidtight, polyvinyl chloride plastic.

- D. Conduit: Use for final connection to motor terminal boxes and transformers. Use at exterior locations, damp locations, wet locations and for flex connections in kitchen, restrooms and similar areas.

2.07 CONDUIT SUPPORTS

- A. Conduit Clamps, Straps, and Supports: Steel or malleable iron. Clamps: Unistrut Nos. P111 thru P1124, Kindorf No. C105. Straps: One or two hole as required.
- B. Conduit hangers, racks and trapezes: Steel, threaded rods, channel iron "U" shaped racks equal to "Unistrut".
- C. Individual conduit hangers: Steel, threaded rods with malleable iron split rings.
- D. Hanger rods: 3/8" minimum diameter for 2" and smaller conduit, factory made. 1/2" minimum for 2-1/2" and larger conduit.
- E. Wire supports: 12-gauge zinc coated iron tie wire, or 16 gauge galvanized double annealed steel tie wire.

2.08 CONDUIT PULLING CORDS

- A. Pull Wire: No. 12 galvanized iron or nylon pull wire rated 250 pounds tensile strength.

2.09 CONDUIT FITTINGS, ELLS AND BUSHINGS

- A. Special conduit fittings: Crouse-Hinds "Condulets" or Appleton "Unilets".
- B. Ells: Same quality, same finish and same make as conduit.
- C. Bushings: Thomas & Betts or approved equal.
- D. Seismic separations and expansion joints: OZ type "AX" complete with bonding strap and clamps. At exterior locations use OZ type "EX".

2.10 CONDUIT SEALS AND SEALING COMPOUND

- A. Vertical seals: Crouse Hinds type "EYD" or Appleton type "SF".
- B. Horizontal Seals: Crouse Hinds type "EYS" or Appleton type "ESU".
- C. Sealing compound: Crouse Hinds "CHICO" or Appleton "APELCO".
- D. Fireproofing Compound: Dow Corning No. 3-6548 RTV or equal by 3M Company or Nelson.

2.12 MC CABLE

- A. Metal Clad (MC) cable system is not allowed.

PART 3: EXECUTION

3.01 CONDUIT SIZING, ARRANGEMENT, AND SUPPORT

- A. Arrange conduit to maintain headroom and present a neat appearance.
- B. Unless indicated otherwise, conceal conduit within or behind finished walls and ceiling.
- C. Route exposed conduit and conduit above accessible ceilings parallel and perpendicular to walls and adjacent piping.
- D. Maintain minimum 6 inch clearance between conduit and piping. Maintain 12 inch clearance between conduit and heat sources such as flues, steam pipes, and heating appliances.
- E. Arrange conduit supports to prevent distortion of alignment by wire pulling operations. Fasten conduit using galvanized straps, lay-in adjustable hangers, clevis hangers, or bolted split stamped galvanized hangers.
- F. Group conduit in parallel runs where practical and use conduit rack constructed of steel channel with conduit straps or clamps. Provide space for 25 percent additional conduit.
- G. Do not fasten conduit with wire or perforated pipe straps. Remove all wire used for temporary conduit support during construction, before conductors are pulled.
- H. Do not support conduit from any equipment subject to vibration. Support from structural members only.
- I. Structural Considerations for Conduit Routing:
 - 1. Where conduits are to pass through or will interfere with any Structural member, or where notching, boring or cutting of the structure is necessary, or where special openings are required through walls, floors, footings, or other buildings elements, to accommodate the electrical work, such work shall conform to State Building Code.
 - 2. Where conduits are terminated in groups at panelboards, switchboards and signal cabinets, etc., provide templates or spacers to hold conduits in proper position and to preserve alignment. Conduits terminating at signal cabinets

shall enter cabinets in following approved locations only: Conduits entering top, side, and bottom of cabinets shall be aligned in a single row, centered 2" from rear of cabinet; conduits entering back of cabinet shall be aligned in a single row centered 2" from top of cabinet. Conduits shall not be spaced closer than 3" on centers.

3. 1" and smaller conduits above metal lath ceilings shall be tied to ceiling channels. 1-1/4" conduits above metal lath ceilings shall be rigidly suspended with pipe hangers or pipe racks or shall be secured to superstructure with factory made pipe straps. Conduits in metal lath or steel stud partitions, shall be tied to furring channels or studs. In ceiling spaces and in partitions, tie wires shall be spaced not more than 5'-0" apart, shall hold conduit tight against channels and studs at point of tie and shall not bear any of weight of conduit. Tie wire shall be #16 gage galvanized double annealed steel tie wire.
4. Where auxiliary supports, saddles, brackets,, etc., are required to meet special conditions they shall be made rigid and secure before conduit is attached thereto.
5. Conduit in ceiling spaces, in stud walls and under floors shall be supported with factory made pipe straps or shall be suspended with pipe hangers or pipe racks. Pipe straps shall be attached to and shall hold conduit tight at point of support against ceiling and floor joists, rafters, and wall studs, or 2" x 4" headers fitted between joists or wall studs.
6. Conduits installed on exposed steel trusses and rafters shall be fastened with factory made conduit straps or clamps which shall hold conduit tight against supporting member at point of support.
7. Conduits under buildings shall be strapped with factory made conduit straps to underside of concrete floor or joists, or wood floor joists, or shall be suspended with pipe hangers or pipe racks. Conduits under building shall not rest on ground but shall be suspended from building or shall be buried below surface of ground. 1" and larger conduits under buildings shall be suspended with conduit hangers or racks.
8. Pipe hangers for individual conduits shall be factory made, consisting of a pipe ring and threaded suspension rod. Pipe ring shall be malleable iron, split and hinged, and shall securely hold conduit, or shall be spring able wrought steel. Rings shall be bolted to or interlocked with suspension rod socket. Rods shall be 3/8" for 2" conduit hangers and smaller and shall be 1/2" for 2-1/2" conduit hangers and larger.
9. Factory-made pipe straps shall be one or 2-hole formed galvanized clamps, heavy duty type, except where otherwise specified.

10. Hangers straps, rods, or pipe supports under concrete shall be attached to inserts set at time concrete is poured. Under wood use bolts, lag bolts, or lag screws; under steel joists or trusses use beam clamps.

3.02 CONDUIT INSTALLATION

- A. Cut conduit square using a saw or pipe cutter; de-burr cut ends.
- B. Bring conduit to the shoulder of fittings and couplings and fasten securely.
- C. Use conduit hubs or sealing locknuts for fastening conduit to cast boxes, and for fastening conduit to sheet metal boxes in damp or wet locations.
- D. Install no more than equivalent of two 90- degree bends between boxes for conduits 2" diameter and larger, three for conduit under 2" diameter. Locate pull boxes as required.
- E. Use conduit bodies to make sharp changes in direction, as around beams.
- F. Use hydraulic one-shot conduit bender or factory elbows for bends in conduit larger than 2 inch size.
- G. Avoid moisture traps where possible; where unavoidable, provide junction box with drain fitting at conduit low point.
- H. Support rigid, intermediate and thin wall conduit at 8'-0" maximum on centers and 3'-0" from junction boxes.
- I. Support flexible and liquidtight flexible conduit at 4'-0" maximum on centers and 12" from junction boxes.
- J. Provide No. 12 AWG insulated conductor or suitable pull string in empty conduit, except sleeves and nipples.
- K. Install expansion-deflection joints where conduit crosses building expansion or seismic joints.
- L. Where conduit penetrates fire-rated walls and floors, seal opening around conduit with UL listed fire barrier, "3M" calk or equal.
- M. Route conduit to roof mounted devices and equipment through roof jacks. Provide flashing/roof jacks for all new and existing conduits which penetrate roof to appropriate Roofing Section(s) for installation.

- N. Run conduit to equipment on roof concealed in attic space. Penetrate roof at equipment locations only.
- O. For conduits to roof mounted HVAC equipment, penetrate roof with roof jacks outside footprint of HVAC units. Do not penetrate roof inside HVAC units.
- P. Do not use aluminum conduit below grade, cast in concrete or in masonry in contact with earth.
- Q. Cut threads on rigid conduit to standard taper and to a length such that all bare metal exposed by threading operation will be completely covered by couplings or fittings used. In addition, cut lengths of thread such that all joints will become secure and wrench tight just preceding point where conduit ends would butt together in couplings and where conduit ends would butt into ends or shoulders of other fittings. Securely tighten all threaded connections.
- R. Make joints in rigid conduit installed in concrete or masonry liquid-and-gas-tight, with red lead and oil, or other approved joint compound and engage not less than five threads.
- S. Keep bends and offsets in conduit runs to an absolute minimum. Replace all deformed, flattened or kinked conduit. Provide large radius factory made bends or power bend rigid metal conduit of 1-1/4" trade size or larger.
- T. Penetration Membrane: Where penetration cannot be avoided, cut and re-seal membrane at point of penetration.
- U. Run exposed conduit parallel with or at right angles to building line, beams, or ceilings. Place symmetrical bends or metal boxes at changes in direction or taps.
- V. Stub from each panel which is flush mounted in a wall, from top of panel a minimum of 3-3/4" conduits to nearest ceiling space or other accessible locations and cap for future use. Tag to indicate panel origination.
- W. Independently support conduit rising from floor for motor connections if over 24" above floor. Support shall not be a motor or duct work which may transmit vibrations.
- X. Provide pull wire in all conduit runs indicated as conduit only (C.O.).
- Y. Do not run conduit closer than 12" to any hot water pipe, steam pipe, heater flue or vent.
- Z. Terminate conduit stub-ups through floor for connection to equipment of junction boxes in couplings flush with top of concrete slab floor.

- AA. Use rigid metal conduit where legally required, where exposed to weather, where located in unheated areas, or where subject to mechanical injury, here defined as exposed conduit less than 7'-6" above floor in areas accessible to anyone other than authorized operating or maintenance personnel.
- BB. Where a conduit from one structure crosses to another structure, e.g., from a building to an arcade or from one arcade to another arcade, use a section of liquid-tight flex conduit at the crossing with sufficient slack to allow the two structures to move during an earthquake without breaking the conduit. For stub up to relocatable buildings, provide liquid-tite flex from stub up to first box on back of building.
- CC. Provide a green insulated ground wire in all flexible conduit runs regardless of length.
- DD. Install an equipment ground (green) insulated conductor in each non-metallic conduit.
- EE. Flash and counter flash all conduit runs passing through roof.
- FF. Use electrical metallic tubing above grade in dry locations only and where not subject to mechanical injury or otherwise prohibited. Concrete and masonry in contact with earth are not considered dry locations.
- GG. Use liquid tight flexible conduit for final connections to motors and vibrating equipment. Use flexible conduit where required for equipment servicing for connections to recessed lighting fixtures from nearby accessible junction boxes, and for concealed runs in dry locations where structural conditions prevent use of other types of conduit.
- HH. Size all conduits as legally required or larger where indicated or preferred. Where portions of a conduit run are increased in size, for whatever reason, make all remaining portions in that run same size.
- II. Do not cut concrete, masonry or structural members except where approved by Architect.

END OF SECTION

SECTION 260534

BOXES

PART 1: GENERAL

1.01 RELATED DOCUMENTS

- A. Addenda, Alternates, Drawings and general provisions of Contract, including General and Supplementary Conditions and Division-01 Specifications collectively apply to work of this Section.

1.02 DESCRIPTION

- A. Work includes but is not limited to the following:
 - 1. Wall and ceiling outlet boxes.
 - 2. Pull and junction boxes.
 - 3. Sealant.
- B. Related Work:
 - 1. Section 260100 - Basic Materials and Methods.
 - 2. Section 260533 - Conduit

PART 2: PRODUCTS

2.01 ACCEPTABLE MANUFACTURERS-OUTLET BOXES

- A. Raco
- B. Steel City
- C. Bowers

2.02 OUTLET BOXES

- A. Sheet Metal Outlet Boxes: One piece galvanized, pressed steel, knockout type, 4-11/16" sq. by 2-1/8" deep in all locations unless otherwise indicated or required.

- B. Cast Boxes: Aluminum, or Cast ferroalloy, deep type, gasketed cover, threaded hubs.
- C. Where Wiremold type box have to be used, e.g., on existing concrete wall, provide proper box such that the total depth of a box including the device mounted on the box, will not exceed 4 inches.

2.03 PULL AND JUNCTION BOXES

- A. Interior and non-weatherproof boxes shall be constructed of blue or galvanized steel with ample laps, spot welded, and shall be rigid under torsional and deflecting forces. Boxes shall have auxiliary angle iron framing where necessary to ensure rigidity. Covers shall be fastened to box with a sufficient number of brass machine screws to ensure continuous contact all around. Flush type boxes shall be drilled and tapped for cover screws at Site if boxes are not installed plumb. All surfaces of pull and junction boxes and covers shall be given one coat of metal primer, and one coat of aluminum paint.
- B. Weatherproof pull and junction boxes shall conform to foregoing for interior boxes with following modifications: Cover of flush mounting boxes shall have a weather-tight gasket cemented to and trimmed even with cover all around. Surface or semi-flush mounting pull and junction boxes shall be UL approved as rain-tight and shall be complete with threaded conduit hubs. All exposed portions of boxes shall be galvanized and finished with a prime coat and coat of baked-on gray enamel.
- C. All junction and pull-boxes shall be rigidly fastened to the structure and shall not depend on conduits for support.
- D. Cast Metal Boxes for Outdoor and Wet Location Installations: Type 4 and Type 6, flat-flanged, surface-mounted junction box, UL listed as rain-tight. Galvanized cast iron OR Cast aluminum box and cover with ground flange, neoprene gasket, and stainless steel cover screws.

2.04 ACCEPTABLE MANUFACTURERS-SEALANT

- A. Crouse Hinds "CHICO"
- B. Permacel
- C. Ductseal

2.05 ACCEPTABLE MANUFACTURERS - FIRE PROOFING SEALANT

- A. Dow Corning
- B. 3M Company

C. Nelson

PART 3: EXECUTION

3.01 COORDINATION OF BOX LOCATIONS

- A. Provide electrical boxes as shown on Drawings, and as required for splices, taps, wire pulling, equipment connections, and code compliance.
- B. Electrical box locations shown on Contract Drawings are approximate unless dimensioned. Verify exact location of floor boxes and outlets in offices and work areas with Owner's representative prior to rough-in.
- C. Locate and install boxes to allow access.
- D. Locate and install to maintain headroom and to present a neat appearance.

3.02 OUTLET BOX INSTALLATION

- A. Unless otherwise noted on plan or specifically allowed by the Engineer, conceal all boxes flush in wall or in ceiling space above drop ceiling. In finished areas and where it is not possible to conceal conduits and boxes, for example, on existing concrete wall, provide Wiremold type metallic surface raceways and boxes.
- B. Do not install boxes back-to-back in walls. Provide minimum 6 inch separation, except provide minimum 24 inch separation in acoustic-rated walls.
- C. Provide knockout closures for unused openings.
- D. Support boxes independently of conduit except for cast box that is connected to two rigid metal conduits, both supported within 12 inches of box.
- E. Use multiple-gang boxes where more than one device are mounted together; do not use sectional boxes. Provide barriers to separate wiring of different voltage systems.
- F. Install boxes in walls without damaging wall insulation.
- G. Coordinate mounting heights and locations of outlets mounted above counters, benches, and backsplashes.
- H. Position outlets to locate lighting fixtures as shown on reflected ceiling plans.
- I. In inaccessible ceiling areas, position outlets and junction boxes within 6 inches of recessed lighting fixture, to be accessible through lighting fixture ceiling opening.

- J. Provide recessed outlet boxes in finished areas; secure boxes to interior wall and partition studs. Accurately position to allow for surface finish thickness. Use stamped steel stud bridges for flush outlets in hollow stud wall, and adjustable steel channel fasteners for flush ceiling outlet boxes. Install plaster rings to interface with equipment to be mounted thereon.
- K. Align wall-mounted outlet boxes for switches, thermostats, and similar devices.
- L. Provide cast outlet boxes in exterior locations and wet locations. Provide cast bell-boxes at interior locations where box is exposed to view. (do not use regular 4/s or handy box with exposed knockouts and unfinished appearances for these interior exposed applications).
- M. Where boxes are installed in fire rated ceiling or walls, be responsible for preserving integrity of fire rating as required.
- N. In fire-rated wall, use 4" square deep boxes. Do not aggregate more than 100 square inches of boxes for any 100 square feet of wall or partitions. Separate outlet boxes on opposite sides of walls or partition by a minimum horizontal distance of 24 inches. Where the separation cannot be achieved due to site condition, provide 2-hour rated fire-proof material behind boxes to maintain fire rating of walls.

3.03 PULL AND JUNCTION BOX INSTALLATION

- A. Locate pull boxes and junction boxes above accessible ceilings or in unfinished areas.
- B. Support pull and junction boxes independent of conduit.

END OF SECTION

SECTION 283100

FIRE ALARM SYSTEMS

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Addenda, Alternates, Drawings and general provisions of Contract, including General and Supplementary Conditions and Division 01 Specifications collectively apply to work of this Section.

1.2 WORK INCLUDED

- A. Section Includes:

1. The work under this section includes all labor, material, equipment, supplies, labor, testing, and accessories required to demolish the existing system and furnish and install a complete new automatic Emergency Voice/Alarm Communications type Fire Alarm System as indicated on the drawings and as specified herein. Remove existing initiating & signaling circuits to new panel. Program new panel to include reconnected devices.
2. It is the intent of the Drawings and Specifications for the Contractor to provide and install a complete, fully operational, and tested system.
3. All miscellaneous system components including, but not limited to control panels, digital communicator, alarm detection devices, alarm initiation devices, alarm indicating devices, voice/amplifier panels, remote power supplies, terminal cabinets, terminal blocks, conduits, wires, programming, testing, etc, as well as any other related items, shall be furnished and installed complete under this section, such that the system shall perform all functions listed herein in compliance with all of the specified requirements.
4. The complete installation shall conform to the following codes:

2019 Building Standards Administrative Code
2019 California Building Code (CBC)
2019 California Electrical Code (CEC)
2019 California Fire Code (CFC)
2016 NFPA-72
Underwriters Laboratories Inc.

All equipment shall be approved by Underwriters Laboratories, Inc. for its intended purpose, listed as power limited by Underwriters Laboratories, Inc., for the following standards as applicable:

UL 864 UOJZ	Control units for Fire Protective Signaling Systems
	Local Signaling Unit
	Central Station Signaling Protected Premises Unit

	Remote Signaling Protected Premises Unit.
	Water Deluge Releasing Unit
UL 268	Smoke Detectors for Fire Protective Signaling systems.
UL 521	Heat Detectors for Fire Protective Signaling systems.
UL 464	Audible Signaling appliances
UL 1638	Visual Signaling appliances
UL 38	Manually Activated Signaling Boxes
UL 1481	Power Supplies for Fire Protective Signaling systems.
UL 2572	Control and Communication Units for Mass Notification Systems

B. Related Sections:

1. Section 26 0100: Basic Materials and Methods.
2. Section 26 0533: Conduit
3. Section 26 0519: Wire and Cable
4. Section 26 0534: Boxes

1.3 SYSTEM REQUIREMENTS

- A. Fire detection system shall continually supervise and monitor the following initiating, signaling, and monitoring circuits:
1. Manual fire-pull stations.
 2. Smoke and heat detectors, monitor modules, relay modules, etc.
 3. Alarm signaling circuits including alarm, horns and visual alarm units.
 4. Annunciators.
 5. Power supplies and batteries.
 6. Interconnection with HVAC system.
- B. System controls shall be UL listed for power limited applications in accordance with California Electrical Code.
- C. The fire alarm devices and equipment shall be listed for installation for the fire alarm control panel to which they are being connected.
- D. System labels and devices programming addresses shall be based on actual signage and building labeling as currently exist.

1.4 CERTIFICATION

- A. Certification: Installation of fire alarm system shall not begin until Shop Drawings, including State Fire Marshal listing numbers of fire alarm components, are submitted and reviewed by the Architect. Written certification by fire alarm equipment distributor or manufacturer shall be submitted to the Architect stating that system and its component parts are as approved and listed by the State Fire Marshal, and that the design conforms to requirements set forth in CBC.

1.5 PERFORMANCE

- A. System shall be fully programmable, configurable, and expandable in the field without special tools or PROM programmers and shall not require replacement of memory ICs. Installer shall provide a CD of all system installed software, site specific system programming and all information and tools required to re-program or modify the system.

1.6 SYSTEM FUNCTIONAL OPERATION

- A. Alarms:
 - 1. When a device indicates any alarm condition, the control panel must respond within 10 seconds. The general Alarm or Supervisory alarm LED on the annunciator(s) should light and the LCD should prompt the user as to the number of current events. The alarm information must be stored in event memory for later review. Event memory must be available at the main and all remote annunciators.
 - 2. When the alarmed device is restored to normal, the control panel shall be required to be manually reset to clear the alarm condition, except that the alarms may be silenced as programmed.
 - 3. An alarm shall be silenced by a code or firefighter key at the main or remote annunciators. When silenced, this shall not prevent the resounding of subsequent events if another event should occur (subsequent alarm feature). When alarms are silenced the Silenced LED on the control panel, and on any remote annunciators, shall remain lit until the alarmed device is returned to normal.
- B. Troubles
 - 1. When a device indicates a trouble condition, the control panel Trouble LED on the annunciator(s) should light and the LCD should prompt the user as to the number of current events. The trouble information must be stored in event memory for later review. Event memory must be available at the main and all remote annunciators.
 - 2. When the device in trouble is restored to normal, the control panel shall be automatically reset. The trouble restore information must be stored in event memory for later review. Event memory must be available at the main and all remote annunciators. A trouble shall be silenced by a code or firefighter key at the main or remote annunciators. When silenced, this shall not prevent the resounding of subsequent events if another event should occur.
- C. Supervision Methods
 - 1. Each SLC loop shall be electrically supervised for opens and ground faults in the circuit wiring, and shall be so arranged that a fault condition on any loop will not cause an alarm to sound.

2. Additionally, every addressable device connected to the SLC will be supervised and individually identified if in a fault condition. The occurrence of any fault will light a Trouble LED and sound the system trouble sounder, but will not interfere with the proper operation of any circuit which does not have a fault condition.
3. Each indicating appliance circuit shall be electrically supervised for opens, grounds and short circuit faults, on the circuit wiring, and shall be so arranged that a fault condition on any indicating appliance circuit or group of circuits will not cause an alarm to sound. The occurrence of any fault will light the trouble LED and sound the system trouble sounder, but will not interfere with the proper operation of any circuit which does not have a fault condition.

1.7 POWER REQUIREMENTS

- A. The fire alarm control panel, voice control panels and remote power supply shall receive 120 VAC power, 60 Hz, through a dedicated 20 amps circuit. Circuit breaker protection for the dedicated fire alarm power circuits shall be equipped with a handle lock-on device, the breaker handle shall be colored red and labeled "FIRE ALARM". Clearly label the Electrical panel name, location and circuit number on the inside of the fire alarm control panel and all remote power supplies using a p-touch style labeling system. Transient voltage surge suppression shall be provided at the 120VAC input terminal.
- B. Circuits requiring system operating power shall be 24 VDC and shall be individually protected at control panel.

1.8 SYSTEM DESIGN PARAMETERS

- A. Standby power
 1. The standby power supply shall be an electrical battery with capacity to operate the system under maximum supervisory load for twenty four (24) hours and capable of operating the system for five (15) minutes of evacuation alarm on all devices, operating at maximum load. The system shall include a charging circuit to automatically maintain the electrical charge of the battery. The system shall automatically adjust the charging of the battery to compensate for temperature.
- B. Voltage Drop
 1. Under all operating conditions, the voltage on the NAC must be sufficient to operate all the notification appliances so that they deliver the proper signal intensity. The worst case operating condition shall be calculated from when the control units' primary powers supply has failed and the battery capacity is at its lowest point. An end of useful battery life starting value of 20.4 Volts shall be used at the starting voltage unless the manufacturer's instructions indicate that a higher or lower value should be

- used. The current draw of an appliance at the minimum listed operating voltage (16 Volts) should be used.
2. The point-to-point Ohm's Law voltage drop calculations of all alarm system circuits shall not exceed
- C. Spare Capacity
1. The system shall be engineered to accommodate 20% spare capacity on each individual loop, and 20% spare on system power supplies.
- D. Circuiting Guidelines
1. Initiating Device Circuits
 - a. Where necessary, conventional initiating device circuits (i.e. waterflow switches, valve supervisory switches, fire pump functions, etc.) shall be Class B (Style "A" or "B").
 2. Notification Appliance Circuits
 - a. All notification appliance circuits shall be Class B (Style "Y"). The notification circuits shall be power limited. Non-power limited circuits are not acceptable.
 3. Signaling Line Circuits: Addressable Analog Devices
 - a. The signaling line circuit connecting to addressable/analog devices including, detectors, monitor modules, control modules, isolation modules, intrusion detection modules and notification circuit modules shall be Class B (style 4).
 - b. Each addressable analog loop shall be circuited so device loading is not to exceed 80% of loop capacity in order to leave for space for future devices.
 4. Signaling Line Circuits: Data & Audio for FACP & Annunciator Network
 - a. The signaling line circuit connecting network panel/nodes, annunciators, command centers, shall be Class A (style 7). The media shall be copper except where fiber optic cable is specified on the drawings.

1.09 SUBMITTALS

- A. Component Plan Submittal: Availability and listing for its application shall be verified for all system components before presentation of the submittal. Include the following information and details as applicable:
1. Installer name, address, telephone number.

2. List of system components, equipment and devices, including manufacturer model numbers, quantity and California State Fire Marshal listing numbers, mounting heights, and symbols.
 3. Current copies of manufacturer specification sheets for equipment and devices indicated. Highlight or identify the specific components on Catalog cut sheets.
 4. Voltage Drop Calculations: Include the following information for the worst case:
 - a. Point-to-point or Ohms law calculations.
 - b. Zone used in calculations.
 - c. Voltage drop percent. Voltage drop shall not exceed manufacturer's requirements. If voltage drop exceeds 10 percent, indicate manufacturer listed operating voltage ranges for equipment and devices.
 - d. Speakers and amplifier calculations.
 5. Battery types, amp hours, and load calculations including the following:
 - a. Normal operation: 100 percent of applicable devices for 24 hours to equal control panel amps plus list of amps per device that draw power from the panel during standby power condition including, but not limited to, zone modules, detectors and devices as identified.
 - b. Alarm condition: 100 percent of voice communication speakers for 15 minutes and 100 percent of horns and bells for 5 minutes to equal control panel amps plus list of amps per device that draw power from panel during alarm condition including, but not limited to, the following:
 - (1) Zone modules.
 - (2) Signal modules.
 - (3) Detectors.
 - (4) Signal devices.
 - (5) Annunciator.
 - (6) Other devices as identified.
 - c. Normal operation plus alarm operation load calculation shall include total amp hours required and total amp hours provided.
 6. Provide one copy of testing procedures.
- B. Shop Drawings: Provide Shop Drawings, in the same size as the design Drawings, Shop Drawings shall include the following:
1. Provide drawing scale, elevations of all system enclosures, and actual layout of the Fire Alarm Control Panel, power supply, annunciator, and all main system components.

2. Site Plan indicating equipment to be monitored or supervised; such as water flow valves, and main equipment such as control panels, power supplies, annunciators, and components such as outdoor wall-mounted horns, sprinkler bells, pull boxes, underground pull boxes, wiring routes on buildings exterior and underground locations. In each conduit or raceway run indicate conduit sizes, and quantities and type of wires.
3. Complete battery calculations, and voltage drop calculation shall be included; these calculations shall be based on the devices maximum UL current rating.
4. One line drawing for the entire system network indicating all system components and wiring. The one line diagram shall show but not be limited to panel to panel interconnections, conductors gauge and quantity, conduit size and type (designation) and specific function.
5. System panel one-line drawings indicating the quantity and type (designation) of conductors entering and exiting the fire alarm terminal cabinet in each building (enclosure) for initiating, notification, or other command control functions required for complete system operation:
 - a. Individual floor/building plan view drawings indicating all device locations including end of line resistors “EOLR” in accordance with the legend provided.
 - b. Individual point addresses for all initiation and notification devices.
 - c. Device “typical” wiring diagrams. These drawings shall indicate specific termination details for all peripheral equipment and/or interface devices.
6. Provide interfacing with equipment furnished by others including voltages, and other required coordination items.
7. Each of the pictorial diagrams included shall appear identical to the products they are intended to depict, in order to speed installation of the system, and to enhance the accuracy of the installation Work. Typical wiring diagrams or catalog sheets are not permitted.
8. Background Drawings with device locations of DSA approved drawings are available in electronic format and may be obtained from the Architect. Contractor is solely responsible for the accuracy and completeness of shop drawings. Buildings that are not part of the contract shall be clearly identified “NOT IN CONTRACT”. Shop Drawings shall be prepared in the latest version of AutoCAD.
9. Other installation and coordination drawings specifically related to this section shall be included as follows:
 - a. Size A (8-1/2 inch x 11 inches) and size B (11 inch x 17 inch) shall be bound into the manual.
 - b. Larger drawings shall be folded and inserted into transparent envelopes and bound into the manual.

10. Installation and coordination drawings for items in other sections shall be included with submittal of Shop Drawings. Submit blue line copies and one reproducible copy of installation and coordination drawings.
- C. In addition to the above requirements, provide submittals to meet any additional requirements of DSA.

1.10 QUALITY ASSURANCE

- A. Installer shall have successfully completed at least 5 projects of equal scope in the past 5 years, and have been in business of furnishing and installing fire alarm systems of this type for at least 5 years. Installer shall use apprentices with certified Life Safety Blue Card Holders.
- B. Installer shall be a factory authorized distributor and service provider for the brand of equipment offered and shall provide documentation to the Architect upon request.
- C. Installer shall maintain a fully equipped service organization capable of furnishing repair service to the equipment and shall maintain a spare set of major parts for the system at all times.
- D. Installer shall furnish a letter from manufacturer of equipment certifying equipment has been installed according to factory standards and that system is operating properly.
- E. Certifications: Installer shall submit certification from the equipment manufacturer indicating that installer is an authorized representative of the equipment manufacturer and is trained on network applications.
- F. All materials and equipment installed shall be new except as specifically shown on the drawings.
- G. All of the fire alarm equipment, devices and wiring in this specification including control panel, remote power supplies, detectors, modules, speakers, strobes, fire alarm wires, etc., shall be furnished and installed by the Authorized Factory Distributor of the equipment. Furnish a letter from the manufacturer of all major equipment, which certifies that the installer is an authorized distributor and that the equipment has been installed according to factory intended practices. Furnish a written guarantee from the manufacturer that they will have a service representative assigned to this area for the life of the equipment. All rough-ins including conduits, boxes, 120-volt power wiring may be installed by an electrician.
- H. Contractor/Installer's electricians and fire/life safety technicians shall be certified in accordance with Labor Code sections 3099, and 3099.2, and section 209.0 of the California Code of Regulations.

- I. System startup and testing shall be performed under the direct observation of the IOR and OAR. The Contractor at this time shall provide a legible half size reproduction of the original completed fire alarm red-line drawings (this copy will be retained by the Owner), an accurate copy of the fire alarm system points list, and a copy of the construction drawings on CD in AutoCAD format,
- J. Provide and install the most current software package available at the time of installation. At the time of Owner Acceptance of the installation, all equipment, including any and all updated software which is to include the appropriate operating system, pass-codes, electronic keys and program disks, manuals and cables employed in the installation of the system, shall be delivered to the OAR who will, in turn, forward the items to the District. In addition, when the programming software is available in disk format, a backup copy of the most up to date revision, in disk format, shall be delivered to the OAR at the completion of the project. A software license agreement shall be made available for the responsible Owner representative to sign at the time of training.

1.11 WARRANTY

- A. The Fire Alarm Equipment Manufacturer shall provide a 3-year material warranty. Installer shall provide a 3-year labor warranty.
- B. Complete maintenance and repair service for the fire alarm system shall be available from a factory trained authorized representative of the manufacturer for a period of 5 years after expiration of the warranty.

1.12 MAINTENANCE PERIOD

- A. Maintenance Service: Provide, as part of the Work of this section, a 12 month maintenance service period commencing from the date of Substantial Completion.
- B. Maintenance and testing shall be as required by local authorities having jurisdiction. A preventive maintenance schedule shall be provided, describing the plan for preventive maintenance of devices and subassemblies requiring regular maintenance. The schedule shall include:
 - 1. Systematic examination, adjustment and cleaning of detectors, manual fire alarm stations, control panels, power supplies, relays, water flow switches and accessories of the fire alarm system.
 - 2. Circuits in the fire alarm network shall be tested semiannually.
 - 3. System shall be tested in accordance with the requirements of NFPA 72.

PART 2 - PRODUCTS

2.1 MANUFACTURERS

- A. All existing panels and peripheral devices shall be of the standard product of single manufacturer and shall display the manufacturer's name of each

component. The catalog numbers specified under this section are those of Silent Knight 6820EVS and shall constitute the type, product quality, material and desired operating features.

2.2 GENERAL

- A. All equipment and components shall be the manufacturer's current model. The materials, appliances, equipment and devices shall be tested and listed by a nationally recognized approval agency for use as part of a protected premises (fire alarm) system.
- B. The contractor shall provide, from the acceptable manufacturer's current product lines, equipment and components, which comply, with the requirements of these specifications. Equipment or components, which do not provide the performance and features, required by these specifications are not acceptable, regardless of manufacturer.
- C. All System components shall be the cataloged products of a single supplier. All products shall be UL listed by the manufacturer for their intended purpose.
- D. All control panel assemblies and connected field appliances shall be both designed and manufactured by the same company, and shall be tested and cross-listed as to ensure that a fully functioning system is designed and installed.

2.3 FIRE ALARM CONTROL PANEL (FACP)

- A. Control Panel with Emergency Voice System
 - 1. The existing fire alarm control panels (FACP) are Silent Knight 6820 EVS analog addressable control panel. The existing audio amplifiers are Silent Knight EVS-50W as required voice evacuation units. The FACP shall have a 9 amp power supply and be capable of expansion via bus connected expander modules that supervise low battery, loss off AC and loss of communication.
 - 2. The system must contain at least one Silent Knight EVS-50W watt amplifier and shall be expandable up to 2000 watts utilizing 16 additional amplifiers. Each amplifier shall be capable of adding a 4-zone splitter (Silent Knight EVS-CE4) to distribute the audio information to different locations in the installation. The amplifiers must contain the capability of being remotely located through a four-wire SBUS communications circuit and a two-wire VBUS circuit.
 - 3. The voice evacuation system must have the capability of downloading 15 to 60 second messages and utilize DSP technology for higher audio intelligibility.
 - 4. The voice evacuation system shall be capable of operating at 25vrms or 70.7vrms, must be field selectable at the amplifier level. Systems that require additional modules for voltage conversion shall not be accepted.

5. The existing main panel shall contain one SLC circuit and three 5815XL expander modules. Each SLC circuit shall support up to 159 detectors and 159 modules. The communication protocol on the SLC loop must be digital.
6. The existing FACP shall support programmable Flexput circuits. The panel shall have a built in LCD annunciator with the capability of having additional supervised remote annunciators connected in the field.
7. The existing FACP must have a built-in UL approved digital communicator. The communicator must allow local and remote up/downloading of system operating options, event history, and detector sensitivity data.
8. The existing FACP must automatically test the smoke detectors in compliance with NFPA standards to ensure that they are within listed sensitivity parameters and be listed with Underwriters Laboratories for this purpose.
9. The existing FACP must compensate for the accumulation of contaminants that affect detector sensitivity. The existing FACP must have day/night sensitivity adjustments, maintenance alert feature (differentiated from trouble condition), detector sensitivity selection, auto-programming mode (Jumpstart) and the ability to upgrade the core operating software on site or over the telephone.
10. The existing FACP must have maintenance alert feature (differentiated from trouble condition) and a calibration trouble condition.
11. The existing FACP shall have a Jumpstart feature that can automatically enroll all properly connected accessories into a functional system within 60 seconds of powering up the panel. Panels that do not have these capabilities will not be accepted.
12. The existing main communication bus (SBUS RS485) shall be capable of class A or class B configuration with a total bus length of 6,000 feet.

2.4 System Wiring

- A. The Signaling Line Circuit (SLC) and data communication bus (SBUS) shall be wired with standard NEC 760 compliant wiring. No twisted, shielded or mid-capacitance wiring is required for standard installations. All FACP screw terminals shall be capable of accepting 14-18 AWG wire. All system wiring shall be in accordance with the requirements of NFPA 70, the National Electrical Code (NEC) and also comply with article 760 of the NEC.

2.5 Signaling Line Circuits

- A. Each SLC shall be capable of a wiring distance of 10,000 feet from the SLC driver module (5815XL) and be capable of supporting 159 detectors and 159 addressable module devices. The communication protocol to SLC devices must be digital. Any SLC loop device which goes into alarm must interrupt the polling cycle for priority response from the FACP. The FACP must respond consistently to a device that goes into alarm on an SLC within 10 seconds. The auxiliary

5815XL SLC loop module must be capable of being located up to 6000 feet from the FACP on the SBUS, which is separate from the SLC circuit. The SLC shall be capable of functioning in a Class A or Class B configuration.

2.6 SLC Loop Devices

- A. Devices supported must include addressable photoelectric and ionization smoke detectors, addressable heat detectors, addressable input modules, relay output modules or addressable notification modules. There is to be no limit to the number of any particular device type up to the maximum of 99 detectors and 99 addressable modules that can be connected to the SLC.

2.7 Addressable Detector Functions

- A. The products of combustion detectors must communicate analog values using a digital protocol to the control panel for the following functions:
 - 1. Automatic compliance with NFPA 72 standards for detector sensitivity testing
 - 2. Drift compensation to assure detector is operating correctly
 - 3. Maintenance alert when a detector nears the trouble condition
 - 4. Trouble alert when a detector is out of tolerance
 - 5. Alert control panel of analog values that indicate fire.

2.8 Programmable Flexputs

- A. The existing FACP shall support programmable Flexput circuits that are capable of being programmed as supervised reverse polarity notification circuits or supervised auxiliary power circuits that can be programmed as continuous, resettable or door holder power. The circuits shall also be programmable as input circuits in Class A or Class B configurations to support dry contact or compatible two wire smoke detectors.

2.9 Addressable Notification Module

- A. The contractor shall furnish and install where indicated on the plans, addressable notification modules. The modules shall be U.L. listed compatible with existing Silent Knight 6820 EVS fire alarm control panel. The notification module must provide one Class A or Class B notification output with one auxiliary power input. The notification module must be suitable for mounting in a standard 4 inch square electrical box and must include a plastic cover plate. The notification module must provide an LED that is visible from the outside of the cover plate. The notification module must be fully programmable for such applications as required by the installation. The SK-Control shall reside on the SLC loop and can be placed up to 10,000 feet from the control or 5815XL SLC loop module.

2.10 Annunciators

- A. The existing main control has a built-in annunciator with LCD display and feature LED's for General Alarm, Supervisory, System Trouble, System Silence and Power. When in the normal condition the LCD shall display time and date based on a 200-year clock which is capable of automatic daylight savings time adjustments. All controls and programming keys are silicone mechanical type with tactile and audible feedback. Keys have a travel of .040 inches. No membrane style buttons will be permissible. The annunciator must be able to silence and reset alarms through the use of a keypad entered code or by using a firefighter's key. The annunciators must have twenty levels of user codes that will allow the limitation of operating system programming to authorized individuals.

2.11 Remote Annunciators

- A. Existing EVS-LOC Remote Command Unit with display and microphone. LCD remote annunciators shall have the same control and display layout so that they match identically the built-in annunciator. LED remote annunciators shall have individually mapped LED's and reset and silence inputs. The reset and silence inputs must use the same firefighter's key as the LCD annunciators. Remote annunciators shall be capable of operating at a distance of 6000 feet from the main control panel on unshielded, non-twisted cable.

2.12 I/O Module

- A. The existing fire system shall be able to support I/O modules, which shall be used to drive remote LED graphic style displays and accommodate. The I/O module inputs shall be supervised and be suitable for alarm and trouble circuits as well as reset and silence switches.

2.13 Serial/Parallel Interface

- A. The fire system shall be capable of supporting up to two (2) serial / parallel interface modules that are capable of driving standard computer style printers. The interface shall be programmable as to what information is sent to it and shall include the ability to print out detector status by point, event history by point and system programming. Provide (1) interface module.

2.14 Distributed Power Modules

- A. The existing power modules model 5496 compatible with the fire alarm control panel has 6 amps of output power with four (4) notification circuits rated at 3 amps each. The four notification circuits shall operate as reverse polarity notification outputs or auxiliary power outputs for constant, resettable, or door holder applications. The module shall be capable of being connected via the SBUS at a maximum distance of 6000 feet from the main control panel.
- B. The power module's SBUS bus shall be electrically isolated providing ground loop isolation and transient protection.

2.15 Digital Communicator

- A. The existing digital communicator must be an integral part of the control panel and be capable of reporting all zones or points of alarm, supervisory, and trouble as well as all system status information such as loss of AC, low battery, ground fault, loss of supervision to any remote devices with individual and distinct messages to a central station or remote station. The communicator must also be capable of up/downloading of all system programming options, event history and sensitivity compliance information to a PC on site or at a remote location.
- B. The existing communicator shall have an answering machine bypass feature that will allow the panel to respond to communication even on phone lines that have other communication equipment present. The communicator must be capable of reporting via SIA and Contact ID formats. The communicator shall have a delayed AC loss report function which will provide a programmable report delay plus a 10-25 min random component to help ease traffic to the central station during a power outage. No controls that use external modems for remote programming and diagnostics shall be accepted.

2.16 Dry Contacts

- A. The existing FACP will have form "C" dry contacts, one will be dedicated to trouble conditions, the other two will be programmable for alarm, trouble, sprinkler supervisory, notification, pre-alarm, waterflow, manual pull, zone aux. 1 or zone aux. 2. The trouble contact shall be normal in an electrically energized state so that any total power loss (AC and backup) will cause a trouble condition. In the event that the microprocessor on the FACP fails, the trouble contacts shall also indicate a trouble condition.

2.17 Ground Fault Detection

- A. There is a ground fault detection circuit to detect positive and negative grounds on all field wiring. The ground fault detection shall operate the general trouble devices as specified but shall not cause an alarm to be sounded. Ground fault will not interfere with the normal operation, such as alarm, or other trouble conditions.

2.18 Overcurrent Protection

- A. All low voltage circuits will be protected by microprocessor controlled power limiting or self restoring poly switches for the following: smoke detector power, main power supply, indicating appliance circuits, battery standby power and auxiliary output.

2.19 Test Functions

- A. A Lamp Test mode shall be a standard feature of the fire alarm control panel and shall test all LED's and the LCD display on the main panel and remote annunciators.

- B. A Walk Test mode shall be a standard feature of the fire alarm control panel. The walk test feature shall function so that each alarm input tested will operate the associated notification appliances for six seconds. The FACP will then automatically perform a reset operation and confirm normal device operation. The event memory shall contain the information on the point tested.
- C. A Fire Drill mode shall allow the manual testing of the fire alarm system notification circuits. The Fire Drill shall be capable of being controlled at the main annunciator, remote annunciators and a remote contact input.
- D. A bypass mode shall allow for any point or NAC circuit to be bypassed without effecting the operation of the total fire alarm system.

2.20 Remote Input Capabilities

- A. The existing control panel shall have provisions for supervised switch inputs for the purpose of alarm reset and alarm and trouble restore.

2.21 Notification Appliance Mapping Structure

- A. All notification circuits and modules shall be programmable via a mapping structure that allows for a maximum of 250 output groups. Each of these groups shall have the ability to be triggered by any of the panel's 125 zones. A zone may trigger groups individually or may contain a global trigger for manual pull stations, fire drills and two different system alarms. Additionally, each zone will individually control the cadence pattern of each of the groups that it is "mapped" to so that sounders can indicate a variety of conditions. The zone shall be capable of issuing a different cadence pattern for each of the groups under its control. The mapping structure must also allow a group to be designated to "ignore cadence" for use with strobes and other continuous input devices. Zones shall have eight different output categories; Detector Alarm, Trouble, Supervisory, Pre-Alarm, Waterflow, Manual pull, Zone Auxiliary 1 and Zone Auxiliary 2. Each of the categories shall have the ability to control from 1 to 8 output groups with a cadence pattern. The patterns are; March Code, ANSI S-3.41, Single Stroke Bell Temporal, California Code, Zone 1 Coded, Zone 2 Coded, Zone 3 Coded, Zone 4 Coded, Zone 5 Coded, Zone 6 Coded, Zone 7 Coded, Zone 8 Coded, Custom Output Pattern 1, Custom Output Pattern 2, Custom Output Pattern 3, Custom Output Pattern 4, Constant, ANSI 4 Temporal, Amseco Synchronization, Faraday Synchronization, Gentex Synchronization, System Sensor Synchronization and Wheelock Synchronization. This mapping/cadence pattern shall be supported by all system power supplies and notification expander modules.

2.22 On-Board Programmer

- A. The existing FACP shall have an on board programmer which will allow for all system functions and options to be programmed via the on board annunciator keypad. Any panel that does not have this capability will not be accepted.

2.23 Downloading Software

- A. The existing fire alarm control panel must support up/downloading of system programming from a PC under Windows XP, Windows Vista, or Windows 7. The FACP must also be able to download the detector sensitivity test results and a 1000 event system event buffer to the PC. Communication shall take place over a direct connection to the PC and/or via the same telephone lines as the built in digital communicator and shall not require an external modem to be connected to the panel. The downloading software shall contain a code that will block unauthorized persons from accessing the panel via direct connection or over the phone lines.

2.24 Facility Management Software

- A. The existing FACP must support facility management software capable of providing off site access to FACP data that is necessary to manage fire system operation. A software package capable of uploading the detector sensitivity test results and the 1000 event system event buffer to the PC shall be required as part of the bid package. Communication shall take place over a direct connection to the PC and/or via the same telephone lines as the built in digital communicator. The facility management package must be separate from the downloading package and must not be capable of affecting programmed system options.

2.25 English Language Descriptions

- A. The existing FACP shall provide the ability to have a text description of each system device, input zone and output group on the system. The use of individual lights to provide descriptions will not be acceptable.

2.26 CONTROL UNIT

- A. Audible System Trouble Sounder
 - 1. An audible system trouble sounder shall be an integral part of the control unit. Provisions shall also be provided for an optional supervised remote trouble signal.
- C. Power Supply and Charger:
 - 1. The entire system shall operate on 24 VDC, filtered switch mode power supply with the rated current available of 9 Amps. The FACP must have a battery charging circuit capable of complying with the following requirements:
Twenty-four (24) hours of battery standby with five (15) minutes of alarm signaling at the end of this twenty-four (24) hour period (as required per NFPA 72 central station signaling requirements) using rechargeable batteries with automatic charger to maintain gel-cell batteries in a fully charged condition.

2. The power supply shall comply with U.L. Standard 864 for power limiting.
3. The existing FACP will indicate a trouble condition if there is a loss of AC power or if the batteries are missing or of insufficient capacity to support proper system operation in the event of AC failure. A battery test will be performed automatically every minute to check the integrity of the batteries. The test must disconnect the batteries from the charging circuit and place a load on the battery to verify the battery condition.
4. In the event that it is necessary to provide additional power one or more of the model distributed power modules shall be used to accomplish this purpose.

D. Connections and Circuits

1. Connections to the light and power service shall be on a dedicated branch circuit in accordance with the National Fire Alarm Code NFPA 72, National Electrical Code (NEC) NFPA 70, and the local authority having jurisdiction (AHJ). The circuit and connections shall be mechanically protected. A circuit disconnecting means shall be accessible only to authorized personnel and shall be clearly marked "FIRE ALARM CIRCUIT CONTROL".

- E. The existing FACP shall support the operation of 159 detectors and 159 addressable module total devices per SLC loop without regard to device type.

2.27 Devices:

Furnish and install, where shown on the drawings, the following devices:

A. Notification Devices

1. The visual and audio/visual signaling devices shall be compatible with the control panel and be listed with Underwriters Laboratories Inc. per UL 1971 and/or 1638. Each indicating appliance circuit shall be electrically supervised for opens, grounds and short circuit faults on the circuit wiring and shall be so arranged that a fault condition on any indicating appliance circuit or group of circuits will not cause an alarm to sound. The occurrence of any fault will light the trouble LED and sound the system trouble sounder, but will not interfere with the proper operation of any circuit which does not have a fault condition. Refer to drawing for specific types.

B. Smoke Detectors

1. Smoke detectors shall be Silent Knight Photo ceiling mounted, addressable photoelectric smoke detectors. The combination detector head and twist lock base shall be U.L. listed compatible with the fire alarm control panel. The base shall be the appropriate twist lock base. The

smoke detector shall have a flashing status LED for visual supervision. When the detector is actuated, the flashing LED will latch on steady at full brilliance. The detector may be reset by actuating the control panel's reset switch. The sensitivity of the detector shall be capable of being selected and measured by the control panel without the need for external test equipment. The vandal security-locking feature shall be used in those areas as indicated on the drawing. The locking feature shall be field selectable when required. It shall be possible to perform a sensitivity test of the detector without the need of generating smoke. The test method shall simulate the effects of products of combustion in the chamber to ensure testing of the detector circuits. Detectors shall have completely closed back to restrict entry of dust and air turbulence and have a 30 mesh insect screen. Electronics of the unit shall be shielded to protect against false alarms from E.M.I. and R.F.I.

C. Heat Detectors

1. Furnish and install analog/addressable heat detectors, Silent Knight. The combination heat detector and twist lock base shall be U.L. listed compatible with the Silent Knight fire alarm control panel. The base shall permit direct interchange with the Ion smoke detector, Acclimate smoke detector and the Photo photoelectric smoke detector. The base shall be appropriate twist lock base. The heat detector shall have a flashing status LED for visual supervision. When the detector is actuated, the flashing LED will latch on steady at full brilliance. The detector may be reset by actuating the control panel's reset switch. The vandal security-locking feature shall be used in those areas as indicated on the drawings. Electronics of the unit shall be shielded to protect against false alarms from E.M.I. and R.F.I.

D. Refer to drawings for speakers, strobes and speaker/strobe units.

PART 3 - EXECUTION

3.1 SYSTEM INSTALLATION

- A. Install required conductors to devices indicated on Drawings. Provide required conductor terminations to devices for a complete system to function as specified and indicated on Drawings. Refer to Section 26 0519: Low-Voltage Wire 600 Volt AC, for wire type and wire color for device types.
- B. Splices shall not be provided in junction boxes. Terminations shall be in terminal cabinets or on equipment terminals.
- C. Conductors shall be installed within conduits, boxes, and terminal cabinets in a totally enclosed installation. Furnish and install conductors required to connect incoming and outgoing circuits, including spare conductors, to terminal strips within terminal cabinets.

- D. Wiring within equipment and terminal cabinets shall be installed to conform to standard engineering practice, and shall be terminated on terminal blocks having terminals for required connections. Wiring shall be cabled, laced, and securely fastened in place so that no weight is imposed on equipment or terminals.
- E. Install required terminal blocks within terminal cabinets. Terminal blocks shall be installed on inside back of cabinets only, not on side. Incoming wiring shall be terminated on the left side of terminal blocks, outgoing wiring shall be terminated on the right side of the terminal blocks.
- F. Conductors shall be color-coded and tagged with code markers at terminal cabinets, junction boxes, pull boxes and equipment. A wire index shall be typed and installed on terminal cabinet doors. Index shall be covered with clear plastic adhesive covers. Wiring shall be identified as to building and location of devices in the index.
- G. Wiring within equipment and terminal cabinets shall be carefully strapped, and shall be formed in rectangular configuration. Wires shall be properly numbered in numerical order and shall maintain same number throughout the Project site.
- H. Complete installation shall comply with local building codes and applicable provisions of the California Electrical Code.
- I. Location of outlet boxes and equipment on Drawings is approximate, unless dimensions are indicated. Do not scale Drawings to determine locations and routing of conduits and outlet boxes. Location of outlet boxes and equipment shall conform to architectural features of the building and other Work already in place, and must be ascertained in the field before the start of Work.
- J. Drawings generally indicate Work to be provided, but do not indicate all bends, transitions or special fittings required to clear beams, girders or other Work already in place. Investigate conditions where conduits are to be installed, and furnish and install required fittings.
- K. Provide a laminated engraved bakelite, or etched metal tag, black lettering on white background, approximately ½" wide x 1" long for each indicating device that is hidden from view, and notification devices that contain an end of line resistor. Tags shall include an abbreviation for the type of device: HD for heat detector, EOL for end of line resistor, DSD for duct smoke detector. Tags shall be permanently attached on access panel or t-bar grid which is used to access a hidden device. Tags for notification devices containing end of line resistors shall be attached to the device or adjacent surface.
- L. Smoke, heat, modules, NAC circuits shall be clearly labeled with clear black round and black lettering to indicate loop and address. Heat detectors shall be labeled in drop ceiling within 4 feet of devices.
- M. NAC circuits shall be labeled like a device with its own address.

- N. Color code wires: blue/yellow for notification circuit. Red/black for auxiliary power.
- O. For surface mount applications, use special finished red electrical boxes compatible with the fire alarm devices and available from the device manufacturer. Do not just use standard electrical boxes with knockouts.

3.2 TESTING

- A. A 24 hour notice shall be provided to the IOR before final testing.
- B. Testing of fire detection system shall be as required by the State Fire Marshal and local authorities having jurisdiction. Installer is responsible for identifying required testing, coordinating, scheduling, and conducting tests before Substantial Completion. Tests shall include the following:
 - 1. Operation of signal-initiating devices (smoke and heat detectors).
 - 2. Operation of indicating devices (alarm speakers).
 - 3. Operation of system features under normal operation.
 - 4. Operation of system supervisory features.
 - 5. Operation of system features on standby power, with primary power off.
 - 6. Before energizing the cables and wires, check for correct connections and test for short circuits, ground faults, continuity, and insulation.
 - 7. Open initiating device circuits and verify that trouble signal actuates.
 - 8. Open signaling line circuits and verify that trouble signal actuates.
 - 9. Open and short notification appliance circuits and verify that trouble signal actuates.
 - 10. Open and short (wire only) network communications and verify that trouble signals are received at network annunciators or reporting terminals.
 - 11. Ground initiating device circuits and verify response of trouble signals.
 - 12. Ground signaling line circuit and verify response of trouble signals.
 - 13. Ground notification appliance circuit and verify response of trouble signals.
 - 14. Check alert tone to alarm notification devices.
 - 15. Check installation, supervision, and operation of intelligent smoke detectors using walk test.
 - 16. Alarm conditions that the system is required to detect shall be introduced on the system. Verify the proper receipt and the proper processing of the signal at the FACP and the correct activation of the control points.
 - 17. When the system is equipped with optional features, consult the manufacturer manual to determine proper testing procedures.
- C. Upon completion of installation of fire alarm equipment, provide to the IOR a signed, written statement confirming that fire alarm equipment was installed in accordance with the Specifications, Shop Drawings, instructions and directions provided by the manufacturer.

- D. Demonstrate in presence of the IOR that circuit and wiring tests are free of shorts and grounds and that installation performs as specified herein and within manufacturer's guidelines.
- E. Software Modifications:
 - 1. If required, provide the services of a factory trained and authorized technician to perform system software modification, upgrades or changes. Response time of the technician to the Project site shall not exceed 24 hours.
 - 2. If required, provide hardware, software, programming tools, and documentation necessary to modify the fire alarm network on the Project site. Modification includes addition and deletion of devices, circuits, zones and changes to system operation and custom label changes for devices or zones. The system structure and software shall place no limit on the type or extent of software modification on-site. Modification of software shall not require power-down of the system or loss of system fire protection while modification are being provided.
- F. Complete the inspection and testing form as required by NFPA 72, and submit one copy of the completed form to the Architect and IOR.

3.3 OPERATING/SERVICE MANUALS

- A. Submit 5 copies of service manuals including the following:
 - 1. Detailed explanation of the operation of the system.
 - 2. Instructions for routine maintenance.
 - 3. Detailed instructions for repair of major components of the system.
 - 4. Pictorial parts list and part numbers.
 - 5. Pictorial and schematic electrical drawings of wiring systems, including operating and safety control panels, annunciators and major components.
 - 6. Installation instructions for system components.
 - 7. Programming instructions.
 - 8. Program listing.
 - 9. Final test report.
 - 10. A single reproducible set of record drawings reflecting the system exactly as it was installed including exact location of components.
 - 11. Provide software and passwords for programming.
 - 12. Provide a print out of the entire programming of the system.

3.4 SPARE PARTS

- A. The following new spare parts shall be furnished in unopened boxes:
 - 1. One spare pull station.
 - 2. Five percent spare smoke and heat detectors (minimum one spare smoke and heat detector per type).

3. Five percent spare audible devices (minimum one spare audible device per type).
4. Five percent spare strobe devices (minimum one spare strobe device per type).

3.5 INSTRUCTION PERIODS

- A. Before Substantial Completion, provide three instruction periods, one for Project site Owner operators and system users and two for Owner maintenance personnel. As a minimum, the following shall be provided:
 1. Provide a minimum of one 4 hour Project on-site instruction period for Owner operators including a complete set of written operating instructions, which shall remain on the Project site.
 2. Provide a minimum of one 8 hour Project site instruction period for Owner maintenance personnel, consisting of a Project site walk-through indicating all device locations and demonstrating all system functions.
 3. Provide a minimum of 16 hour classroom instruction period for owner maintenance personnel consisting of field programming, uploading and downloading data, troubleshooting, cable connections, installing and deleting pass-codes, adding or removing addressable devices or components and general operation. Eight hours of this training shall be actual hands-on training using a laptop computer on system mockups.
 4. All instruction periods shall be scheduled and coordinated by the IOR.

3.6 PROTECTION

- A. Protect the Work of this section until Substantial Completion.

3.7 CLEANUP

- A. Remove rubbish, debris, and waste materials and legally dispose of off the Project site.

END OF SECTION

SECTION 311000

SITE CLEARING

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section Includes:

1. Protecting existing vegetation to remain.
2. Removing existing vegetation.
3. Clearing and grubbing.
4. Stripping and stockpiling topsoil.
5. Removing above- and below-grade site improvements.
6. Disconnecting, capping or sealing, and removing/abandoning site utilities

- B. Related Sections:

1. Division 01 Specifications apply to this section.
2. Division 02 Section and "Site Demolition" for demolition of site improvements.

1.3 DEFINITIONS

- A. Subsoil: All soil beneath the topsoil layer of the soil profile and typified by the lack of organic matter and soil organisms.
- B. Surface Soil: Soil that is present at the top layer of the existing soil profile at the Project site. In undisturbed areas, the surface soil is typically topsoil; but in disturbed areas such as urban environments, the surface soil can be subsoil.
- C. Topsoil: Top layer of the soil profile consisting of existing native surface topsoil or existing in-place surface soil and is the zone where plant roots grow.
- D. Tree-Protection Zone: Area surrounding individual trees, groups of trees, shrubs, or other vegetation to be protected during construction, and indicated on Drawings.
- E. Vegetation: Trees, shrubs, groundcovers, grass, and other plants.

1.4 MATERIAL OWNERSHIP

- A. Except for stripped topsoil and other materials indicated to be stockpiled or otherwise remain Owner's property, cleared materials shall become Contractor's property and shall be removed from Project site.

1.5 INFORMATIONAL SUBMITTALS

- A. Existing Conditions: Documentation of existing trees and plantings, adjoining construction, and site improvements that establishes preconstruction conditions that might be misconstrued as damage caused by site clearing.
 - 1. Use sufficiently detailed photographs or videotape.
 - 2. Include plans and notations to indicate specific wounds and damage conditions of each tree or other plants designated to remain.
- B. Record Drawings: Identifying and accurately showing locations of capped utilities and other subsurface structural, electrical, and mechanical conditions. Provide copy to Engineer of Record.

1.6 QUALITY ASSURANCE

- A. Pre-installation Conference: Conduct conference at project site.

1.7 PROJECT CONDITIONS

- A. Existing Improvements: Provide protections necessary to prevent damage to existing improvements indicated to remain in place.
 - 1. Protect improvements on adjoining properties, public right-of-way and on Owner's property.
 - 2. Restore damaged improvements to their original condition, as acceptable to property owners. The full width of pavements damaged due to construction access and other construction-related activities shall be replaced with a structural section (pavement and base) at least equal to the adjacent existing section.
 - 3. Protect existing utility lines indicated to remain. Notify Architect immediately of any damage to or encounter with an unknown existing utility line. Immediately repair damage to existing utility lines.
- B. Existing Trees and Vegetation: Protect existing trees and other vegetation indicated to remain in place against unnecessary cutting, breaking or skinning of roots, skinning or bruising of bark, smothering of trees by stockpiling construction materials or excavated materials within drip line, excess foot or vehicular traffic, or parking of vehicles within drip line. Provide temporary guards to protect trees and vegetation to be left standing.
 - 1. Water trees and other vegetation to remain within limits of contract work as required to maintain their health during course of construction operations.
 - 2. Provide protection for roots over 1-1/2 inch in diameter that are cut during construction operations. Coat cut faces with an emulsified asphalt or other acceptable coating formulated to use on damaged plant tissues. Temporarily

- cover exposed roots with wet burlap to prevent roots from drying out; cover with earth as soon as possible.
 - 3. Repair or replace trees and vegetation indicated to remain that are damaged by construction operations in a manner acceptable to Architect. Employ a licensed arborist to repair damage to trees and shrubs.
 - 4. Replace trees that cannot be repaired and restored to full-growth status, as determined by arborist.
- C. Traffic: Minimize interference with adjoining roads, streets, walks, and other adjacent occupied or used facilities during site-clearing operations.
 - 1. Do not close or obstruct streets, walks, or other adjacent occupied or used facilities without permission from Owner and authorities having jurisdiction.
 - 2. Provide alternate routes around closed or obstructed traffic ways if required by Owner or authorities having jurisdiction.
- D. Improvements on Adjoining Property: Authority for performing site clearing indicated on property adjoining Owner's property will be obtained by Owner before award of Contract.
 - 1. Contractor shall delineate with construction stakes, the property line along the southeast side of the project.
 - 2. Contractor shall document the pre-construction condition and photograph the existing CMU retaining wall along the southeast property line.
 - 3. Do not proceed with work on adjoining property until directed by Architect.
- E. Salvable Improvements: Carefully remove items indicated to be salvaged and store on Owner's premises per owner's direction.
- F. Utility Locator Service: Notify UNDERGROUND SERVICE ALERT for area where Project is located before site clearing.

PART 2 - PRODUCTS

2.1 MATERIALS

- A. Satisfactory Soil Material: Requirements for satisfactory soil material are specified in Division 31 Section "Earthwork."
 - 1. Obtain approved borrow soil material off-site when satisfactory soil material is not available on-site.
- B. Tree Wound Paint: Bituminous based paint of standard manufacture specially formulated for the intended use.

PART 3 - EXECUTION

3.1 SITE CLEARING

- A. Remove trees, shrubs, grass, and other vegetation, improvements, or obstructions, as required, to permit installation of new construction. Remove similar items elsewhere on site or premises as specifically indicated. Removal includes digging out and off-site disposal of stumps and roots.
 - 1. Cut minor roots and branches of trees indicated to remain in a clean and careful manner where such roots and branches obstruct installation of new construction.
 - 2. Unless specifically designated to remain, strip the upper two inches (minimum) of soil containing vegetation and root growth within the Limits of Work shown on the Drawings.
- B. Removal of Improvements: Remove existing above-grade and below-grade improvements as indicated and as necessary to facilitate new construction.
 - 1. Abandonment or removal of certain underground pipe or conduits may be indicated on mechanical or electrical drawings. Removing abandoned underground piping or conduits interfering with construction is included under this Section.
 - 2. Contractor shall refer to the project's Asbestos Abatement Report for removal of asbestos containing materials and other potential hazardous materials.
- C. Clearing and Grubbing: Clear site of trees, shrubs, and other vegetation, except for those indicated to be left standing.
 - 1. Completely remove stumps, roots, and other debris protruding through ground surface.
 - 2. Use only hand methods for grubbing inside drip line of trees indicated to remain.
 - 3. Fill depressions caused by clearing and grubbing operations with satisfactory soil material, unless further excavation or earthwork is indicated.
 - a. Place fill material in horizontal layers not exceeding 6 inches loose depth, and thoroughly compact each layer and compact in accordance with the requirements specified in Section 31 "Earthwork" to make the new surface conform with the existing adjacent surface of the ground.
 - 4. Trim trees, designated to be left standing within the cleared areas, of dead branches 1-1/2 inches or more in diameter; and trim all branches to heights and in a manner as indicated. Neatly cut limbs and branches to be trimmed close to the bole of the tree or main branches. Paint cuts more than 1-1/4 inches in diameter with specified tree-wound paint.
- D. Topsoil is defined as friable clay loam surface soil found in a depth of not less than 4 inches. Satisfactory topsoil is reasonably free of subsoil, clay lumps, stones, and other objects over 2 inches in diameter, and without weeds, roots, and other objectionable material.
 - 1. Strip topsoil to whatever depths encountered in a manner to prevent intermingling with underlying subsoil or other objectionable material. Remove heavy growths of grass from areas before stripping.
 - a. Where existing trees are indicated to remain, leave existing topsoil in place within drip lines to prevent damage to root system.

2. Stockpile topsoil in storage piles in areas indicated or directed. Construct storage piles to provide free drainage of surface water. Cover storage piles, if required, to prevent wind and sediment erosion.
 3. Dispose of unsuitable or excess topsoil as specified for disposal of waste material.
- E. Protect and maintain benchmarks and survey control points from disturbance during construction.
- F. Locate and clearly identify trees, shrubs, and other vegetation to remain.

3.2 EXISTING UTILITIES

- A. Arrange with Owner for disconnecting and sealing of all overhead and underground utilities that serve adjoining existing structures before site clearing.
1. Verify that utilities have been disconnected and capped before proceeding with site clearing.
- B. Locate, identify, disconnect, and seal or cap utilities indicated to be abandoned in place.
1. Arrange with utility companies to shut off indicated utilities.
 2. Arrange with owner scheduling of utilities shut off.
- C. Locate, identify, and disconnect utilities indicated to be removed.
- D. Interrupting Existing Utilities: Do not interrupt utilities serving facilities occupied by Owner or others unless permitted under the following conditions and then only after arranging to provide temporary utility services according to requirements indicated:
1. Notify Architect not less than two days in advance of proposed utility interruptions.
 2. Do not proceed with utility interruptions without Architect's written permission.
- E. Excavate for and remove underground utilities indicated to be removed.
- F. Contractor shall note that various unknown and undocumented underground utilities exist at the project site. Contractor shall ensure that utilities are inactive or shut off prior to removal or abandonment. Contractor shall document all found underground utilities and notify engineer of record for further direction.

3.3 SITE IMPROVEMENTS

- A. Remove existing above- and below-grade improvements as indicated and necessary to facilitate new construction.
- B. Remove slabs, paving, curbs, gutters, and aggregate base as indicated.

1. Unless existing full-depth joints coincide with line of demolition, neatly saw-cut along line of existing pavement to remain before removing adjacent existing pavement. Saw-cut faces vertically.
2. Paint cut ends of steel reinforcement in concrete to remain with two coats of antirust coating, following coating manufacturer's written instructions. Keep paint off surfaces that will remain exposed.

3.4 DISPOSAL OF SURPLUS AND WASTE MATERIALS

- A. Remove surplus soil material, unsuitable topsoil, obstructions, demolished materials, and waste materials including trash and debris, and legally dispose of them off Owner's property.
- B. Separate recyclable materials produced during site clearing from other nonrecyclable materials. Store or stockpile without intermixing with other materials and transport them to recycling facilities. Do not interfere with other Project work.

END OF SECTION

SECTION 312000

EARTHWORK

PART 1 - GENERAL

1.1 Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

A. Section Includes:

1. Preparing and grading subgrades for slabs-on-grade, walks, pavements and landscaping
2. Excavating and backfilling for buildings and structures.
3. Drainage and moisture-control fill course for concrete slabs-on-grade.
4. Base course for concrete walks, asphalt and pavements.
5. Subsurface drainage backfill for walls and trenches.
6. Excavating and backfilling trenches for utilities and appurtenances outside building lines.

B. Related Sections:

1. Division 01 Section "Temporary Facilities and Controls" for temporary controls, utilities, and support facilities.
2. Division 31 Section "Site Clearing" for site stripping, grubbing, and removal of above- and below-grade improvements and utilities.
3. Division 32 Section "Cast-in-Place Concrete" for granular course beneath the slab-on-grade.

1.3 REFERENCE SPECIFICATION

- A. Perform all work in accordance with applicable provisions of "Standard Specifications for Public Works Construction", 2021 Edition, City of Rosemead Ordinances and Amendments, latest editions, UBC and 2019 CBC. Unless otherwise noted, mention herein of section numbers refers to sections of the Reference Specification. Where Reference Specification refers to "Agency", substitute the word "Owner". Where Reference Specification refers to "Engineer", substitute the word "Architect". Where Reference Specification is in conflict with these Specifications, these Specifications shall govern.
- B. The recommendations found in the Geotechnical Exploration Report prepared by Associated Soils Engineering, Inc. dated June 29, 2022 apply to this Section.

1.4 DEFINITIONS

- A. Backfill: Soil material or controlled low-strength material used to fill an excavation.
 - 1. Initial Backfill: Backfill placed beside and over pipe in a trench, including haunches to support sides of pipe.
 - 2. Final Backfill: Backfill placed over initial backfill to fill a trench.
- B. Base Course: Aggregate layer placed between the subbase course and the surface pavement in paving system.
- C. Bedding Course: Aggregate layer placed over the excavated subgrade in a trench before laying pipe.
- D. Borrow Soil: Satisfactory soil imported from off-site for use as fill or backfill when sufficient approved soil material is not available from excavations
- E. Drainage Fill: Aggregate layer supporting the slab-on-grade that also minimizes upward capillary flow of pore water.
- F. Excavation: Removal of material encountered to subgrade elevations and the re-use or disposal of materials removed.
 - 1. Authorized Additional Excavation: Excavation below subgrade elevations as directed by Architect.
 - 2. Unauthorized Excavation: Excavation below subgrade elevations without direction by Architect. Unauthorized excavation, as well as remedial work directed by Architect, shall be without additional compensation.
- G. Fill: Soil materials used to raise existing grades.
- H. Structures: Buildings, footings, foundations, retaining walls, slabs, tanks, curbs, mechanical and electrical appurtenances, or other man-made stationary features constructed above or below the ground surface.
- I. Subbase Course: Aggregate layer placed between the subgrade and base course for hot-mix asphalt pavement, or aggregate layer placed between the subgrade and a cement concrete pavement or a cement concrete or hot-mix asphalt walk.
- J. Subgrade: Uppermost surface of an excavation or the top surface of a fill or backfill immediately below subbase, drainage fill, drainage course, or topsoil materials.
- K. Utilities: On-site underground pipes, conduits, ducts, and cables, as well as underground services within building lines.
- L. Compaction: Any method of mechanically stabilizing a material by increasing its density at a controlled moisture condition. "Degree of Compaction" is expressed as a percentage of the maximum dry density obtained by the test procedure described in ASTM D 1557 for general soil types abbreviated in this Specification as 90 percent of maximum dry density".

- M. Hard Material: Weathered rock, dense consolidated deposits or conglomerate materials which are not included in the definition of "rock" but which usually require the use of heavy excavation equipment, ripper teeth, or jack hammers for removal
- N. Lift: A layer or course of soil placed on top of previously prepared or placed soil in a fill or embankment.
- O. Unsatisfactory Material: Soil or other material identified as having insufficient strength or stability to carry intended loads without excessive consolidation or loss of stability.

1.5 SUBMITTALS

- A. Product Data: For each type of the following manufactured products required:
 - 1. Warning Tape
 - 2. Geotextile
 - 3. Water Quality Filter Media
- B. Location of Borrow Materials.
- C. Material Test Reports
- D. Pre-excavation Photographs or Videotape: Show existing conditions of adjoining construction and site improvements, including finish surfaces that might be misconstrued as damage caused by earth moving operations. Submit before earth moving begins.

1.6 QUALITY ASSURANCE

- A. Codes and Standards: Perform earthwork complying with requirements of authorities having jurisdiction
- B. Testing and Inspection Service: Owner will employ a qualified independent geotechnical engineering testing agency to classify proposed on-site and borrow soils to verify that soils comply with specified requirements and to perform required field and laboratory testing.
- C. Pre-excavation Conference: Before commencing earthwork, meet with representatives of the governing authorities, Owner, Architect, consultants, Geotechnical Engineer, independent testing agency, and other concerned entities. Review earthwork procedures and responsibilities including testing and inspection procedures and requirements. Notify participants at least 3 working days prior to convening conference. Record discussions and agreements and furnish a copy to each participant.

1.7 PROJECT CONDITIONS

- A. Existing Utilities: Do not interrupt existing utilities serving facilities occupied by the Owner or others except when permitted in writing by the Architect and then only after acceptable temporary utility services have been provided.

1. Provide a minimum 48-hours' notice to the Architect and receive written notice to proceed before interrupting any utility.
- B. Demolish and completely remove from site existing underground utilities indicated to be removed. Coordinate with utility companies and owner to shutoff services if lines are active.
- C. Traffic: Minimize interference with adjoining roads, streets, walks, and other adjacent occupied or used facilities during earth moving operations.
 1. Do not close or obstruct streets, walks, or other adjacent occupied or used facilities without permission from Owner and authorities having jurisdiction.
 2. Provide alternate routes around closed or obstructed traffic ways if required by Owner or authorities having jurisdiction.
- D. Improvements on Adjoining Property: Authority for performing earth moving indicated on property adjoining Owner's property will be obtained by Owner before award of Contract.
 1. Do not proceed with work on adjoining property until directed by Architect.
- E. Utility Locator Service: Notify UNDERGROUND SERVICE ALERT for area where Project is located before beginning earth moving operations.
- F. Do not commence earth moving operations until temporary erosion/sedimentation control measures, specified in Division 01 are in place.
- G. Groundwater was not encountered to the explored depth of 51.5 feet below the ground surface.

PART 2 - PRODUCTS

2.1 SOIL MATERIALS

- A. General: Provide borrow soil materials when sufficient satisfactory soil materials are not available from excavations.
- B. Satisfactory Soils: Soil materials imported or excavated on the property determined to be suitable as referenced in the project Geotechnical Investigation Report; and approved by the Geotechnical Engineer.
- C. Unsatisfactory Soils: Soil Classification Groups GC, SC, CL, ML, OL, CH, MH, OH, and PT according to ASTM D 2487 or a combination of these groups.
 1. Refer to Geotechnical Investigation Report, for unsuitable materials and disposal methods for unsatisfactory soils.
- D. Backfill and Fill Materials: Satisfactory soil materials.
- E. Base Material: Shall conform to crushed aggregate base or crushed miscellaneous base, as specified on plan, in accordance with section 200-2.2 or 200-2.4, respectively,

of the Reference Specification, and compacted to at least 95% of the maximum dry density as determined by ASTM Test Method D 1557.

- F. Engineered Fill: Base Materials and compacted fill materials
- G. Bedding Material: Shall be 1 sack slurry per soils report.
- H. Drainage Fill: Washed, evenly graded mixture of crushed stone, or crushed or uncrushed gravel, ASTM D 448, coarse aggregate grading size 57, with 100 percent passing a 1-1/2-inch sieve and not more than 5 percent passing a No. 8 sieve
- I. Filtering Material: Evenly graded mixture of natural or crushed gravel or crushed stone and natural sand, with 100 percent passing a 1-1/2-inch sieve and 0 to 5 percent passing a No. 50 sieve.
- J. Impervious Fill: Clayey gravel and sand mixture capable of compacting to a dense state.

2.2 GEOTEXTILES

- A. Subsurface Drainage Geotextile: Nonwoven needle-punched geotextile, manufactured for subsurface drainage applications, made from polyolefins or polyesters; with elongation greater than 50 percent; complying with AASHTO M 288 and the following, measured per test methods referenced:
 - 1. Survivability: Class 2; AASHTO M 288.
 - 2. Grab Tensile Strength: 157 lbf (700 N); ASTM D 4632.
 - 3. Sewn Seam Strength: 142 lbf (630 N); ASTM D 4632.
 - 4. Tear Strength: 56 lbf (250 N); ASTM D 4533.
 - 5. Puncture Strength: 56 lbf (250 N); ASTM D 4833.
 - 6. Apparent Opening Size: No. 60 sieve, maximum; ASTM D 4751.
 - 7. Permittivity: 0.2 per second, minimum; ASTM D 4491.
 - 8. UV Stability: 50 percent after 500 hours' exposure; ASTM D 4355.

2.3 ACCESSORIES

- A. Warning Tape: Acid- and alkali-resistant, polyethylene film warning tape manufactured for marking and identifying underground utilities, 6 inches (150 mm) wide and 4 mils (0.1 mm) thick, continuously inscribed with a description of the utility; colored as follows:
 - 1. Red: Electric.
 - 2. Yellow: Gas, oil, steam, and dangerous materials.
 - 3. Orange: Telephone and other communications.
 - 4. Blue: Water systems.
 - 5. Green: Sewer systems.
 - 6. White: Steam systems
- B. Detectable Warning Tape: Acid- and alkali-resistant, polyethylene film warning tape manufactured for marking and identifying underground utilities, a minimum of 6 inches (150 mm) wide and 4 mils (0.1 mm) thick, continuously inscribed with a description of the utility, with metallic core encased in a protective jacket for corrosion protection, detectable by metal detector when tape is buried up to 30 inches (750 mm) deep; colored as follows:

1. Red: Electric.
2. Yellow: Gas, oil, steam, and dangerous materials.
3. Orange: Telephone and other communications.
4. Blue: Water systems.
5. Green: Sewer systems.
6. White: Steam Systems

PART 3 - EXECUTION

3.1 PREPARATION

- A. Protect structures, utilities, sidewalks, pavements, and other facilities from damage caused by settlement, lateral movement, undermining, washout, and other hazards created by earth moving operations.
- B. Provide erosion control measures to prevent erosion or displacement of soils and discharge of soil-bearing water runoff or airborne dust to adjacent properties and walkways.
- C. Tree protection is specified in the Section 31 10 00 "Site Clearing". Refer to landscape architectural plans for instructions.
- D. Prepare subgrade and place base materials in accordance with sections 301-1.2 and 301-2, respectively, of the Reference Specification.

3.2 DEWATERING

- A. Prevent surface water and ground water from entering excavations, from ponding on prepared subgrades, and from flooding Project site and surrounding area.
- B. Dewatering shall be done in accordance with NPDES waste discharge requirements. Contractor shall obtain all necessary Dewatering permits from state and local jurisdictions.
- C. Protect subgrades from softening, undermining, washout, and damage by rain or water accumulation.
 1. Reroute surface water runoff away from excavated areas. Do not allow water to accumulate in excavations. Do not use excavated trenches as temporary drainage ditches.

3.3 EXPLOSIVES

- A. Explosives: Do not use explosives.

3.4 EXCAVATION, GENERAL

- A. General: Excavation shall be to the contours, elevations and dimensions indicated. Keep excavations free from water and debris while construction is in progress. Notify the Owner immediately in writing where it becomes necessary to remove hard, soft, weak, or wet material to a depth greater than indicated. Unless otherwise indicated, concrete placed below grade will be formed and excavations shall allow for placement and removal of forms. Side cuts shall be cribbed and shored as required.
- B. Unclassified Excavation: Excavation is unclassified and includes excavation to required subgrade elevations regardless of the character of surface and subsurface conditions encountered. Unclassified excavated materials may include rock, soil materials, and obstructions as described in the referenced Geotechnical Investigations Report.
 - 1. If excavated materials intended for fill and backfill include unsatisfactory soil materials, replace with satisfactory soil materials.
 - 2. Earth excavation includes excavating pavements and obstructions visible on surface; underground structures, utilities, and other items indicated to be removed; together with soil, boulders, and rocks.
 - 3. Rock fragments greater than 3 inches in diameter shall be taken off-site or placed in accordance with the recommendations of the Geotechnical Engineer in areas designated as suitable for rock disposal.

3.5 STABILITY OF EXCAVATIONS

- A. Comply with local codes, ordinances, and requirements of authorities having jurisdiction to maintain stable excavations.
- B. Unshored Temporary Excavations:
 - 1. Unshored temporary excavations may be sloped back at 1 to 1 (horizontal to vertical) or flatter up to 5 feet in height. Where sloped embankments are used, the tops of the slopes should be barricaded to prevent vehicles and storage loads within seven feet of the tops of the slopes. If the temporary construction slopes will be maintained during the rainy season, construct berms along the tops of the slopes where necessary to prevent run-off water from entering the excavation and eroding the slope faces.

3.6 EXCAVATION FOR STRUCTURES

- A. Excavation Limits: Shall be to a tolerance of plus-or-minus 0.10 foot and shall extend three (3) feet laterally beyond the building limits at the excavation level and three (3) feet below existing grade, or deeper to excavate existing fill. The excavation side slopes shall not exceed a slope ratio of 1.5 to 1, horizontal to vertical, up to 5 feet in height, unless they are positively retained by shoring or other approved methods. Over-excavation side slopes may be vertical, as long as they are no higher than allowed by the State of California Construction Safety Orders, in which case they shall be no steeper than 1.5 to 1. If cut below depths indicated, excavations shall be filled with concrete when the foundations or footings are placed. Revise first subparagraph below if footings and foundations are placed on engineered fill.

1. Excavations for Footings and Foundations: Do not disturb bottom of excavation. Excavate by hand to final grade just before placing concrete reinforcement. Trim bottoms to required lines and grades to leave solid base to receive other work.
2. Excavation for Underground Tanks, Basins, and Mechanical or Electrical Utility Structures: Excavate to elevations and dimensions indicated within a tolerance of plus or minus 0.10 foot. Do not disturb bottom of excavations intended as bearing surfaces.

B. Excavations at Edges of Tree- and Plant-Protection Zones:

1. Excavate by hand to indicated lines, cross sections, elevations, and subgrades. Use narrow-tine spading forks to comb soil and expose roots. Do not break, tear, or chop exposed roots. Do not use mechanical equipment that rips, tears, or pulls roots.

3.7 EXCAVATION FOR WALKS AND PAVEMENTS

- A. Excavate surfaces under walks and pavements to indicated lines, cross sections, elevations, and subgrades.

3.8 EXCAVATION FOR UTILITY TRENCHES

- A. Excavation made with power-driven equipment is not permitted within two feet of any known utility or subsurface construction. For work immediately adjacent to or for excavations exposing a utility or other buried obstruction, use hand or light equipment excavation. Start hand or light equipment excavation on each side of the indicated obstruction and continue until the obstruction is uncovered or until clearance for the new grade is assured. Support uncovered lines and other existing work affected by the excavation work of this Section until approval for backfill is granted by the geotechnical engineer. Immediately report damage to utility lines or subsurface construction to the Owner.
- B. Where unidentified existing utilities are encountered, determine whether these are active or abandoned. Remove interfering portions of abandoned utilities and cap or plug open ends of pipe to remain. The cap or plug must seal the opening in such a manner that would permit remaining portions of the utility to be reactivated. Notify Owner for instructions on utilities which are determined to be active. Do not proceed without instructions, except to correct an immediate hazard or emergency condition. Relocation work performed on an active utility without obtaining prior approval from Owner shall be done at the Contractor's expense and liability.
- C. In areas where compacted backfill has been placed, additional consolidation may occur after completion due to changes in moisture content and surcharge. Utility connections crossing this backfill, and improvements adjoining the building at the backfill line shall be installed taking into account this additional consolidation, or sufficient time shall be scheduled between backfilling operations and such improvements to allow this consolidation to take place. Damage to utilities or other improvements due to

Contractor's negligence in regard to this paragraph shall be repaired at the Contractor's expense

- D. Protect newly backfilled areas and adjacent structures, slopes, or grades from traffic, erosion settlement, and any other damage. Repair and re-establish damaged or eroded grades and slopes and restore surface construction prior to acceptance
- E. Cutting Pavement, Curbs, and Gutters: Saw cut with neat, parallel, straight lines one foot wider than trench width on each side of trenches and one foot beyond each edge of pits. If an existing pavement joint or cracked area is within two feet outside of a designated sawcut line shown on the Drawings, removal and resurfacing shall be to that joint, and/or shall include the crack or cracked area, unless otherwise approved by Architect.
- F. Contractor shall pothole at all identifiable crossings of existing utilities prior to any trenching operations and provide Architect with a survey of the top elevations (and bottom elevations, if applicable), of possible interferences so that an evaluation of necessary adjustments to the current profile or alignment may be made. Additionally, Architect shall be given the opportunity to view possible conflicts in the field prior to providing revised designs.
- G. Provide a minimum cover from grade of 3 feet for water mains and gas mains unless otherwise indicated on plans and details. Storm drains and sewers shall be to the depths indicated. Where settlements greater than the tolerance allowed herein for grading occur in trenches and pits due to improper compaction, excavate to the depth necessary to rectify the problem, then backfill and compact the excavation as specified herein and restore the surface to the required elevation.
- H. Keep excavations free from water while construction is in progress.
- I. Notify the Owner immediately in writing if it becomes necessary to remove rock or hard, unstable, or otherwise unsatisfactory material to a depth greater than indicated. Excavate large rock, boulders, and other unyielding material to depth at least 6 inches below the bottom of the pipe, conduit, duct and appurtenances, unless otherwise indicated or specified. Over-excavate soft, weak, or wet excavations to an depth at least 6 inches below the bottom of the pipe, conduit, duct or appurtenances unless otherwise indicated or specified.
- J. Excavate trenches to indicated slopes, lines, depths, and invert elevations.
- K. Excavate trenches to uniform widths to provide a working clearance on each side of pipe or conduit. Excavate trench walls vertically from trench bottom to 12 inches higher than top of pipe or conduit, except where sloping of sides is allowed. Sides of trenches shall not be sloped from the bottom of the trench up to the elevation of the top of the pipe. See plans for detail.
- L. At the option of the Contractor, the excavations may be overcut to depth of not less than 4 inches and refilled to required grade as specified.
- M. Trench Bottoms: Excavate and shape trench bottoms to provide uniform bearing and support of pipes and conduit. Shape subgrade to provide continuous support for bells, joints, and barrels of pipes and for joints, fittings, and bodies of conduits. Remove stones and sharp objects to avoid point loading.

1. For pipes or conduit less than 6 inches in nominal diameter and flat-bottomed, multiple-duct conduit units, hand-excavate trench bottoms and support pipe and conduit on an undisturbed subgrade.
2. For pipes and conduit 6 inches or larger in nominal diameter, shape bottom of trench to support bottom 90 degrees of pipe circumference. Fill depressions with tamped sand backfill.
3. Dig bell holes and depressions for joints after trench has been graded. Dimension of bell holes shall be as required for properly making the particular type of joint to ensure that the bell does not bear on the bottom of the excavation.

3.9 APPROVAL OF SUBGRADE

- A. Notify Architect when excavations have reached required subgrade.
- B. If and when Architect determines that unsatisfactory soil is present, continue excavation and replace with compacted backfill or fill material as directed.
- C. Roll subgrade below the building slabs and pavements with a pneumatic-tired roller to identify soft pockets and areas of excess yielding. Do not roll wet or saturated subgrades.
 1. Completely roll subgrade in one direction, repeating rolling in direction perpendicular to first direction. Limit vehicle speed to 3 mph (5 km/h).
 2. Excavate soft spots, unsatisfactory soils, and areas of excessive pumping or rutting, as determined by Architect, and replace with compacted backfill or fill as directed.
- D. Unforeseen additional excavation and replacement material will be paid for according to Contract provisions for Changes in Work.
- E. Reconstruct subgrades damaged by freezing temperatures, frost, rain, accumulated water, or construction activities, as directed by Architect, without additional compensation.

3.10 UNAUTHORIZED EXCAVATION

- A. Fill unauthorized excavation under foundations or wall footings by extending indicated bottom elevation of concrete foundation or footing to excavation bottom, without altering top elevation. Lean concrete fill may be used to bring elevations to proper position when acceptable to the Architect.
 1. Fill unauthorized excavations under other construction, pipe, or conduit as directed by Architect.

3.11 STORAGE OF SOIL MATERIALS

- A. Stockpile borrow soil materials and excavated satisfactory soil materials without intermixing. Place, grade, and shape stockpiles to drain surface water. Cover to prevent windblown dust.
 - 1. Stockpile soil materials away from edge of excavations. Do not store within drip line of remaining trees.

3.12 SOIL TREATMENT

- A. All chemical applications used for soil treatment are subject to the approval of the Owner.
- B. Recommended termiticide: Chlorpyrifos "Dursban TC", or "Permetrin Torpedo" or "Dragnet", or approved equal.
- C. Do not apply soil treatment solution until excavating, filling and grading operations are completed and prior to any membrane being placed beginning concrete placement or other construction activities.
- D. To ensure penetration, do not apply soil treatment to excessively wet soils or during inclement weather. Comply with handling and application instruction of soil toxicant manufacturer.
- E. Remove foreign matter which could decrease effectiveness of treatment on areas to be treated. Loosen, rake, and level soil to be treated, except previously compacted areas under foundations.
- F. Apply soil treatment solution at rates recommended by soil toxicant manufacturer.
- G. Allow not less than 12 hours for drying after application, before beginning concrete placement or other construction activities
- H. Reapply soil treatment solution to areas disturbed by subsequent excavation or other construction activities following application.

3.13 BACKFILL

- A. Place and compact backfill in excavations promptly, but not before completing the following:
 - 1. Acceptance of construction below finish grade including, where applicable, subdrainage, damp-proofing, waterproofing, and perimeter insulation.
 - 2. Surveying locations of underground utilities for Record Documents.
 - 3. Testing and inspecting underground utilities.
 - 4. Removing concrete formwork.
 - 5. Removing trash and debris.
 - 6. Removing temporary shoring and bracing, and sheeting.
 - 7. Installing permanent or temporary horizontal bracing on horizontally supported walls.

- B. Place backfill on subgrades free of mud, frost, snow, or ice.

3.14 UTILITY TRENCH BACKFILL AND COMPACTION

- A. Backfilling of exterior utility trenches shall not be undertaken until geotechnical engineer has received 24-hours notice, until required tests and inspections have been completed, and until as-built location notes have been furnished. Remove uninspected backfill in accordance with requirements of this specification. Use hand-operated, plate-type, vibratory, or other suitable hand tampers in areas not accessible to larger rollers or compactors. Avoid damaging pipes and protective pipe coatings.
- B. Place backfill material in accordance with Section 306-1.3.2 of the Reference Specifications and achieve at least 90% of the maximum density. The top 12 inches of backfill in the building or paved areas shall be compacted to 90% of maximum density.
- C. Compaction by ponding or flooding will not be permitted.
- D. Place and compact bedding course on rock and other unyielding bearing surfaces and to fill unauthorized excavations. Shape bedding course to provide continuous support for bells, joints, and barrels of pipes and for joints, fittings, and bodies of conduits.
- E. Concrete backfill trenches that carry below or pass under footings and that are excavated within 18 inches of footings. Place concrete to level of bottom of footings
- F. Provide 4-inch-thick concrete base slab support for piping or conduit less than 2'-6" below surface of roadways. After installation and testing, completely encase piping or conduit in a minimum of 4 inches of concrete before backfilling or placing roadway base.
- G. Place and compact initial backfill of satisfactory soil material or base material, free of particles larger than 1 inch, to a height of 12 inches over the utility pipe or conduit.
 - 1. Carefully compact material under pipe haunches and bring backfill evenly up on both sides and along the full length of utility piping or conduit to avoid damage or displacement of utility system.

3.15 FILL

- A. Preparation: Scarify and remove vegetation, topsoil, debris, wet, and unsatisfactory soil materials, obstructions, and deleterious materials from ground surface prior to placing fills.
 - 1. The scarified ground shall be brought to optimum moisture, mixed as required, and compacted as specified. If the scarified zone is greater than 12 inches in depth, the excess shall be removed and placed in lifts restricted to six inches.
 - 2. Plow, scarify, bench, or break up sloped surfaces steeper than 1 vertical to 4 horizontal so fill material will bond with existing material.
- B. Place and compact fill material in layers to required elevations as follows:
 - 1. Under grass and planted areas, use satisfactory soil material.
 - 2. Under walks and pavements, use satisfactory soil material.

3. Under steps and ramps, use base materials
4. Under building slabs, use base materials
5. Under footings and foundations, use drainage fill materials.

C. Place soil fill on subgrades free of mud, frost, snow, or ice.

3.16 SOIL MOISTURE CONTROL

- A. Uniformly moisten or aerate subgrade and each subsequent fill or backfill soil layer before compaction to within 2 percent of optimum moisture content.
1. Do not place backfill or fill soil material on surfaces that are muddy, frozen, or contain frost or ice.
 2. Remove and replace, or scarify and air dry, otherwise satisfactory soil material that exceeds optimum moisture content by 2 percent and is too wet to compact to specified dry unit weight.
 - a. Stockpile or spread and dry removed wet satisfactory soil material.

3.17 COMPACTION OF SOIL BACKFILLS AND FILLS

- A. Place backfill and fill soil materials in layers not more than 6 inches in loose depth for material compacted by heavy compaction equipment, and not more than 4 inches in loose depth for material compacted by hand-operated tampers.
- B. Place backfill and fill soil materials evenly on all sides of structures to required elevations, and uniformly along the full length of each structure. Keep rollers and other heavy equipment at least 18 inches from footings, foundations, piers and walls of buildings and accessory construction. Use mechanical and hand tampers weighing at least 90 pounds with a maximum face area of 48 inches square to compact backfill within 18 inches of construction and where access is restricted.
- C. Percentage of Maximum Dry Density Requirements: Compact soil materials to not less than the following percentages of maximum dry unit weight according to ASTM D 1557:
1. For general site fills, compact each layer of backfill or fill material at 90 percent maximum dry density.
 2. Under structures, building slabs, and steps, scarify and recompact top 24 inches below footing or slab and each layer of backfill or fill soil material at 95 percent maximum dry density.
 3. Under walkways and paving, scarify and recompact top 12 inches below subgrade and compact each layer of backfill or fill soil material at 95 percent maximum dry density.
 4. Under lawn or unpaved areas, scarify and recompact top 6 inches below subgrade and compact each layer of backfill or fill soil material at 90 percent maximum dry density.

3.18 GRADING

- A. General: Uniformly grade areas to a smooth surface, free of irregular surface changes. Comply with compaction requirements and grade to cross sections, lines, and elevations indicated.
 - 1. Provide a smooth transition between adjacent existing grades and new grades.
 - 2. Cut out soft spots, fill low spots, and trim high spots to comply with required surface tolerances.
 - 3. If necessary, the Contractor's selected equipment and construction procedure shall be altered, changed or modified in order to meet the specified compaction requirements. Flooding and water jetting is prohibited.
- B. Site Rough Grading: Slope grades to direct water away from buildings and to prevent ponding. Finish subgrades to required elevations within the following tolerances:
 - 1. Lawn or Unpaved Areas: ± 0.10 foot, unless otherwise indicated.
 - 2. Concrete Walks: ± 0.025 foot.
 - 3. Pavements:
 - a. Concrete: 0.025 foot minus, with no high spots.
 - b. Asphalt: 0.05 foot minus, with no high spots.
- C. Grading inside Building Lines: Finish subgrade to a tolerance of $\frac{1}{2}$ inch when tested with a 10-foot straightedge.

3.19 SUBSURFACE DRAINAGE

- A. Subdrainage Pipe: Specified in Division 33 Section "Storm Drainage."
- B. Subsurface Drain: Place subsurface drainage geotextile around perimeter of subdrainage trench. Place a 6-inch course of filter material on subsurface drainage geotextile to support subdrainage pipe. Encase subdrainage pipe in a minimum of **12 inches x 12 inches** of filter material, placed in compacted layers 6 inches thick, and wrap in subsurface drainage geotextile, overlapping sides and ends at least 6 inches.
 - 1. Compact each filter material layer to 90 percent of maximum dry unit weight
- C. Drainage Backfill: Place and compact filter material over subsurface drain, in width indicated, to within 12 inches of final subgrade, in compacted layers 6 inches thick. Overlay drainage backfill with one layer of subsurface drainage geotextile, overlapping sides and ends at least 6 inches.
 - 1. Compact each filter material layer to 90 percent of maximum dry unit weight
 - 2. Place and compact impervious fill over drainage backfill in 6-inch thick compacted layers to final subgrade.

3.20 BASE COURSES UNDER PAVEMENTS AND WALKS

- A. Place base course on subgrades free of mud, frost, snow, or ice.
- B. On prepared subgrade, place base course under pavements and walks as follows:

1. Compact base courses at optimum moisture content to required grades, lines, cross sections and thickness to not less than 95 percent of ASTM D 4254 relative density.
2. Shape base to required crown elevations and cross-slope grades.
3. When thickness of compacted base course is 6 inches or less, place materials in a single layer.
4. When thickness of compacted base course exceeds 6 inches, place materials in equal layers, with no layer more than 6 inches thick or less than 3 inches thick when compacted.

3.21 PAVEMENT REPAIR

- A. Repair or patch asphalt pavement as specified in Section 32 12 16 Asphalt Paving. Repair or patch concrete pavement, curbs and gutters as specified in Section 32 1313 Concrete Paving. Do not repair pavement until trench has been backfilled and compacted as herein specified. As a minimum, maintain one-way traffic on roads and streets crossed by trenches.

3.22 FIELD QUALITY CONTROL

- A. Testing Agency Services: Allow testing agency to inspect and test each subgrade and each fill or backfill layer. Do not proceed until test results for previously completed work verify compliance with requirements.
 1. Perform field in-place density tests according to ASTM D 1556 (sand cone method), ASTM D 2167 (rubber balloon method), or ASTM D 2937 (drive cylinder method), as applicable.
 - a. Field in-place density tests may also be performed by the nuclear method according to ASTM D 2922, provided that calibration curves are periodically checked and adjusted to correlate to tests performed using ASTM D 1556. With each density calibration check, check the calibration curves furnished with the moisture gages according to ASTM D 3017
 - b. When field in-place density tests are performed using nuclear methods, make calibration checks of both density and moisture gages at beginning of work, on each different type of material encountered, and at intervals as directed by the Architect.
- B. Footing Subgrade: At footing subgrades, at least one test of each soil stratum will be performed to verify design bearing capacities. Subsequent verification and approval of other footing subgrades may be based on a visual comparison of subgrade with tested subgrade when approved by Architect.
- C. Paved and Building Slab Areas: At subgrade and at each compacted fill and backfill layer, perform at least one field in-place density test for every 2,000 sq. ft. or less of paved area or building slab, but in no case fewer than three tests.
- D. Foundation Wall Backfill: In each compacted backfill layer, perform at least one field in-place density test for each 100 feet or less of wall length, but no fewer than two tests along a wall face.

- E. Trench Backfill: In each compacted initial and final backfill layer, perform at least one field in-place density test for each 150 feet or less of trench, but no fewer than two tests.
- F. When testing agency reports that subgrades, fills, or backfills have not achieved degree of compaction specified, scarify and moisten or aerate, or remove and replace soil materials to depth required; recompact and retest until specified compaction is obtained.

3.23 PROTECTION

- A. Protecting Graded Areas: Protect newly graded areas from traffic, freezing, and erosion. Keep free of trash and debris.
- B. Repair and reestablish grades to specified tolerances where completed or partially completed surfaces become eroded, rutted, settled, or where they lose compaction due to subsequent construction operations or weather conditions.
 - 1. Scarify or remove and replace soil material to depth as directed by Architect; reshape and recompact at optimum moisture content to the required density.
- C. Where settling occurs before Project correction period elapses, remove finished surfacing, backfill with additional soil material, compact, and reconstruct surfacing.
 - 1. Restore appearance, quality, and condition of finished surfacing to match adjacent work, and eliminate evidence of restoration to greatest extent possible.

3.24 DISPOSAL OF SURPLUS AND WASTE MATERIALS

- A. Remove surplus satisfactory soil and waste materials, including unsatisfactory soil, trash, and debris, and legally dispose of them off Owner's property.
- B. Transport surplus satisfactory soil to designated storage areas on Owner's property. Stockpile or spread soil as directed by Architect.
 - 1. Remove waste materials, including unsatisfactory soil, trash, and debris, and legally dispose of them off Owner's property.

END OF SECTION

SECTION 312219

FINISH GRADING

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. This section includes the following:
 - 1. Weeding.
 - 2. Finish grading of lawn and planting areas.
- B. Related Sections include the following:
 - 1. 312000: Earthwork

1.3 DEFINITIONS

- A. Finish grading: finish grading shall consist of adjusting and finishing soil surfaces with site or imported topsoil, raking grades to a smooth, even, uniform plane. Remove and legally dispose of all extraneous matter off site. Facilitate natural run-off water and establish grades and drainage indicated as part of the contract work.

PART 2 – PRODUCTS

2.1 MATERIALS

- A. Obtain imported topsoil from approved local sources.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Verification of conditions: Prior to commencing the finish grading, review the installed work of other trades and verify that their work is complete.
 - 1. Rough Grading: Grading in planting areas (except raised planter areas) shall be established to within plus or minus 0.10 foot prior to beginning of finish grading.
- B. Import topsoil only when necessary to supplement site soil to achieve grades shown on drawings, or if site soil is unsuitable for planting.

3.2 PREPARATION

- A. Weeding: Before finish grading, weeds and grasses shall be dug out by the root or sprayed with an herbicide and disposed of off-site. This procedure is outlined under the Landscape Planting Section.

- B. Debris: Remove stones and debris 1 inch in diameter and greater and clumps of earth that do not break up. Dispose of off-site.

3.3 INSTALLATION

- A. General: When rough grading and weeding have been completed, and the soil has dried sufficiently to be readily worked, lawn and planting areas shall be graded to the elevations indicated on the Drawings.
 - 1. Grades indicated on Drawing are grades that will result after thorough settlement and compaction of the soil.
 - 2. Grades not otherwise indicated shall be uniform finish grades and, if required, shall be made at the direction of the Architect.
 - 3. Finish grades shall be smooth, even, and a uniform plane with no abrupt change of surfaces.
 - 4. Soil areas adjacent to buildings shall slope away from the building to allow a natural run-off of water, and surface drainage shall be directed as indicated on the drawings by remodeling surfaces to facilitate the run off water at 2% minimum grade.
 - 5. Low spots and pockets shall be graded to drain properly.
- B. Drainage: Finish grade with proper slope to drains.
 - 1. Flow lines, designated or not, shall be graded and maintained to allow free flow of surface water.
 - 2. If any drainage problems arise during construction period due to Contractor's work (such as, but not limited to, low spots, slides, gullies and general erosion), the Contractor shall be responsible for repairing these areas to a condition equal to their original condition, and in so doing shall prevent further drainage problems from occurring.
- C. Toe of slope: To prevent soil creep or erosion across pavement, where pavement (walk, curb, etc.) is at the toe of a slope, finish grade is to level out or swale slightly at least 6" before reaching pavement.
- D. Moisture Content: The soil shall not be worked when the moisture content is so great that excessive compaction occurs, nor when it is so dry that dust may form in the air or that clods do not break readily. Water may be applied, if necessary, to provide moisture content for tilling and planting operations. It is the Contractor's responsibility to control dust that is spread as a result of grading operations.
- E. Grades: The finish grade in areas to be planted with turf shall be 2 inches below grade of adjacent pavement and walks unless shown otherwise on landscaping plans and details.
- F. Compaction: Soils in planted areas shall be loose and friable, yet firm enough that no settling occurs from normal foot traffic or irrigation.

3.4 FIELD OBSERVATION

- A. It is the Contractor's responsibility to contact the Architect 48 hours or two working days in advance of each agreed observation or conference.
- B. Schedule for On-Site Reviews: at completion of finish grading and prior to any planting operations.

END OF SECTION

SECTION 321216

ASPHALT PAVING

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. This Section includes the following:
 - 1. Hot-mix asphalt paving.
 - 2. Hot-mix asphalt patching.
 - 3. Hot-mix asphalt overlays.
 - 4. Asphalt surface treatments:
 - a. Fog seals.
 - b. Slurries.
 - 5. Pavement-marking paint.
- B. Related Sections include the following:
 - 1. Section 312000 "Earthwork" for aggregate subbase and base courses and aggregate pavement shoulders.
 - 2. Section 321313 "Concrete Paving" for pavement marking on portland cement concrete pavement and herbicide treatment under portland cement concrete paving.

1.3 SYSTEM DESCRIPTION

- A. Provide hot-mix asphalt pavement according to the materials, workmanship, and other applicable requirements of the standard specifications of the state or of authorities having jurisdiction.
 - 1. Reference Specification: Perform all work in accordance with applicable provisions of "Standard Specifications for Public Works Construction", 2021 Edition. Unless otherwise noted, mention herein of section numbers refers to sections of the Reference Specification. Where Reference Specification refers to "Agency", substitute the word "Owner". Where Reference Specification refers to "Engineer", substitute the word "Architect". Where Reference Specification is in conflict with these Specifications, these Specifications shall govern.
 - 2. Measurement and payment provisions and safety program submittals included in Reference Specifications do not apply to this Section.

1.4 SUBMITTALS

- A. Product Data: For each product specified. Include technical data and tested physical and performance properties.

- B. Job-Mix Designs: Certification, by authorities having jurisdiction, of approval of each job mix proposed for the Work.
- C. Job-Mix Designs: For each job mix proposed for the work.
- D. Shop Drawings: Indicate pavement markings, lane separations, and defined parking spaces. Indicate dedicated handicapped spaces with international graphics symbol.
- E. Samples: 12 by 12 inches (300 by 300 mm) minimum, of paving fabric.
- F. Qualification Data: For firms and persons specified in the "Quality Assurance" Article to demonstrate their capabilities and experience. Include lists of completed projects with project names and addresses, names and addresses of architects and owners, and other information specified.
- G. Material Test Reports: Indicate and interpret test results for compliance of materials with requirements indicated.
- H. Material Certificates: Certificates signed by manufacturers certifying that each material complies with requirements.

1.5 QUALITY ASSURANCE

- A. Installer Qualifications: Engage an experienced installer who has completed hot-mix asphalt paving similar in material, design, and extent to that indicated for this Project and with a record of successful in-service performance.
- B. Manufacturer Qualifications: Engage a firm experienced in manufacturing hot-mix asphalt similar to that indicated for this Project and with a record of successful in-service performance.
 - 1. Firm shall be a registered and approved paving mix manufacturer with authorities having jurisdiction or with the DOT of the state in which Project is located.
- C. Testing Agency Qualifications: Demonstrate to Architect's satisfaction, based on Architect's evaluation of criteria conforming to ASTM D 3666, that the independent testing agency has the experience and capability to satisfactorily conduct the testing indicated without delaying the Work.
- D. Regulatory Requirements: Conform to applicable standards of authorities having jurisdiction for asphalt paving work on public property.
- E. Asphalt-Paving Publication: Comply with AI's "The Asphalt Handbook," except where more stringent requirements are indicated.
- F. Preinstallation Conference: Review methods and procedures related to asphalt paving including, but not limited to, the following:
 - 1. Review proposed sources of paving materials, including capabilities and location of plant that will manufacture hot-mix asphalt.
 - 2. Review condition of substrate and preparatory work performed by other trades.
 - 3. Review requirements for protecting paving work, including restriction of traffic during installation period and for remainder of construction period.

4. Review and finalize construction schedule for paving and related work. Verify availability of materials, paving Installer's personnel, and equipment required to execute the Work without delays.
5. Review inspection and testing requirements, governing regulations, and proposed installation procedures.
6. Review forecasted weather conditions and procedures for coping with unfavorable conditions.

1.6 DELIVERY, STORAGE, AND HANDLING

- A. Deliver pavement-marking materials to Project site in original packages with seals unbroken and bearing manufacturer's labels containing brand name and type of material, date of manufacture, and directions for storage.
- B. Store pavement-marking materials in a clean, dry, protected location and within temperature range required by manufacturer. Protect stored materials from direct sunlight.

1.7 PROJECT CONDITIONS

- A. Environmental Limitations: Do not apply asphalt materials if substrate is wet or excessively damp or if the following conditions are not met:
 1. Prime and Tack Coats: Minimum surface temperature of 60 deg F (15.5 deg C).
 2. Slurry Coat: Comply with weather limitations of ASTM D 3910.
 3. Asphalt Base Course: Minimum surface temperature of 40 deg F (4 deg C) and rising at time of placement.
 4. Asphalt Surface Course: Minimum surface temperature of 60 deg F (15.5 deg C) at time of placement.
- B. Pavement-Marking Paint: Proceed with pavement marking only on clean, dry surfaces and at a minimum ambient or surface temperature of 40 deg F (4 deg C) for oil-based materials, 50 deg F (10 deg C) for water-based materials, and not exceeding 95 deg F (35 deg C).

PART 2 - PRODUCTS

2.1 AGGREGATES

- A. General: Use materials and gradations that have performed satisfactorily in previous installations.
- B. Coarse Aggregate: Sound; angular crushed stone; crushed gravel; or properly cured, crushed blast-furnace slag; complying with ASTM D 692.
- C. Fine Aggregate: Sharp-edged natural sand or sand prepared from stone; gravel, properly cured blast-furnace slag, or combinations thereof; complying with ASTM D 1073.
 1. For hot-mix asphalt, limit natural sand to a maximum of 20 percent by weight of the total aggregate mass.

- D. Mineral Filler: Rock or slag dust, hydraulic cement, or other inert material complying with ASTM D 242.

2.2 ASPHALT PAVEMENT MATERIALS

- A. Asphalt Pavement Leveling Course: Conform to Viscosity Grade B-PG 64-10 in section 203-1.2 and section 203-6 of the Reference Specification.
- B. Asphalt Pavement Wearing (Surface) Course: Conform to Viscosity Grade III C2-PG 64-10, C3-PG 64-10 in section 203-1.2 and section 203-6 and section 400-4 to be used with Class III asphalt of the Reference Specification.
- C. Prime Coat: Grade SC-70 liquid asphalt conforming to section 203-2 of the Reference Specification.
- D. Tack Coat: Emulsified asphalt grade SS-1h conforming to section 203-3 of the Reference Specification.
- E. Asphalt Paint: Conform to ASTM D41 or D43 per section 203-8 of the Reference Specification.
- F. Slurry Seal: Emulsified asphalt grade [SS-1h] [CSS-1h] and aggregate conforming to section 203.5 of the Reference Specification.
- G. Asphalt Cement: ASTM D 3381 for viscosity-graded material; ASTM D 946 for penetration-graded material.
- H. Asphalt Cement: ASTM D 3381 for viscosity-graded material.
- I. Undersealing Asphalt: ASTM D 3141, pumping consistency.
- J. Prime Coat: ASTM D 2027; medium-curing cutback asphalt; MC-30, MC-70, or MC-250.
- K. Prime Coat: Asphalt emulsion prime conforming to state DOT requirements.
- L. Prime Coat: ASTM D 977, emulsified asphalt or ASTM D 2397, cationic emulsified asphalt, slow setting, factory diluted in water, of suitable grade and consistency for application.
- M. Tack Coat: ASTM D 977, emulsified asphalt or ASTM D 2397, cationic emulsified asphalt, slow setting, factory diluted in water, of suitable grade and consistency for application.
- N. Fog Seal: ASTM D 977, emulsified asphalt or ASTM D 2397, cationic emulsified asphalt, slow setting, factory diluted in water, of suitable grade and consistency for application.
- O. Water: Potable.

2.3 AUXILIARY MATERIALS

- A. Herbicide: Commercial chemical for weed control, registered by Environmental Protection Agency (EPA). Provide granular, liquid, or wettable powder form.

- B. Sand: ASTM D 1073, Grade Nos. 2 or 3.
- C. Paving Geotextile: Nonwoven polypropylene, specifically designed for paving applications, resistant to chemical attack, rot, and mildew.
- D. Pavement-Marking Paint: Alkyd-resin type, ready-mixed, complying with FS TT-P-115, Type I, or AASHTO M-248, Type N.
- E. Pavement-Marking Paint: Latex, water-base emulsion, ready-mixed, complying with FS TT-P-1952.
 - 1. Color: As indicated.
 - 2. Color: White (for parking stalls, other than handicapped).
 - 2. Color: Yellow (for parking stalls, other than handicapped).
 - 3. Color: Blue (for pavement markings identifying handicap parking)
 - 4. Color: Red (for "No Parking" areas as shown)
- F. Glass Beads: AASHTO M-247.

2.4 MIXES

- A. Hot-Mix Asphalt: Provide dense, hot-laid, hot-mix asphalt plant mixes approved by authorities having jurisdiction; designed according to procedures in AI's "Mix Design Methods for Asphalt Concrete and Other Hot-Mix Types"; and complying with the following requirements:
 - 1. Provide mixes with a history of satisfactory performance in geographical area where Project is located.
 - 2. Base Course: As indicated.
 - 3. Surface Course: As indicated.
- B. Hot-Mix Asphalt: Provide dense, hot-laid, hot-mix asphalt plant mixes approved by authorities having jurisdiction and designed according to procedures in AI's "Mix Design Methods for Asphalt Concrete and Other Hot-Mix Types."
 - 1. Provide mixes with a history of satisfactory performance in geographical area where Project is located.
 - 2. Provide mixes complying with the composition, grading, and tolerance requirements of ASTM D 3515 for the following nominal, maximum aggregate sizes:
 - a. Base Course: 1 inch (25 mm).
 - b. Surface Course: 1/2 inch (13 mm).
- C. Emulsified-Asphalt Slurry: ASTM D 3910, consisting of emulsified asphalt, fine aggregates, and mineral fillers and as follows:
 - 1. Composition: Type 1.
 - 2. Composition: Type 2.
 - 3. Composition: Type 3.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Verify that subgrade is dry and in suitable condition to support paving and imposed loads.

- B. Subgrade, Subbase, and Base:
 - 1. Proof-roll prepared subgrade and base using heavy, pneumatic-tired rollers to locate areas that are unstable or that require further compaction.
- C. Notify Architect in writing of any unsatisfactory conditions. Do not begin paving installation until these conditions have been satisfactorily corrected.

3.2 COLD MILLING

- A. Clean existing paving surface of loose and deleterious material immediately before cold milling. Remove existing asphalt pavement, including hot-mix asphalt and, as necessary, unbound-aggregate base course, by cold milling to grades and cross sections indicated.
 - 1. Repair or replace curbs, manholes, and other construction damaged during cold milling.
- B. Cold mill existing asphalt concrete pavement in accordance with section 302-5.2 of the Reference Specification.

3.3 PATCHING AND REPAIRS

- A. Patching: Saw cut perimeter of patch and excavate existing pavement section to sound base. Recompact new subgrade. Excavate rectangular or trapezoidal patches, extending 12 inches (300 mm) into adjacent sound pavement, unless otherwise indicated. Cut excavation faces vertically.
 - 1. Tack coat faces of excavation and allow to cure before paving.
 - 2. Fill excavation with dense-graded, hot-mix asphalt base mix and, while still hot, compact flush with adjacent surface.
 - 3. Partially fill excavation with dense-graded, hot-mix asphalt base mix and compact while still hot. Cover asphalt base course with compacted, hot-mix surface layer finished flush with adjacent surfaces.
- B. Portland Cement Concrete Pavement: Break cracked slabs and roll as required to reseat concrete pieces firmly.
 - 1. Pump hot undersealing asphalt under rocking slabs until slab is stabilized or, if necessary, crack slab into pieces and roll to reseat pieces firmly.
 - 2. Remove disintegrated or badly broken pavement. Prepare and patch with hot-mix asphalt.
- C. Leveling Course: Install and compact leveling course consisting of dense-graded, hot-mix asphalt surface course to level sags and fill depressions deeper than 1 inch (25 mm) in existing pavements.
 - 1. Install leveling wedges in compacted lifts not exceeding 3 inches (75 mm) thick.
- D. Crack and Joint Filling: Remove existing filler material from cracks or joints to a depth of 1/4 inch (6 mm). Refill with asphalt joint-filling material to restore watertight condition. Remove excess filler that has accumulated near cracks or joints.
- E. Asphalt paint: Apply uniformly to existing surfaces of previously constructed asphalt or Portland cement concrete paving and to surfaces abutting or projecting into new, hot-mix asphalt pavement. Apply at a uniform rate of 0.05 to 0.15 gal./sq. yd. (0.2 to 0.7 L/sq. m) of surface.
 - 1. Allow asphalt paint to cure undisturbed before paving.

2. Avoid smearing or staining adjoining surfaces, appurtenances, and surroundings. Remove spillages and clean affected surfaces.

3.4 SURFACE PREPARATION

- A. General: Immediately before placing asphalt materials, remove loose and deleterious material from substrate surfaces. Ensure that prepared subgrade is ready to receive paving.
 1. Sweep loose granular particles from surface of unbound-aggregate base course. Do not dislodge or disturb aggregate embedded in compacted surface of base course.
- B. Herbicide Treatment: Apply herbicide according to manufacturer's recommended rates and written application instructions. Apply to dry, prepared subgrade or surface of compacted-aggregate base before applying paving materials.
 1. Mix herbicide with prime coat when formulated by manufacturer for that purpose.
- C. Prime Coat: Apply uniformly over surface of compacted-aggregate base at a rate of 0.15 to 0.50 gal./sq. yd. (0.7 to 2.3 L/sq. m). Apply enough material to penetrate and seal, but not flood, surface. Allow prime coat to cure for 72 hours minimum.
 1. If prime coat is not entirely absorbed within 24 hours after application, spread sand over surface to blot excess asphalt. Use just enough sand to prevent pickup under traffic. Remove loose sand by sweeping before pavement is placed and after volatiles have evaporated.
 2. Protect primed substrate from damage until ready to receive paving.
- D. Prime Coat: Comply with section 302-5.3 of the Reference Specification. Apply primer at a rate of between 0.20 and 0.25 gallons per square yard to top surface of base course prior to asphalt placement.
- E. Tack Coat: If a leveling course has been used for construction traffic, apply tack coat to all leveling course surfaces in accordance with section 302-5.4 of the Reference Specification at a rate of 0.10 gallons per square yard.

3.5 HOT-MIX ASPHALT PLACING

- A. Machine place hot-mix asphalt mix on prepared surface, spread uniformly, and strike off. Place asphalt mix by hand to areas inaccessible to equipment in a manner that prevents segregation of mix. Place each course to required grade, cross section, and thickness, when compacted.
 1. Place hot-mix asphalt base course in number of lifts and thicknesses indicated.
 2. Place hot-mix asphalt surface course in single lift.
 3. Spread mix at minimum temperature of 250 deg F (121 deg C).
 4. Begin applying mix along centerline of crown for crowned sections and on high side of one-way slopes, unless otherwise indicated.
 5. Regulate paver machine speed to obtain smooth, continuous surface free of pulls and tears in asphalt-paving mat.
- B. Place paving in consecutive strips not less than 10 feet (3 m) wide, except where infill edge strips of a lesser width are required.

1. After first strip has been placed and rolled, place succeeding strips and extend rolling to overlap previous strips. Complete asphalt base course for a section before placing asphalt surface course.
- C. Promptly correct surface irregularities in paving course behind paver. Use suitable hand tools to remove excess material forming high spots. Fill depressions with hot-mix asphalt to prevent segregation of mix; use suitable hand tools to smooth surface.
- D. The asphalt pavement shall be completed in phases; the leveling course during construction for temporary construction traffic and storage of materials and; the wearing (surface) course just prior to turnover to Owner; unless the entire paving operation is completed just prior to turnover to the Owner such that no construction traffic or storage of materials shall be allowed on the finished pavement surface after its completion. Contractor shall schedule final surface course paving operations so that the required waiting period specified in the Division 2 Section "Pavement Marking" will allow project completion within the specified time.
- E. Construct asphalt pavement in accordance with section 302-5 of the Reference Specification and as shown on the Drawings.
- F. Two Layer Method: The leveling course shall be installed to elevations which will allow the future placement of a wearing (surface) course no thinner than 1-1/2 inches. Prior to placing the wearing (surface) course, repair all areas damaged during construction use, thoroughly clean the leveling course of all loose material and place a tack coat pursuant to paragraph 3.4 D. herein.

3.6 JOINTS

- A. Construct joints to ensure continuous bond between adjoining paving sections. Construct joints free of depressions with same texture and smoothness as other sections of hot-mix asphalt course.
 1. Clean contact surfaces and apply tack coat.
 2. Offset longitudinal joints in successive courses a minimum of 6 inches (150 mm).
 3. Offset transverse joints in successive courses a minimum of 24 inches (600 mm).
 4. Construct transverse joints by bulkhead method or sawed vertical face method as described in AI's "The Asphalt Handbook."
 5. Compact joints as soon as hot-mix asphalt will bear roller weight without excessive displacement.
 6. Compact asphalt at joints to a density within 2 percent of specified course density.

3.7 COMPACTION

- A. General: Begin compaction as soon as placed hot-mix paving will bear roller weight without excessive displacement. Compact hot-mix paving with hot, hand tampers or vibratory-plate compactors in areas inaccessible to rollers.
 1. Complete compaction before mix temperature cools to 185 deg F (85 deg C).
- B. Breakdown Rolling: Accomplish breakdown or initial rolling immediately after rolling joints and outside edge. Examine surface immediately after breakdown rolling for indicated crown, grade, and smoothness. Repair surfaces by loosening displaced material, filling with hot-mix asphalt, and rerolling to required elevations.

- C. Intermediate Rolling: Begin intermediate rolling immediately after breakdown rolling, while hot-mix asphalt is still hot enough to achieve specified density. Continue rolling until hot-mix asphalt course has been uniformly compacted to at least 95 percent of the Hveem density (ASTM D 2726-05a).
- D. Finish Rolling: Finish roll paved surfaces to remove roller marks while hot-mix asphalt is still warm.
- E. Edge Shaping: While surface is being compacted and finished, trim edges of pavement to proper alignment. Bevel edges while still hot, with back of rake or smooth iron. Compact thoroughly using tamper or other satisfactory method.
- F. Repairs: Remove paved areas that are defective or contaminated with foreign materials. Remove paving course over area affected and replace with fresh, hot-mix asphalt, with a thickness one inch greater than the existing, and to match existing finish surface grades such that no local ponding of water will result. Compact by rolling to specified density and surface smoothness.
- G. Protection: After final rolling, do not permit vehicular traffic on pavement until it has cooled and hardened.
- H. Erect barricades to protect paving from traffic until mixture has cooled enough not to become marked.

3.8 INSTALLATION TOLERANCES

- A. Thickness: Compact each course to produce the thickness indicated within the following tolerances:
 - 1. Leveling Course: $\pm 1/2$ inch (13 mm).
 - 2. Surface Course: Plus $1/4$ inch (6 mm), no minus.
- B. Surface Smoothness: Compact each course to produce a surface smoothness within the following tolerances as determined by using a 10-foot (3-m) straightedge applied transversely or longitudinally to paved areas:
 - 1. Leveling Course: $1/4$ inch (6 mm).
 - 2. Surface Course: $1/8$ inch (3 mm).
 - 3. Crowned Surfaces: Test with crowned template centered and at right angle to crown. Maximum allowable variance from template is $1/4$ inch (6 mm).

3.9 SURFACE TREATMENTS

- A. Fog Seals: Apply fog seal at a rate of 0.10 to 0.15 gal./sq. yd. (0.45 to 0.70 L/sq. m) to existing asphalt pavement and allow to cure. Lightly dust areas receiving excess fog seal with a fine sand.
- B. Slurry Seals: Apply slurry coat in a uniform thickness according to ASTM D 3910 and allow to cure.
 - 1. Roll slurry seal to smooth ridges and provide a uniform, smooth surface.
 - 2. Slurry seal to be applied min. 30 days after completion of asphalt pavement.
- C. Slurry seals: Apply in accordance with section 302-4 of the Reference Specification.

3.10 PAVEMENT MARKING

- A. Do not apply pavement-marking paint until layout, colors, and placement have been verified with Architect.
- B. Allow paving to cure for 30 days before starting pavement marking.
- C. Sweep and clean surface to eliminate loose material and dust.
- D. Apply paint with mechanical equipment to produce pavement markings of dimensions indicated with uniform, straight edges. Apply at manufacturer's recommended rates to provide a minimum wet film thickness of 15 mils (0.4 mm).
 - 1. Broadcast glass spheres uniformly into wet pavement markings at a rate of 6 lb/gal. (0.72 kg/L).
- E. Comply with paint manufacturer's maximum drying time requirements to prevent undue softening of bitumen and pick-up, displacement, or discoloration of pavement marking by vehicular traffic.
- F. Paint pavement, curbs and other surfaces, as shown on the Drawings. Painting shall be straight, uniform, exact and sharp without blobs at the start and finish. Edges shall be even, accurate, symmetrical and free of fuzziness.
- G. Apply markings for disabled access symbols in accordance with State of California Building Code, Part 2, Title 24, CCR.
- H. Where work consists of modifications of, or additions to existing parking striping, match existing color and width of lines as closely as possible.

3.11 FIELD QUALITY CONTROL

- A. Testing Agency: Owner will engage a qualified independent testing agency to perform field inspections and tests and to prepare test reports.
 - 1. Testing agency will conduct and interpret tests and state in each report whether tested Work complies with or deviates from specified requirements.
- B. Additional testing, at Contractor's expense, will be performed to determine compliance of corrected Work with specified requirements.
- C. Thickness: In-place compacted thickness of hot-mix asphalt courses will be determined according to ASTM D 3549.
- D. Surface Smoothness: Finished surface of each hot-mix asphalt course will be tested for compliance with smoothness tolerances.
- E. Perform flood tests on asphalt paved areas to determine if surface grades allow proper runoff of surface water and if drainage devices function properly. Such tests shall be conducted in the presence of the Architect and the Owner. Promptly correct paving work found to be defective due to ponding of water or improper drainage.
- F. In-Place Density tests will be performed using nuclear gauge (ASTM D 2950-05) to verify at least 95 percent relative compaction of the Hveem density has been achieved. Representative samples of the AC will be collected and tested in the laboratory for Hveem density (ASTM D 2726-05a), theoretical maximum density

(ASTM D 2041-03a), stability (ASTM D 1560-05), gradation (ASTM C 136-05), and asphalt content (ASTM D 6307-05).

- G. Remove and replace or install additional hot-mix asphalt where test results or measurements indicate that it does not comply with specified requirements.

END OF SECTION

SECTION 321313

CONCRETE PAVING

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. This Section includes exterior Portland cement concrete paving for the following:
 - 1. Curbs and gutters.
 - 2. Walkways.
 - 3. Driveways
 - 3. Concrete pavement.
 - 4. Concrete wheel stops
- B. Related Sections: The following Sections contain requirements that relate to this Section:
 - 1. Section 312000: Earthwork for subgrade preparation, grading and base course.
 - 2. Section 321313: Concrete paving for general building applications of concrete.

1.3 SYSTEM DESCRIPTION

- A. Provide concrete pavement according to the materials, workmanship, and other applicable requirements of the following standard specifications:
 - 1. Reference Specification: Perform all work in accordance with applicable provisions of "Standard Specifications for Public Works Construction", 2021. Unless otherwise noted, mention herein of section numbers refers to sections of the Reference Specification. Where Reference Specification refers to "Agency", substitute the word "Owner". Where Reference Specification refers to "Engineer", substitute the word "Architect". Where Reference Specification is in conflict with these Specifications, these Specifications shall govern.
 - 2. Measurement and payment provisions and safety program submittals included in Reference Specifications do not apply to this Section.

1.4 SUBMITTALS

- A. General: Submit the following according to the Conditions of the Contract and Division 1 Specification Sections.
- B. Design mixes for each class of concrete. Include revised mix proportions when characteristics of materials, project conditions, weather, test results, or other circumstances warrant adjustments.
- C. Description of Methods and Sequence of Placement. For each type of specially-finished concrete provide description of methods and sequence of placement.

- D. Submit manufacturer's product data for the following:
 - 1. Form release agent.
 - 2. Concrete coloring additive.
 - 3. Prefabricated control joint.
 - 4. Preformed joint filler.
 - 5. Sealants.
 - 6. Slip plane joint.
 - 7. Concrete mix design.

1.5 QUALITY ASSURANCE

- A. Concrete Standards: Comply with provisions of the following standards, except where more stringent requirements are indicated.
 - 1. American Concrete Institute (ACI) 301, "Specifications for Structural Concrete for Buildings."
 - 2. ACI 318, "Building Code Requirements for Reinforced Concrete."
 - 3. Concrete Reinforcing Steel Institute (CRSI) "Manual of Standard Practice."
 - 4. Standard specifications for PWC (Green Book) latest edition, section 201-1.
- B. Concrete Manufacturer Qualifications: Manufacturer of ready-mixed concrete products complying with ASTM C 94 requirements for production facilities and equipment.
- C. Paving work, base course etc., shall be done only after excavation and construction work, which may damage them, have been completed. Damage caused during construction shall be repaired before acceptance.
- D. Existing paving area shall, if damaged or removed during the course of this project, be repaired or replaced under this section of the specification. Workmanship and materials for such repair and replacement, except as otherwise noted, shall match as closely as possible those employed in existing work.
- E. Pavement, base, or subbase shall not be placed on a muddy subgrade.
- F. Provide sawcut control joints as required to construct 100 sq. ft. maximum panel sizes, unless otherwise called on the plans.
- G. Concrete Testing Service: Engage a qualified independent testing agency to perform materials evaluation tests and to design concrete mixes.

1.6 PROJECT CONDITIONS

- A. Traffic Control: Maintain access for vehicular and pedestrian traffic as required for other construction activities.

1.7 TESTING AND INSPECTION

- A. The owner reserves the right to inspect and test paving and associated work.

PART 2 - PRODUCTS

2.1 FORMS

- A. Form Materials: Plywood, metal, metal-framed plywood, or other acceptable panel-type materials to provide full-depth, continuous, straight, smooth exposed surfaces.
 - 1. Use flexible or curved forms for curves of a 100-foot or less radius.
- B. Form Release Agent: Provide commercial formulation form-release agent with a maximum of 350 g/L volatile organic compounds (VOCs) that will not bond with, stain, or adversely affect concrete surfaces and will not impair subsequent treatments of concrete surfaces.
 - 1. Available Products: Subject to compliance with requirements, products that may be incorporated in the Work include, but are not limited to, the following:
 - a. Debond Form Coating, L & M Construction Chemicals.
 - b. Crete-Lease 880 VOC, Cresset Chemical Company.

2.2 REINFORCING MATERIALS

- A. Reinforcing Bars and Tie Bars: ASTM A 615, Grade 40 for #3 bars and Grade 60 for bars larger than #3, deformed.
- B. Plain, Cold-Drawn Steel Wire: ASTM A 82.
- C. Joint Dowel Bars: Plain steel bars, ASTM A 615, Grade 60. Cut bars true to length with ends square and free of burrs.
- D. Dowel Sleeves: Speed Dowel, Aztec Concrete Accessories, Inc.
- E. Hook Bolts: ASTM A 307, Grade A bolts, internally and externally threaded. Design hook bolt joint assembly to hold coupling against pavement form and in position during concreting operations, and to permit removal without damage to concrete or hook bolt.
- F. Supports for Reinforcement: Chairs, spacers, dowel bar supports and other devices for spacing, supporting, and fastening reinforcing bars, welded wire fabric, and dowels in place. Use wire bar-type supports complying with CRSI specifications.
 - 1. Use supports with sand plates or horizontal runners where base material will not support chair legs.
- G. Welded wire fabric reinforcement shall conform to the applicable requirements of ASTM A185. Fabric reinforcement shall be furnished in flat sheets. Fabric reinforcement in rolls will not be permitted.

2.3 CONCRETE MATERIALS

- A. Portland Cement: ASTM C 150, Type II
 - 1. Use one brand of cement throughout Project. Coordinate with Division 3 Section "Cast-In-Place Concrete."
- B. Normal-Weight Aggregates: ASTM C 33, Class 4M non-reactive, and as follows. Provide aggregates from a single source.
 - 1. Maximum Aggregate Size: 1-inch.
 - 2. Do not use fine or coarse aggregates that contain substances that cause spalling.

3. Local aggregates not complying with ASTM C 33 that have been shown to produce concrete of adequate strength and durability by special tests or actual service may be used when acceptable to Architect.

C. Water: Potable.

D. Admixtures: Comply with requirements specified in Division 32 Section "321313 Concrete paving."

1. Do not use admixtures containing calcium chloride or chloride ions.

2.4 COLOR ADMIXTURE

- A. Color admixture shall be suitable for flatwork concrete and shall meet or exceed the requirements set by Portland Cement Association (PCA) and ATSM C 494.
- B. Color admixture shall be of a type and quality which will not adversely affect workability, setting, or strength of concrete. Color pigments shall consist of chemically inert, non-fading, alkali-fast mineral oxides, finely ground and specially prepared for the use in both cement and mortar. Admixture shall not contain calcium chloride.
- C. Color admixture shall be Chromix admixture, manufactured by L.M. Scofield Company, Los Angeles, CA 90040, or approved equal.
- D. Mix design shall conform to manufacturer's recommendations, and directions of the Architect to achieve proposed color. Strictly monitor additive / cement ratio throughout job to ensure uniform color.

2.5 CURING MATERIALS

- A. Absorptive Cover: Burlap cloth made from jute or kenaf, weighing approximately 9 oz. per sq. yd., complying with AASHTO M 182, Class 2.
- B. Moisture-Retaining Cover: One of the following, complying with ASTM C 171.
 1. Waterproof paper.
 2. Polyethylene film.
 3. White burlap-polyethylene sheet.
- C. Liquid Membrane-Forming Curing Compound: ASTM C 309, Type 1, Class B. Moisture loss not more than 0.55 kg/sq. meter in 72 hours when applied at a rate of 200 sq. ft./gal.
 1. Provide material that has a maximum volatile organic compound (VOC) rating of 350 g/L.
 2. Products: Subject to compliance with requirements, provide one of the following or approved equal:
 - a. L & M Cure R, L & M Construction Chemicals, Inc.
 - b. 1100-Clear, W.R. Meadows, Inc.
 3. Do not use sodium silicate type curing agents.
- D. Evaporation Control: Monomolecular film-forming compound applied to exposed concrete slab surfaces for temporary protection from rapid moisture loss.
 1. Products: Subject to compliance with requirements, provide one of the following or approved equal:
 - a. Eucobar; Euclid Chemical Co.

- b. E-Con; L&M Construction Chemicals, Inc.
- c. Confilm; Master Builders, Inc.

2.6 RELATED MATERIALS

- A. Bonding Agent: Acrylic or styrene butadiene, complying with ASTM C 1059, Type 2.
- B. Epoxy Adhesive: ASTM C 881, two-component material suitable for dry or damp surfaces. Provide material type, grade, and class to suit requirements.
- C. Products: Subject to compliance with requirements, provide one of the following or approved equal:
 - 1. Bonding Agent:
 - b. SBR Latex; Euclid Chemical Co.
 - c. Daraweld C; W.R. Grace & Co.
 - d. Everbond; L&M Construction Chemicals, Inc.
 - e. Acryl-Set; Master Builders Inc.
 - 2. Epoxy Adhesive:
 - a. Burke Epoxy M.V., The Burke Co.
 - b. Concsive Standard Liquid; Master Builders, Inc.
 - c. Rezi-Weld 1000; W.R. Meadows, Inc.
- D. Concrete Sealer: Water-based, deep penetrating, non-staining, non-darkening silane micro emulsion.
 - 1. Positive chloride-ion screening, prevents water intrusion, minimizes rebar corrosion and potential concrete spalling, and protects against damaging effects of alkalis and other contaminants.
 - 2. Provide material that has a maximum volatile organic compound (VOC) rating of 350 g/L.
 - 3. Available Products: Subject to compliance with requirements, products that may be incorporated in the work include, but are not limited to the following:
 - a. Pentane WB, L & M Construction Chemicals, Inc. This product is intended to establish the characteristics and level of quality intended for this Project.
- D. Expansion and Isolation Joint Fillers: ASTM D 1751, cellulosic fiber.

2.7 CONCRETE MIX

- A. Prepare design mixes for each type and strength of normal-weight concrete by either laboratory trial batch or field experience methods as specified in ACI 301. For the trial batch method, use a qualified independent testing agency for preparing and reporting proposed mix designs.
 - 1. Do not use the Owner's field quality-control testing agency as the independent testing agency.
- B. Proportion mixes according to ACI 211.1 and ACI 301 to provide normal-weight concrete with the following properties:
 - 1. Compressive Strength (28-Day): 2500 psi for concrete for sidewalks; 3200 psi for concrete in traffic areas, curbs and gutters.
 - 2. The minimum cement content shall be 5-1/4 sacks per cubic yard.

3. The maximum concrete slump shall be 3 inches $\pm 1/2$ inch, for all walks; and 4 inches ± 1 inch for all other Portland cement concrete paving.
4. Water/Cement Ratios:
 - a. 0.50 maximum for all site concrete.
- C. Adjustment to Concrete Mixes: Mix design adjustments may be requested by Contractor when characteristics of materials, project conditions, weather, test results, or other circumstances warrant.
- D. Admixtures: Comply with requirements specified in Division 32 Section "321313 Concrete paving."

2.8 CONCRETE MIXING

- A. Ready-Mixed Concrete: Comply with requirements and with ASTM C 94.
 1. When air temperature is between 85 deg F (30 deg C) and 90 deg F (32 deg C), reduce mixing and delivery time from 1-1/2 hours to 75 minutes; when air temperature is above 90 deg F (32 deg C), reduce mixing and delivery time to 60 minutes.

2.9 GROUT

- A. Grout shall be mixed in the proportions of one part Portland cement to two parts sand, by volume. Only sufficient water shall be used to enable grout to barely hold its shape when squeezed into a ball in the hand. Sand for grout shall be "Fine Aggregate", conforming to ASTM C 33.
- B. Non-shrink grout shall be pre-mixed non-shrinking, high strength grout. Compressive strength in 28 days shall be 5,000 psi minimum, but in no case less than the specified strength of the adjacent concrete. Manufacturer shall provide evidence that the material meets the requirements of the COE CRD-C 621 (558). Grout permanently exposed to view shall be non-oxidizing; metallic grout may be used in other locations.
 1. Non-shrink grout shall be one of the following or approved equal:

<u>Manufacturer</u>	<u>Product</u>
Gifford-Hill Co.	Supreme
Master Builders Co.	Embeco
U.S. Grout Corporation	Five Star Grout

2.10 SANDBLASTING MATERIAL

- A. Material for sandblasting shall be 16/20 mesh sand.

2.11 HERBICIDE TREATMENT

- A. Commercial chemical for weed control, registered by Environmental Protection Agency. Provide granular, liquid, or wettable powder form.
 1. Available Manufacturers: Subject to compliance with requirements, manufacturers offering products that may be incorporated in the work include, but are not limited to the following:
 - a. Ciba-Geigy Corp.
 - b. Dow Chemical U.S.A.
 - c. E.I. Du Pont de Nemours & Co., Inc.
 - d. FMC Corp.

- e. Thompson-Hayward Chemical Co.
- f. U.S. Borax and Chemical Corp.

PART 3 - EXECUTION

3.1 SURFACE PREPARATION

- A. Areas to be paved shall be compacted and brought to subgrade elevation per soils report before work of this section is performed. Final fine grading, filling, and compaction of areas to receive paving, as required to form a firm, uniform, accurate, and unyielding subgrade at required elevations and to required lines, shall be done under this Section.
- B. Existing subgrade material which will not readily compact as required shall be removed and replaced with satisfactory materials. Additional materials needed to bring subgrade to required line and grade and to replace unsuitable material removed shall be material conforming to this Section.
- C. Subgrade of areas to be paved shall be re-compacted per soils report.
- D. Excavation required in pavement subgrade shall be completed before fine grading and final compaction of subgrade are performed. Where excavation must be performed in completed subgrade, base, or pavement, subsequent backfill and compaction shall be performed per soils report.
- E. Areas being graded or compacted shall be kept shaped and drained during construction. Ruts greater than or equal to 2 in. deep in subgrade, shall be graded out, reshaped as required, and re-compacted before placing pavement.
- F. Materials shall not be stored or stockpiled on subgrade.
- G. Disposal of debris and other material excavated under this section, and material unsuitable for or in excess of requirements for completing work of this section shall be disposed of off-site.
- H. Prepared subgrade will be inspected by Soils Engineer. Subgrade shall be approved before installation of gravel base course. Disturbance to subgrade caused by inspection procedures shall be repaired under this section of the specification.
- I. Proof-roll subgrade or base surface prepared by others to check for unstable areas and verify need for additional compaction. Do not begin paving work until such conditions have been corrected and are ready to receive paving.
- J. Herbicide Treatment: Apply chemical weed control agent in strict compliance with manufacturer's recommended dosages and application instructions. Apply to compacted, dry subgrade prior to installation of base course.

3.2 EDGE FORMS AND SCREED CONSTRUCTION

- A. Set, brace, and secure edge forms, bulkheads, and intermediate screed guides for paving to required lines, grades, and elevations. Install forms to allow continuous

progress of work and so that forms can remain in place at least 24 hours after concrete placement.

- B. Check completed formwork and screeds for grade and alignment to following tolerances:
 - 1. Top of Forms: Not more than 1/8 inch in 10 feet.
 - 2. Vertical Face on Longitudinal Axis: Not more than 1/4 inch in 10 feet.
- C. Clean forms after each use and coat with form release agent as required to ensure separation from concrete without damage.

3.3 PLACING REINFORCEMENT

- A. General: Comply with Concrete Reinforcing Steel Institute's recommended practice for "Placing Reinforcing Bars" for placing and supporting reinforcement.
- B. Clean reinforcement of loose rust and mill scale, earth, or other bond-reducing materials. Where there is delay in placing concrete after reinforcement is in place, bars shall be re inspected and cleaned when necessary.
- C. Any bar showing cracks after bending shall be discarded.
- D. Arrange, space, and securely tie bars and bar supports to hold reinforcement in position during concrete placement. Maintain minimum cover to reinforcement.
- E. Install fabricated bar mats in lengths as long as practicable. Handle units to keep them flat and free of distortions. Straighten bends, kinks, and other irregularities or replace units as required before placement. Set mats for a minimum 2-inch overlap to adjacent mats.
- F. After forms have been coated with form release agent, but before concrete is placed, reinforcing steel anchors shall be securely wired in the exact position called for, and shall be maintained in that position until concrete is placed and compacted. Chair bars and supports shall be provided in a number and arrangement satisfactory to the Architect.

3.4 JOINTS

- A. General: Construct contraction, construction, and isolation joints true to line with faces perpendicular to surface plane of concrete. Construct transverse joints at right angles to the centerline, unless indicated otherwise.
 - 1. When joining existing paving, place transverse joints to align with previously placed joints, unless indicated otherwise.
 - 2. Make joints, including sawed joints, full depth required and from edge to edge of paving.
- B. Control Joints: Provide weakened-plane control joints, sectioning concrete into areas as shown on Drawings. Construct control joints for a depth equal to at least 1/4 of the concrete thickness, as follows:
 - 1. Tooled Joints: Form control joints in fresh concrete by grooving and finishing each edge of joint with a radiused jointer tool.
 - 2. Sawed Joints: Form control joints with power saws equipped with shatterproof abrasive or diamond-rimmed blades. Cut 1/8-inch-wide joints into hardened

- concrete when cutting action will not tear, abrade, or otherwise damage surface and before development of random contraction/shrinkage cracks.
3. Inserts: Form control joints by inserting pre-molded plastic, hardboard, or fiberboard strips into fresh concrete until top surface of strip is flush with paving surface. Radius each joint edge with a jointer tool. Carefully remove strips or caps of two-piece assemblies after concrete has hardened. Clean groove of loose debris.
- C. Construction Joints: Set construction joints at side and end terminations of paving and at locations where paving operations are stopped for more than 1/2 hour, unless paving terminates at isolation joints.
1. Continue reinforcement across construction joints unless indicated otherwise. Do not continue reinforcement through sides of strip paving unless indicated.
 2. Provide tie bars at sides of paving strips where indicated.
 3. Use bonding agent on existing concrete surfaces that will be joined with fresh concrete.
- D. Isolation Joints: Form isolation joints of preformed joint filler strips abutting concrete curbs, catch basins, manholes, inlets, structures, walks, other fixed objects, and where indicated.
- E. Expansion Joints: Form expansion joints of preformed joint filler strips.
1. Install dowel bars and support assemblies at joints where indicated. When no sleeves are used, lubricate or asphalt-coat one half of dowel length to prevent concrete bonding to one side of joint.
 2. Where spacing is not shown, locate expansion joints at 32-foot maximum spacing or less to fit the control joints pattern.
- F. Installation of joint fillers and sealants is specified in Section "Joint Sealants".
1. Extend joint fillers full width and depth of joint, not less than 1/2 inch or more than 1 inch below finished surface where joint sealant is indicated. Place top of joint filler flush with finished concrete surface when no joint sealant is required.
 2. Furnish joint fillers in one-piece lengths for full width being placed wherever possible. Where more than one length is required, lace or clip joint filler sections together.
 3. Protect top edge of joint filler during concrete placement with a metal, plastic, or other temporary preformed cap. Remove protective cap after concrete has been placed on both sides of joint.
- G. Where plastic "zip strips" are used to construct concrete joints, cut and remove, as a minimum, the top 1/4 inch of these strips after concrete has cured, and coordinate installation of joint filler as specified in Section "Joint Sealants".

3.5 CONCRETE PLACEMENT

- A. Inspection: Before placing concrete, inspect and complete formwork installation, reinforcing steel, and items to be embedded or cast in. Notify other trades to permit installation of their work.

- B. Moisten subgrade or base to provide a uniform dampened condition at the time concrete is placed. Do not place concrete around manholes or other structures until they are at the required finish elevation and alignment.
- C. Comply with requirements and with ACI 304R for measuring, mixing, transporting, and placing concrete.
- D. Deposit and spread concrete in a continuous operation between transverse joints. Do not push or drag concrete into place or use vibrators to move concrete into place.
- E. Use a bonding agent at locations where fresh concrete is placed against hardened or partially hardened concrete surfaces.
- F. Consolidate concrete by mechanical vibrating equipment supplemented by hand-spading, rodding, or tamping. Use equipment and procedures to consolidate concrete complying with ACI 309R.
 - 1. Consolidate concrete along face of forms and adjacent to transverse joints with an internal vibrator. Keep vibrator away from joint assemblies, reinforcement, or side forms. Use only square-faced shovels for hand-spreading and consolidation. Consolidate with care to prevent dislocating reinforcing, dowels, and joint devices.
- G. Screed paved surfaces with a straightedge and strike off. Use bull floats or darbies to form a smooth surface plane before excess moisture or bleed water appears on the surface. Do not further disturb concrete surfaces prior to beginning finishing operations.
- H. Curbs and Gutters: When automatic machine placement is used for curb and gutter placement, submit revised mix design and laboratory test results that meet or exceed requirements. Produce curbs and gutters to required cross section, lines, grades, finish, and jointing as specified for formed concrete. If results are not acceptable, remove and replace with formed concrete.
- I. Cold-Weather Placement: Comply with provisions of ACI 306R and as follows. Protect concrete work from physical damage or reduced strength that could be caused by frost, freezing actions, or low temperatures.
 - 1. When air temperature has fallen to or is expected to fall below 40 deg F (4 deg C), uniformly heat water and aggregates before mixing to obtain a concrete mixture temperature of not less than 50 deg F (10 deg C) and not more than 80 deg F (27 deg C) at point of placement.
 - 2. Do not use frozen materials or materials containing ice or snow.
 - 3. Do not use calcium chloride, salt, or other materials containing antifreeze agents or chemical accelerators unless otherwise accepted in mix designs.
- J. Hot-Weather Placement: Place concrete complying with ACI 305R and as specified when hot weather conditions exist.
 - 1. Cool ingredients before mixing to maintain concrete temperature at time of placement to below 90 deg F (32 deg C). Mixing water may be chilled or chopped ice may be used to control temperature, provided water equivalent of ice is calculated to total amount of mixing water. Using liquid nitrogen to cool concrete is Contractor's option.

2. Cover reinforcing steel with water-soaked burlap if it becomes too hot, so that steel temperature will not exceed the ambient air temperature immediately before embedding in concrete.
3. Fog spray forms, reinforcing steel, and subgrade just before placing concrete. Keep subgrade moisture uniform without standing water, soft spots, or dry areas.

3.6 CONCRETE FINISHING

- A. Float Finish: Begin floating when bleed water sheen has disappeared, and the concrete surface has stiffened sufficiently to permit operations. Float surface with power-driven floats, or by hand-floating if area is small or inaccessible to power units. Finish surfaces to true planes within a tolerance of 1/4 inch in 10 feet as determined by a 10-foot-long straightedge placed anywhere on the surface in any direction. Cut down high spots and fill low spots. Refloat surface immediately to a uniform granular texture.
 1. Burlap Finish: Drag a seamless strip of damp burlap across concrete, perpendicular to line of traffic, to provide a uniform gritty texture finish.
 2. Medium-to-Fine-Textured Broom Finish: Draw a soft bristle broom across concrete surface perpendicular to line of traffic to provide a uniform fine line texture finish.
 3. Medium-to-Coarse-Textured Broom Finish: Provide a coarse finish by striating surface 1/16 inch to 1/8 inch deep with a stiff-bristled broom, perpendicular to line of traffic.
 4. Do not use troweling machines within 12 inches of electrical junction and outlet boxes which are set to finish flush with concrete slabs. Float and trowel such areas by hand with wood floats and steel trowels, taking care to see that concrete is finished flush with box cover and matches adjacent surfaces.
- B. Slip-Resistant Aggregate Finish: Before final floating, spread slip-resistive aggregate finish on pavement surface in accordance with manufacture's written instructions
 1. Cure concrete with curing compound recommended by slip-resistive aggregate manufacturer. Apply curing compound immediately after final finishing.
 2. After curing, lightly work surface with a steel wire brush or abrasive stone and water to expose non-slip aggregate
- C. Finishing formed surfaces:
 1. Curb forms shall leave a smooth face.
 2. Remove all fins.
- D. Provide steel trowel finish on tops of curbs and flow lines of curbs, gutters and integral curb and gutters.
- E. Final Tooling: Tool edges of paving, gutters, curbs, and joints formed in fresh concrete with a jointing tool to the following radius. Repeat tooling of edges and joints after applying surface finishes. Eliminate tool marks on concrete surfaces.
 1. Radius: 1/4 inch.
 2. Radius: 3/8 inch.
- F. Finish surfaces to produce a uniform appearance throughout area involved and throughout adjacent areas with the same treatment.
- G. Sandblast finish shall be consistent finish throughout and match approved mock-up.

- H. Where concrete finishing occurs adjacent to finished metal or other surfaces, particularly where serrated or indented surfaces occur, remove all traces of cement film before allowing to harden.
- I. Apply integral wood float and broom finish to the all concrete pavements and walkways, unless otherwise shown on the Drawings.
 - 1. After screeding and compacting, finish with a wood float using a circular motion to produce a uniform texture and finish throughout.
 - 2. For vehicular traffic areas, the finish shall be coarse enough to provide a non-slip surface with a minimum static friction coefficient of 0.6.
 - 3. For pedestrian traffic areas, finish shall be a non-slip surface with a minimum static coefficient of friction of 0.6.
 - a. For ramps, the static coefficient of friction shall be a minimum of 0.8. Ramps are defined as any sloping path of travel with a slope in the direction of travel of 5.0%, or greater.
 - 4. Tests for coefficient of friction shall be either ASTM C-1028 (field test) or ASTM D-2047 (laboratory test).

3.7 CONCRETE PROTECTION AND CURING

- A. General: Protect freshly placed concrete from premature drying and excessive cold or hot temperatures. Comply with the recommendations of ACI 306R for cold weather protection and ACI 305R for hot weather protection during curing.
- B. Evaporation Control: In hot, dry, and windy weather, protect concrete from rapid moisture loss before and during finishing operations with an evaporation-control material. Apply according to manufacturer's instructions after screeding and bull floating, but before floating.
- C. Begin curing after finishing concrete but not before free water has disappeared from concrete surface.
- D. Curing Methods: Cure concrete by moisture curing, moisture-retaining-cover curing, curing compound, or a combination of these as follows:
 - 1. Moisture Curing: Keep surfaces continuously moist for not less than 7 days with the following materials:
 - a. Water.
 - b. Continuous water-fog spray.
 - c. Absorptive cover, water saturated, and kept continuously wet. Cover concrete surfaces and edges with a 12-inch lap over adjacent absorptive covers.
 - 2. Moisture-Retaining-Cover Curing: Cover concrete surfaces with moisture-retaining cover for curing concrete, placed in widest practicable width, with sides and ends lapped at least 12 inches, and sealed by waterproof tape or adhesive. Immediately repair any holes or tears during curing period using cover material and waterproof tape.
 - 3. Curing Compound: Apply uniformly in continuous operation by power spray or roller according to manufacturer's directions. Recoat areas subjected to heavy rainfall within 3 hours after initial application. Maintain continuity of coating and repair damage during curing period.
- E. Spray-apply concrete sealer to all concrete pavement. Comply with sealer manufacturer's application instructions.

3.8 CURING COLORED CONCRETE

- A. Colored concrete shall not, under any circumstances, be cured using water fog misting or ponding, burlap, plastic sheeting, or other wet covering.
- B. Curing material and method shall be in strict conformance with manufacturer's guidelines and recommendations.
- C. Only if additional protection is absolutely required, the surface should remain uncovered for at least 4 days, after which time new and unwrinkled non-staining reinforced waterproof kraft curing paper may be used.

3.9 FIELD QUALITY CONTROL TESTING

- A. The Owner will employ a qualified testing and inspection agency to sample materials, perform tests, and submit test reports during concrete placement. Sampling and testing for quality control may include the following:
 - 1. Sampling Fresh Concrete: ASTM C 172, except modified for slump to comply with ASTM C 94.
 - a. Slump: ASTM C 143; one test at point of placement for each compressive-strength test but no less than one test for each day's pour of each type of concrete. Additional tests will be required when concrete consistency changes.
 - b. Air Content: ASTM C 231, pressure method; one test for each compressive-strength test but no less than one test for each day's pour of each type of air-entrained concrete.
 - c. Concrete Temperature: ASTM C 1064; one test hourly when air temperature is 40 deg F (4 deg C) and below and when 80 deg F (27 deg C) and above, and one test for each set of compressive-strength specimens.
 - d. Compression Test Specimens: ASTM C 31; one set of four standard cylinders for each compressive-strength test, unless directed otherwise. Mold and store cylinders for laboratory-cured test specimens except when field-cured test specimens are required.
 - e. Compressive-Strength Tests: ASTM C 39; one set for each day's pour of each concrete class exceeding 5 cu. yd. but less than 25 cu. yd., plus one set for each additional 50 cu. yd. Test one specimen at 7 days, test two specimens at 28 days, and retain one specimen in reserve for later testing if required.
 - 2. When frequency of testing will provide fewer than five strength tests for a given class of concrete, conduct testing from at least five randomly selected batches or from each batch if fewer than five are used.
 - 3. When total quantity of a given class of concrete is less than 50 cu. yd., Architect may waive strength testing if adequate evidence of satisfactory strength is provided.
 - 4. When strength of field-cured cylinders is less than 85 percent of companion laboratory-cured cylinders, evaluate current operations and provide corrective procedures for protecting and curing the in-place concrete.
 - 5. Strength level of concrete will be considered satisfactory if averages of sets of three consecutive strength test results equal or exceed specified compressive strength and no individual strength test result falls below specified compressive strength by more than 500 psi.

- B. Test results will be reported in writing to Architect, concrete manufacturer, and Contractor within 24 hours of testing. Reports of compressive strength tests shall contain the Project identification name and number, date of concrete placement, name of concrete testing agency, concrete type and class, location of concrete batch in paving, design compressive strength at 28 days, concrete mix proportions and materials, compressive breaking strength, and type of break for both 7-day and 28-day tests.
- C. Nondestructive Testing: Impact hammer, sonoscope, or other nondestructive device may be permitted but shall not be used as the sole basis for acceptance or rejection.
- D. Additional Tests: The testing agency will make additional tests of the concrete when test results indicate slump, air entrainment, concrete strengths, or other requirements have not been met, as directed by Architect. Testing agency may conduct tests to determine adequacy of concrete by cored cylinders complying with ASTM C 42, or by other methods as directed.
- E. Manufacturer's Field Service: When placing integral colored concrete, arrange for the services of a qualified technical representative of the color pigment manufacturer, equipped with wet-batch color control test devices to ensure concrete of uniform color and matching approved mock-up.

3.10 REPAIRS AND PROTECTION

- A. Remove and replace concrete paving that is broken, damaged, or defective, or does not meet the requirements of this Section. Concrete which is not true to line and plane, which is not thoroughly troweled and properly surfaced as required, which varies in excess of 1/4-inch along a 10-foot straight edge, which is scuffed or has a rough top surface, except where required, or which does not connect properly to adjoining work, does not slope as required for drainage or is not properly cured, will be deemed defective.
 - 1. General: Patch defective areas immediately following form removal. Remove defective concrete to a width and depth necessary for proper patching, but in no case less than 1 inch deep. Make the walls of the cut area perpendicular to the surface and do not feather out the edge. Dampen the patch area and the adjacent area 6 inches around the patch area.
 - 2. Exposed concrete: Prepare a patching mortar of one part Portland cement, adjusted to match the color of the surrounding concrete, and 2-1/2 parts sand with the least water required to produce a workable mass. Re-work this mortar until it is the stiffest consistency that will permit placing. Brush the patch area with a bond of neat cement and water paste and apply patching mortar when the water sheen is off the bond. Strike off the mortar slightly higher than the surrounding surface, let set for 1 hour and finish flush with the surrounding surface.
- B. Drill test cores where directed by Architect when necessary to determine magnitude of cracks or defective areas. Fill drilled core holes in satisfactory pavement areas with Portland cement concrete bonded to paving with epoxy adhesive.
- C. Protect concrete from damage. Exclude traffic from paving for at least 14 days after placement. When construction traffic is permitted, maintain paving as clean as possible by removing surface stains and spillage of materials as they occur.

- D. Maintain concrete paving free of stains, discoloration, dirt, and other foreign material. Sweep concrete paving not more than 2 days prior to date scheduled for Substantial Completion inspections.

END OF SECTION

SECTION 331000

WATER DISTRIBUTION

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. This Section includes piping and specialties for combined potable and fire protection water service outside the building.
- B. Related Sections include the following:
 - 1. Section 312000 - Earthwork for trench excavation and backfill.
 - 2. Drawings for potable and fire protection piping inside the building.

1.3 SYSTEM PERFORMANCE REQUIREMENTS

- A. Minimum Working Pressures: The following are minimum pressure requirements for piping and specialties, unless otherwise indicated:
 - 1. Combined Potable Water and Fire Protection Water Service: 200 psig (1380 kPa).

1.4 SUBMITTALS

- A. General: Submit each item in this Article according to the Conditions of the Contract and Division 1 Specification Sections.
- B. Product Data: For the following:
 - 1. Pipe, joint restraints and fittings.
 - 2. Valves and covers
 - 3. Backflow preventer
 - 4. Fire Department Connection
- C. Purging and Disinfecting Reports: As specified in "Cleaning" Article in Part 3.

1.5 QUALITY ASSURANCE

- A. Comply with NFPA 24, "Installation of Private Fire Service Mains and Their Appurtenances," for materials, installations, tests, flushing, and valve and hydrant supervision.
- B. Comply with NSF Standard 61, "Drinking Water System Components", for material, installation, and testing requirements.
- C. Comply with City of Rosemead requirements for tapping of water mains.
- D. Comply with City of Rosemead standards for potable water-service piping for testing and disinfections.
- E. Comply with City of Rosemead Fire Department installation and testing requirements.

1.6 DELIVERY, STORAGE, AND HANDLING

- A. Preparation for Transport: Prepare valves according to the following:
 - 1. Ensure that valves are dry and internally protected against rust and corrosion.
 - 2. Protect valves against damage to threaded ends and flange faces.
 - 3. Set valves in best position for handling. Set valves closed to prevent rattling.
- B. During Storage: Use precautions for valves according to the following:
 - 1. Do not remove end protectors, unless necessary for inspection; then reinstall for storage.
 - 2. Protect from weather. Store indoors and maintain temperature higher than ambient dew-point temperature. Support off the ground or pavement in watertight enclosures when outdoor storage is necessary.
- C. Handling: Use sling to handle valves whose size requires handling by crane or lift. Rig valves to avoid damage to exposed valve parts. Do not use handwheels or stems as lifting or rigging points.
- D. Deliver piping with factory-applied end-caps. Maintain end-caps through shipping, storage, and handling to prevent pipe-end damage and to prevent entrance of dirt, debris, and moisture.
- E. Protect stored piping from moisture and dirt. Elevate above grade. Do not exceed structural capacity of floor when storing inside.
- F. Protect flanges, fittings, and specialties from moisture and dirt.

1.7 PROJECT CONDITIONS

- A. Verify existing utility locations and meters. Contact utility locating service.
- B. Verify that it is possible to install water service piping to comply with original design and referenced standards.
- C. Site Information: Reports on subsurface condition investigations made during design of Project are available for informational purposes only; data in reports are not intended as representations or warranties of accuracy or continuity of conditions between soil borings. Owner assumes no responsibility for interpretations or conclusions drawn from this information.
- D. Obtain necessary connection permits with local water company as required.
- E. Obtain necessary street excavation and encroachment permits from the [City of Rosemead](#) Dept. of Public Works.

1.8 SEQUENCING AND SCHEDULING

- A. Coordinate piping materials, sizes, entry locations, and pressure requirements with building water distribution piping.
- B. Coordinate piping materials, sizes, entry locations, and pressure requirements with building fire-protection water piping.

- C. Coordinate with other site utility work.

PART 2 - PRODUCTS

2.1 PIPES AND TUBES

- A. General: Applications of the following pipe and tube materials are indicated in Part 3 "Piping Applications" Article.
- B. PVC Plastic, Socket Fittings: ASTM D 2466, Schedule 40.
- C. PVC Plastic, Fire Service Pipe: UL 1285 and AWWA C900, Class 200 or 150 as noted on plans. Include elastomeric seal according to ASTM F 477.
- D. Pipe sizes up to 2 inches shall be copper water tubing, Type K hard, ANSI H23.1, ASTM B 88, IAPMO IS. Muller Brass, Cambridge-Lee Halstead, or equal. An approved protective wrap shall be used to completely isolate and protect all underground copper tubing and extend past the surface a minimum 12 inches. The excess wrapping shall be trimmed down and taped to copper tubing with 10 mill PVC pipe tape at grade level of concrete or asphalt.
- B. Ductile-Iron, Push-on-Joint Pipe: AWWA C151, with cement-mortar lining and seal coat according to AWWA C104. Include rubber compression gasket according to AWWA C111.

2.2 PIPE AND TUBE FITTINGS

- A. General: Applications of the following pipe and tube fitting materials are indicated in Part 3 "Piping Applications" Article.
- B. Copper Fittings: ASME B16.22; wrought-copper, solder-joint pressure type.
- C. PVC Plastic, Socked Fittings: ASTM D2466, Schedule 40.
- D. Ductile-Iron, Push-on-Joint Fittings: AWWA C110, ductile-iron or cast-iron; or AWWA C153, ductile-iron, compact type. Include cement-mortar lining and seal coat according to AWWA C104 and rubber compression gaskets according to AWWA C111.

2.3 JOINING MATERIALS

- A. General: Applications of the following piping joining materials are indicated in Part 3 "Piping Applications" Article.
- B. Solder Filler Metal: ASTM B 32, Alloy Sn95, Alloy Sn94, or Alloy E, with 0.10 percent maximum lead content.
- C. Primers for PVC Piping Solvent-Cement Joints: ASTM F 656.
- D. Solvent Cement for PVC Piping Solvent-Cement Joints: ASTM D 2564.

2.4 PIPING SPECIALTIES

- A. Dielectric Fittings: Assembly or fitting with insulating material isolating joined dissimilar metals to prevent galvanic action and corrosion.
 - 1. Description: Combination of copper alloy and ferrous; threaded, solder, plain, and weld-neck end types and matching piping system materials.
 - 2. Dielectric Unions: Factory-fabricated union assembly, designed for 250-psig (1725-kPa) minimum working pressure at 180 deg F (82 deg C). Include insulating material isolating dissimilar metals and ends with inside threads according to ASME B1.20.1.
 - 3. Dielectric Flanges: Factory-fabricated companion-flange assembly, for 150- or 300-psig (1035- or 2070-kPa) minimum pressure to suit system pressures.
 - 4. Dielectric-Flange Insulation Kits: Field-assembled companion-flange assembly, full-face or ring type. Components include neoprene or phenolic gasket, phenolic or polyethylene bolt sleeves, phenolic washers, and steel backing washers.
 - a. Provide separate companion flanges and steel bolts and nuts for 150- or 300-psig (1035- or 2070-kPa) minimum working pressure to suit system pressures.
 - 5. Dielectric Couplings: Galvanized-steel couplings with inert and non-corrosive thermoplastic lining, with threaded ends and 300-psig (2070-kPa) minimum working pressure at 225 deg F (107 deg C).
 - 6. Dielectric Nipples: Electroplated steel nipples with inert and non-corrosive thermoplastic lining, with combination of plain, threaded, or grooved end types and 300-psig (2070-kPa) working pressure at 225 deg F (107 deg C).

2.5 POLYETHYLENE ENCASEMENT

- A. Polyethylene Encasement for Ductile-Iron Piping: ASTM A 674 or AWWA C105, PE film, 0.008-inch (0.20-mm) minimum thickness, tube or sheet.

2.6 VALVES

- A. All Gate Valves, 4-Inch NPS (DN80) and Larger in size shall conform to AWWA Standard Specifications C500. All valves, including those over 12", shall be rated to a minimum working pressure of 200 psi. All valves shall be iron body, bronze mounted, double-disk, parallel scat gate valves. All valves shall open by turning the stem counterclockwise. Buried valves shall be non-rising type with O-ring seal equipped with 2 inch square operating nut, and shall be bituminous coated. End connections shall be flanged, or mechanical joint as required for the type of pipe used. Buried valves shall have stem extensions to place operating nut within 6" of top of valve box.
- B. Valve Boxes shall be precast concrete with cast iron traffic rated cover with lettering "WATER", bottom section with base of size to fit over valve and barrel approximately 5 inches (125 mm) in diameter, and adjustable cast-iron extension of length required for depth of bury of valve.
 - 1. Provide steel tee-handle operating wrench with each valve box. Include tee handle with one pointed end, stem of length to operate valve, and socket-fitting valve-operating nut. After installation of valve box cover and after installation of adjacent paving, if any, covers shall be sandblasted or wire-brushed as necessary and painted with bituminous black paint, unless another color is required by the Architect.
- C. Indicator Posts: UL 789, FM-approved, vertical-type, cast-iron body with operating wrench, extension rod, and adjustable cast-iron barrel of length required for depth of bury of valve. Posts above and including connection to riser shall be sandblasted, if

necessary, after installation and painted red, unless another color is required by the Architect.

- D. Tapping Sleeve and Tapping Valve: Complete assembly, including tapping sleeve, tapping valve, and bolts and nuts. Use sleeve and valve compatible with tapping machine.
 - 1. Tapping Sleeve: Cast- or ductile-iron, 2-piece bolted sleeve with flanged outlet for new branch connection. Sleeve may have mechanical-joint ends with rubber gaskets or sealing rings in sleeve body. Include sleeve matching size and type of pipe material being tapped and of outlet flange required for branch connection.
- E. No ball valves shall be used for underground installation.

2.7 BACKFLOW PREVENTERS

- A. General: Manufactured backflow preventers, of size indicated for maximum flow rate and maximum pressure loss indicated.
- B. Working Pressure: 200 psig (1380 kPa) minimum, unless otherwise indicated.
- C. 2-Inch NPS (DN50) and Smaller: Bronze body with threaded ends.
- D. Interior Lining: AWWA C550, epoxy coating for backflow preventers with cast-iron or steel body.
- E. Interior Components: Corrosion-resistant materials.
- F. Strainer on inlet if strainer is indicated.
- G. Hose-Connection Vacuum Breakers: ASSE 1011, nickel plated, with nonremovable and manual drain features, and ASME B1.20.7, 3/4-11.5NH threads for garden hose on outlet. Units attached to rough-bronze-finish hose connections may be rough bronze.
- H. Reduced-Pressure-Principle Backflow Preventer: ASSE 1013, with OS&Y gate valves on inlet and outlet, and strainer on inlet. Include test cocks and pressure-differential relief valve with ASME A112.1.2 air-gap fitting located between 2 positive-seating check valves for continuous-pressure application.
 - 1. Pressure Loss: 12 psig (83 kPa) maximum through middle third of flow range.
 - 2. Double Detector Check Assembly: 15 psi (103.75 kPa) entry loss.
- I. Exterior Finish: Red or yellow (as directed by Water Purveyor or local Fire Department) alkyd-gloss enamel paint. Entire device above and including connection to riser shall be sandblasted, if necessary, after installation and re-painted.

Manufacturer	Model	Size
Cia-Val	RP-LEX	2", 2 1/2", 3", 4", 6", 8", 10"
Cia-Val	RP-2	3/4", 1", 1-1/4", 1-1/2"
Cia-Val	RP4	6 "
Febco	825YD2	2-1/2", 3", 4", 6", 8", 10"
Febco	825Y	3/4", 1", 1-1/4", 1-1/2", 2"
Febco	825YA	3/4", 1", 1-1/2", 2"

Febco	845	3/4",1"
Mueller	H-9506	4",6",8",10"
Orion	80-0069	1-1/2"
Orion	BRP	3/4,1",3",4"
Orion	9-2929	2 "
Rain Bird	RPA-075-R	3/4"
Rain Bird	RPA-100-R	1"
Rain Bird	RPA-125-R	1-1/4"
Rain Bird	RPA-150-R	1-1/2"
Rain Bird	RPA-200-R	2"
Rain Bird	RPA-250-R	2-1/2"
Rain Bird	RPA-400-R	4 "
Rain Bird	RPA-600-R	6"
Rain Bird	RPA-800-R	8"
Rain Bird	RPA-1000-R	10"
Watts	909 PCQT	3/4"-2"
Watts	909HWQT	3/4",1",1-1/4",1-1/2",2"
Watts	909 PCRW	2-1/2"-10"
Watts	909 RW Bronze	2-1/2",3"
Watts	009QT	3/4",1",1-1/4",1-1/2",2"
Watts	009SSQT	3/4",1",1-1/4",1-1/2",2"
Wilkins	975XL	3/4",1",1-1/4",1-1/2",2"
Wilkins	375(SM)	1/2", 3/4",1",1-1/4",1-1/2",2"
Wilkins	375A	2 1/2", 3", 4", 6", 8", 10"
Wilkins	375ADA	2 1/2", 3", 4", 6", 8", 10"
Wilkins	450DA	4", 6", 8", 10"

2.7 FIRE DEPARTMENT CONNECTIONS

- A. Exposed Fire Department Connections: UL 405, cast-brass body, with thread inlets according to NFPA 1963 and matching local fire department hose threads, and threaded bottom outlet. Include lugged caps, gaskets, and chains; lugged swivel connection and drop clapper for each hose-connection inlet; 18-inch- (460-mm-) high brass sleeve; and round escutcheon plate.
 - 1. Connections: Two 2-1/2-inch NPS (DN65) inlets and 6-inch NPS (DN150) outlet.
 - 2. Inlet Alignment: Inline, horizontal.
 - 3. Finish Including Sleeve: Polished chrome-plated.
 - 4. Escutcheon Plate Marking: "AUTO SPKR."

2.8 ANCHORAGES

- A. Concrete Reaction Backing: Portland cement concrete mix, 2000 psig (13.8 MPa).
 - 1. Cement: ASTM C 150, Type I.
 - 2. Fine Aggregate: ASTM C 33, sand.
 - 3. Coarse Aggregate: ASTM C 33, crushed gravel.
 - 4. Water: Potable.

2.9 IDENTIFICATION

- A. Refer to Division 2 Section "Earthwork" for underground warning tape materials.

- B. Arrange for detectable warning tapes made of solid blue film with metallic core and continuously printed black-letter caption "CAUTION--WATER LINE BURIED BELOW."
- C. Nonmetallic Piping Label: Engraved, plastic-laminate label at least 1 by 3 inches (25 by 75 mm), with caption "CAUTION--THIS STRUCTURE HAS NONMETALLIC WATER-SERVICE PIPING," for installation on main electrical meter panel.

PART 3 - EXECUTION

3.1 EARTHWORK

- A. Refer to Section 31 20 00 "Earthwork" for excavation, trenching, and backfilling.
- B. Refer to Section 32 12 16 "Asphalt Concrete Paving" for cutting and patching of existing asphalt paving.
- C. Refer to Section 32 13 13 "Concrete Paving" for cutting and patching of existing concrete paving.

3.2 PIPING APPLICATIONS

- A. General: Use pipe, fittings, and joining methods for piping systems according to the following applications.
- B. Transition couplings and special fittings with pressure ratings at least equal to piping pressure rating may be used, unless otherwise indicated.
- C. Do not use flanges or unions for underground piping.
- D. Flanges, unions, grooved-end-pipe couplings, and special fittings may be used, instead of joints indicated, on aboveground piping and piping in vaults.
- E. Underground water-service piping NPS 2 to NPS 16 shall be the following:
 - 1. Soft copper tube, ASTM B 88, Type K and B 251; wrought-copper, solder-joint fittings; and brazed joints.
 - 2. Ductile-iron, push-on-joint pipe; ductile-iron, push-on-joint fittings; and gasketed, or mechanical-joint pipe; ductile-iron, mechanical-joint fittings; and mechanical joints.
- F. Underground water-service piping NPS 30 shall be the following:
 - 1. Ductile-iron, push-on-joint pipe; ductile-iron, push-on-joint fittings; and gasketed, or mechanical-joint pipe; ductile-iron, mechanical-joint fittings; and mechanical joints

3.3 VALVE APPLICATIONS

- A. Drawings indicate valve types to be used. Where specific valve types are not indicated, the following requirements apply:
 - 1. Underground Valves, 3-Inch NPS (DN80) and Larger: AWWA, gate valves, non-rising stem, with valve box.
 - 2. Underground Valves, 4-Inch NPS (DN100) and Larger: UL/FM, gate valves, non-rising stem, with indicator post.

3.4 JOINT CONSTRUCTION

- A. Ductile-Iron Piping, Gasketed Joints for Fire-Service Piping: According to UL 194 and AWWA C600.
- B. Dissimilar Materials Piping Joints: Use adapters compatible with both piping materials, OD, and system working pressure. Refer to "Piping Systems - Common Requirements" Article below for joining piping of dissimilar metals.

3.5 PIPING SYSTEMS - COMMON REQUIREMENTS

- A. General Locations and Arrangements: Drawings indicate general location and arrangement of piping systems. Install piping as indicated, unless deviations to layout are approved in advance by the Architect or USC.
- B. Install components with pressure rating equal to or greater than system operating pressure.
- C. Install piping free of sags and bends.
- D. Install fittings for changes in direction and branch connections.
- G. Piping Connections: Unless otherwise indicated, make piping connections as specified below:
 - 1. Install dielectric fittings to connect piping of dissimilar metals.

3.6 SERVICE ENTRANCE PIPING

- A. Extend water-service piping and connect to water-supply source and building water piping systems at outside face of building wall in locations and pipe sizes indicated.
 - 1. Terminate water-service piping at building wall until building water piping systems are installed. Terminate piping with caps, plugs, or flanges as required for piping material. Make connections to building water piping systems when those systems are installed.
- B. Sleeves and mechanical sleeve seals are specified in Drawings.
- C. Install underground piping with restrained joints at horizontal and vertical changes in direction. Use restrained-joint piping, thrust blocks, anchors, tie-rods and clamps, and other supports.

3.7 PIPING INSTALLATION

- A. Make connections larger than 2-inch NPS (DN50) with tapping machine according to the following:
 - 1. Install tapping sleeve and tapping valve according to manufacturer's written instructions.
 - 2. Install tapping sleeve on pipe to be tapped. Position flanged outlet for gate valve.

3. Install gate valve onto tapping sleeve. Comply with AWWA C600. Install valve with stem pointing up and with cast-iron valve box.
 4. Use tapping machine compatible with valve and tapping sleeve; cut hole in main. Remove tapping machine and connect water-service piping.
- B. If hot tap is not possible, install cut-in tee with C-110 fittings.
- C. Comply with NFPA 24 for fire-protection water-service piping materials and installation.
- D. Install ductile-iron piping according to AWWA C600.
1. Encase piping with PE film according to ASTM A 674 or AWWA C105.
 2. Install encasement per manufacturer's written instructions. Close seams and overlaps in the polyethylene tubes with polyethylene compatible adhesive tape. The tape shall be approximately two inches wide and shall have the ability to bond securely to a metal surface and the polyethylene material. Repair all rips, tears and other damage with suitable adhesive tape.
- E. Bury piping with depth of cover over top at least 30 inches (750 mm) and according to the following:
1. Under Driveways: With at least 36 inches (900 mm) cover over top.
 2. If trenching before rough grading is completed would result in a lesser depth of cover than specified above, then trenching for water piping installation shall not be done until the specified minimum cover depth can be achieved. If construction traffic will be allowed to pass over completed water piping installations prior to finish paving, then a protective pavement blanket at least equivalent to the final pavement and base thickness shall be constructed within the vehicle access area for a minimum distance of three feet on either side of the pipe. As an alternative to the temporary pavement blanket, the water pipe shall be installed at a minimum of two (2) feet deeper than specified within construction traffic areas.

3.8 ANCHORAGE INSTALLATION

- A. Install anchorages for tees, plugs and caps, bends, crosses, valves, and hydrant branches. Include anchorages for the following piping systems:
1. Gasketed-Joint, Ductile-Iron, Potable-Water Piping: According to AWWA C600.
 2. Fire-Service Piping: According to NFPA 24.
- B. Apply full coat of asphalt or other acceptable corrosion-retarding material to surfaces of installed ferrous anchorage devices.

3.9 VALVE INSTALLATION

- A. General Application: Use mechanical-joint-end valves for 3-inch NPS (DN80) and larger underground installation. Use non-rising-stem UL/FM gate valves for installation with indicator posts.
- B. AWWA-Type Gate Valves: Comply with AWWA C600. Install underground valves with stem pointing up and with cast-iron valve box.

- C. UL/FM-Type Gate Valves: Comply with NFPA 24. Install underground valves and valves in pits with stem pointing up and with vertical cast-iron indicator post.

3.10 FIRE DEPARTMENT CONNECTION INSTALLATION

- A. Install fire department connection of type and features indicated.

3.11 IDENTIFICATION INSTALLATION

- A. Install continuous plastic underground warning tape during back-filling of trench for underground water-service piping. Locate 6 to 8 inches (150 to 200 mm) below finished grade, directly over piping.

3.12 FIELD QUALITY CONTROL

- A. Piping Tests: Conduct piping tests before joints are covered and after thrust blocks have hardened sufficiently. Fill pipeline 24 hours before testing and apply test pressure to stabilize system. Use only potable water.
- B. Hydrostatic Tests: Test at not less than 1-1/2 times working pressure for 2 hours.
 - 1. Increase pressure in 50-psig (350-kPa) increments and inspect each joint between increments. Hold at test pressure for one hour; decrease to 0 psig (0 kPa). Slowly increase again to test pressure and hold for one more hour. Maximum allowable leakage is 2 quarts (1.89 L) per hour per 100 joints. Remake leaking joints with new materials and repeat test until leakage is within above limits.
- C. Prepare reports for testing activities.

3.13 CLEANING

- A. Clean and disinfect water distribution piping as follows:
 - 1. Purge new water distribution piping systems and parts of existing systems that have been altered, extended, or repaired before use.
 - 2. Use purging and disinfecting procedure prescribed by authorities having jurisdiction or, if method is not prescribed by authorities, use procedure described in AWWA C651 or as described below:
 - a. Comply with NFPA 24 for flushing of piping. Flush piping system with clean, potable water until dirty water does not appear at points of outlet.
 - 1) Fill system or part of system with water/chlorine solution containing at least 50 ppm of chlorine. Isolate system or part thereof and allow to stand for 24 hours.
 - 2) Drain system or part of system of previous solution and refill with water/chlorine solution containing at least 200 ppm of chlorine; isolate and allow to stand for 3 hours.
 - 3) Following allowed standing time, flush system with clean, potable water until chlorine does not remain in water coming from system.
 - 4) Submit water samples in sterile bottles to authorities having jurisdiction. Repeat procedure if biological examination shows evidence of contamination.
- B. Prepare reports for purging and disinfecting activities.

END OF SECTION

SECTION 333100
SANITARY SEWER

PART 1 - GENERAL

1.1 SECTION INCLUDES

- A. Sanitary drainage piping, fittings and accessories.
- B. Connection of building sanitary sewer drainage system to site sewer systems
- C. Cleanout access.

1.2 REFERENCES

- A. ASTM D2751 - Acrylonitrile-Butadiene-Styrene (ABS) Sewer Pipe and Fittings.
- B. ASTM D3034 - polyvinyl chloride (PVC), SDR 35, for solvent-cemented or gasketed joints.
- C. ASTM C700 - Standard Specification for Vitrified Clay Pipe, Extra Strength, Standard Strength, and Perforated
- D. SSPWC - Standard Specifications for Public Works Construction, latest Edition.

1.3 REGULATORY REQUIREMENTS

- A. Conform to Section 306, Standard Specifications for Public Works Construction, for materials and installation of Work of this Section.

1.4 SUBMITTALS

- A. Shop drawings indicating dimensions, locations and elevations of manholes, cleanouts and sub-surface structures.
- B. Product data for pipe and pipe accessories.
- C. Inspection and test reports specified

1.5 PROJECT RECORD DOCUMENTS

- A. Accurately record location of existing and proposed pipe runs, connections, manholes, cleanouts and invert elevations.
- B. Identify and describe unexpected variations to subsoil conditions or discovery of uncharted utilities.

PART 2 - PRODUCTS

2.1 SEWER PIPE MATERIALS

- A. Gravity-Flow, Non-pressure Plastic Pipe: Polyvinyl Chloride (PVC) Sewer Pipe and Fittings: ASTM D 3034, SDR 35, for gasketed joints. Gaskets: ASTM F 477, elastomeric seal.
- B. PVC pipe is for outside conditions.
- C. Vitrified Clay Pipe (VCP) - pipe shall be "extra strength VCP" and shall comply with Section 207-8 of the Standard Specifications for Public Works Construction. Pipe shall be manufactured in accordance with ASTM C-700 and installed in accordance with ASTM C-12. Joints for Vitrified Clay Pipe shall comply with Section 208-2.3 of SSPWC and manufactured in accordance with ASTM C-425. All VCP pipe, fittings and couplings shall be clearly marked at an interval not to exceed 5 feet as follows:
 - 1) Nominal pipe diameter.
 - 2) VCP classification.
 - 3) Company, plant, shift ASTM, and date designation.
 - 4) Service designation or legend.
- D. Reinforced Concrete Pipe and Fittings: ASTM C76 (ASTM C76M), Class III, Wall B, for gasketed joints.
 - 1) Gaskets: ASTM C443 (ASTM C443M), rubber.
- E. Hub and Spigot, Cast-Iron Soil Pipe and Fittings: ASTM A74, Service class, gray cast iron for gasketed joints. Include ASTM C564, rubber compression-type gaskets.
- F. Backwater Valves: Gray iron.
- G. Cleanouts: PVC.
- H. Corrosion-Protection Piping Encasement: LLDPE film.
- I. Manholes: Standard precast concrete.
 - 1. Resilient pipe connectors.
 - 2. Reinforced-concrete grade rings.
 - 3. Protective coating.
 - 4. Manhole frames and covers, with protective coating.
 - 5. Manhole cover inserts.

2.2 PIPE ACCESSORIES

- A. Pipe Joints: Mechanical clamp ring type, stainless steel expanding and contracting sleeve, neoprene ribbed gasket for positive seal.

- B. Fittings: Same material as pipe, molded or formed to suit pipe size and end design, in required "T", bends, elbows, cleanouts, reducers, traps and other configurations required.
- C. PVC Sewer Pipe and Fittings, NPS 15 and Smaller: ASTM D3034, SDR 35, for solvent-cemented or gasketed joints.
 - 1. Gaskets: ASTM F477, Elastomeric seals.
 - 2. Primer: ASTM F 656.
 - 3. Solvent Cement: ASTM D 2564

2.3 CLEANOUTS

- A. Lid and Frame: Cast iron construction, removable lid, closed checkerboard grill lid design; nominal lid and frame diameter as required for pipe sizes. [SPPWC 204-2]
- B. Manholes: SPPWC Standard Drawing 200-3.

2.4 FILL MATERIAL

- A. Bedding and Fill: As specified in Section 312000 "Earthwork"

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Verify that trench cut, or excavation base is ready to receive work, excavations, dimensions and elevations are as indicated on drawings.
- B. Beginning of installation means acceptance of existing conditions.
- C. Verify that existing invert elevations on site will allow proper tie in to new work with proper positive slope. Ascertain accuracy prior to trenching and installation of sanitary sewer system.

3.2 PREPARATION

- A. Hand trim excavations to required elevations. Correct over excavation with approved fill material.
- B. Remove large stones or other hard matter that could damage sewer pipe or impede consistent backfilling or compaction.

3.3 INSTALLATION - PIPE

- A. Prior to commencing Work, Contractor shall pothole existing utilities at points of connection and verify the joining invert shown on plan. Notify Architect in event of discrepancies.

- B. Install pipe, fittings and accessories in accordance with Section 306, SSPWC and manufacturer's instructions. Seal joints watertight.
- C. Concrete Pipe and Fittings: Install according to ACPA "Concrete Pipe Handbook". Provide the following seals:
 - 1. Round Pipe and Fittings: ASTM C443 (ASTM C443M), rubber gaskets.
 - 2. Elliptical Pipe: ASTM C877 (ASTM C877M), Type I, sealing bands.
 - 3. Arch Pipe: ASTM C877 (ASTM C877M), Type I, sealing bands.
- D. All below grade piping consisting of ferrous metals shall be given a high-quality protective coating, such as 18-mil plastic tape, extruded polyethylene, coal-tar enamel, or Portland cement mortar. Below-grade metals should be electrically insulated (isolated) from above-grade metals by means of dielectric fittings in ferrous utilities and/or exposed metal structures breaking grade.
- E. Place pipe on bedding as specified in Section 312000.
- F. Lay pipe to slope gradient noted on Drawings with maximum variation from true slope of 1/8 inch in 10 feet.
- G. Do not displace or damage pipe when compacting.
- H. Connect to site sewer outlet system through installed sleeves.
- I. Do not cover joints until lines have been tested and approved.

3.4 INSTALLATION - CLEANOUTS

- A. Form bottom of excavation clean and smooth to correct elevation.
- B. Establish elevations and pipe inverts.
- C. Mount lid and frame level in grout secured to top cone section to elevation indicated.

3.5 PROTECTION

- A. Protect pipe cover from damage or displacement until backfilling operation is in progress.

3.6 TESTING

- A. After installation, test each sanitary drain and/or sewer and each section between successive manholes for either infiltration or exfiltration. Test shall be conducted in accordance with Section 306 - Underground Conduit Construction of the Standard Specifications for Public Works Construction.

- B. Where excessive ground water is encountered test the pipeline for infiltration.
- C. When infiltration or exfiltration exceeds allowable amounts as set forth in the Section 306 formula, perform repairs or replacements as necessary to comply with the required limits.

END OF SECTION