



Industrial Hygiene • Air Quality • Lead & Asbestos • Training • Health & Safety

LIMITED ASBESTOS INSPECTION REPORT

Conducted at:

ENCINITA ELEMENTARY SCHOOL
PAINTING PROJECT
4515 ENCINITA AVENUE
ROSEMEAD, CALIFORNIA 91770

Prepared for:

MR. HAROLD SULLINS
ASSISTANT SUPERINTENDENT
ROSEMEAD SCHOOL DISTRICT
3907 ROSEMEAD BOULEVARD, SUITE 220
ROSEMEAD, CALIFORNIA 91770

Prepared by:

EXECUTIVE ENVIRONMENTAL
310 EAST FOOTHILL BOULEVARD, SUITE 200
ARCADIA, CALIFORNIA 91006

Project Number EE 20-Z0046-0027
February 26, 2020

Report assembled by:

Yesenia G. Galeana
Technical Report Writer
Executive Environmental

Report generated/reviewed by:

Tim Galeana, CAC# 98-2470
Senior Project Manager
Executive Environmental

TABLE OF CONTENTS

- I. EXECUTIVE SUMMARY
- II. SAMPLING METHODOLOGY
- III. SAMPLE ANALYSIS
- IV. FINDINGS
- V. CONCLUSIONS/RECOMMENDATIONS
- VI. DISCLAIMER/REPORT LIMITATIONS

APPENDICES

APPENDIX A – LABORATORY ANALYSIS REPORT

APPENDIX B – SAMPLE/ACM LOCATIONS DRAWING

LIMITED ASBESTOS INSPECTION REPORT

Project Number: EE 20-Z0046-0027

Client: Rosemead School District
3907 Rosemead Boulevard, Suite 220
Rosemead, California 91770

Site Location: Encinita Elementary School
Exterior Painting Project
4515 Encinita Avenue
Rosemead, California 91770

Site Use: School Property

Contact Person: Mr. Harold Sullins
Assistant Superintendent
Phone: (626) 312-2900

Inspection Date: February 6 and 7, 2020

Inspected By: Mr. Rhys Kuzmic
Certified Asbestos Consultant, # 09-4586

Report Assembled By: Ms. Yesenia G. Galeana
Technical Report Writer

Report Generated/Reviewed By: Mr. Tim Galeana
Certified Asbestos Consultant, # 98-2470

I. EXECUTIVE SUMMARY

Executive Environmental (EE) provided the services of a Certified Asbestos Consultant to conduct a limited asbestos inspection of the permanent buildings, portables and covered walkways at Encinita Elementary School located at 4515 Encinita Avenue, Rosemead, California. The inspection was conducted as a precursor to the upcoming exterior painting project. Materials suspected of containing asbestos were sampled and analyzed for the presence of asbestos. No Asbestos-Containing Materials (ACM) were identified during this inspection. *This is considered to be a limited inspection. Inspection was limited to exterior materials anticipated to be impacted by the exterior painting project.*

II. SAMPLING METHODOLOGY

A visual inspection of the exterior of the permanent buildings, portables and covered walkways at Encinita Elementary School was conducted prior to the collection of any bulk samples. The visual inspection was conducted to identify and record the location and condition of the materials to be sampled. Following the visual inspection, bulk material samples of the identified suspect asbestos-containing building materials were

collected. The materials were categorized into homogeneous groupings, and each sample was assigned a unique sample number and placed into a sealed container.

Upon completion of the bulk sample collection, a chain of custody was prepared and the samples were delivered to the laboratory for analysis. AmeriSci of Carson, CA, analyzed the samples using Polarized Light Microscopy (PLM). AmeriSci is an accredited participant in the National Voluntary Laboratory Accreditation Program (NVLAP), No. 200346-0. The principles described in the current Environmental Protection Agency (EPA) 600 method were used in the preparation and analysis of the bulk samples.

Note: Inaccessible suspect asbestos materials may be located within sealed ceilings, walls, or floors; or within wall cavities, interstitials, shafts, etc. Suspect asbestos materials located in these areas must be sampled prior to any activities that might cause them to be disturbed.

III. SAMPLE ANALYSIS

Fifty-seven (57) samples were collected during this inspection. The laboratory analysis results are identified in the following table. Materials determined not to contain asbestos are listed as "No Asbestos Detected" (NAD).

Any material found to contain more than 1% of a known asbestos substance is considered to be an asbestos-containing material (ACM). Materials falling within this category are controlled and must be handled in accordance with the California Occupational Safety & Health Administration (Cal/OSHA), EPA, and South Coast Air Quality Management District (SCAQMD) regulations.

In addition, materials which are characterized as non-ACM by EPA or other local regulatory agencies may fall within the regulatory standards of Cal/OSHA, which further regulates any materials found to contain more than 1/10 of 1%, but 1% or less, of a known asbestos substance as asbestos-containing construction materials (ACCMs). Impacting or handling ACCMs requires special employer registration, documentation, training, and personal protective equipment. When a material is to be impacted, the National Emission Standards for Hazardous Air Pollutants (NESHAPs) regulations require further testing for materials that fall within this category.

The PLM analytical protocol requires each layer of the sample to be analyzed separately. The quantity of analyses will vary based on the number of layers in a sample and whether a "positive stop" is employed. When one sample of a homogeneous area is positive, the remainder of the samples need not be analyzed because the entire homogeneous area must be considered positive.

**Sampling results begin on the next page.
The remainder of this page is blank.**

POLARIZED LIGHT MICROSCOPY (PLM) ANALYSIS DATA

Encinita Elementary School
4515 Encinita Avenue
Rosemead, California 91770

Homogeneous Material #	Material Description	Material Location	Estimated Quantity	Condition ^A	Type ^B	Friable	Percent Damaged	Sample Number	Sample Location	Analytical Results
Building A (Administration Building) ^C										
1	Stucco	Throughout exterior walls	2,500 Square Feet	G	Surf.	No	0	2002060027RK-01	North wall, east end	NAD ^D
								2002060027RK-02	West wall	NAD
								2002060027RK-03	South wall, west end	NAD
								2002060027RK-04	West wall, south end	NAD
								2002060027RK-05	South wall, east end	NAD
Building B (Classrooms 1 thru 3/Restroom) ^E										
2	Stucco	Throughout exterior walls and breezeway ceiling	2,500 Square Feet	G	Surf.	No	0	2002060027RK-06	South wall, east end	NAD
								2002060027RK-07	West wall	NAD
								2002060027RK-08	Breezeway ceiling	NAD
								2002060027RK-09	West wall of Student restroom	NAD
								2002060027RK-10	East wall	NAD

Note: This table must be used in conjunction with the entire report. This document is not to be used for contract bidding and is intended to be used to identify asbestos-containing materials and their locations only.

- ^A G = Good; D = Damaged; SD = Severely Damaged
^B Misc. = Miscellaneous; Surf. = Surfacing; TSI = Thermal System Insulation
^C NOTE: 1) No window putty.
^D NAD = No Asbestos Detected.
^E NOTE: 1) No window putty.

Executive Environmental
Limited Asbestos Inspection Report

Encinita ES – Exterior Painting Project
Project Number EE 20-Z0046-0027
February 26, 2020

POLARIZED LIGHT MICROSCOPY (PLM) ANALYSIS DATA

Encinita Elementary School
4515 Encinita Avenue
Rosemead, California 91770

Homogeneous Material #	Material Description	Material Location	Estimated Quantity	Condition ^F	Type ^G	Friable	Percent Damaged	Sample Number	Sample Location	Analytical Results
Building C (Multi-Purpose Building)^H										
3	Stucco	Throughout exterior walls and overhangs	5,000 Square Feet	G	Surf.	No	0	2002060027RK-11	Northeast overhang ceiling	NAD ^I
								2002060027RK-12	East wall of Kitchen	NAD
								2002060027RK-13	East upper wall at roof	NAD
								2002060027RK-14	South wall near southeast entry	NAD
								2002060027RK-15	South wall	NAD
								2002060027RK-16	West wall, south end	NAD
								2002060027RK-17	West wall, north end	NAD
Building D (Classrooms 4 thru 6)^J										
4	Stucco	Throughout exterior walls	2,000 Square Feet	G	Surf.	No	0	2002060027RK-18	East wall, south end	NAD
								2002060027RK-19	South wall	NAD
								2002060027RK-20	West wall, south end	NAD
								2002060027RK-21	North wall, west end	NAD
								2002060027RK-22	East wall	NAD

Note: This table must be used in conjunction with the entire report. This document is not to be used for contract bidding and is intended to be used to identify asbestos-containing materials and their locations only.

^F G = Good; D = Damaged; SD = Severely Damaged
^G Misc. = Miscellaneous; Surf. = Surfacing; TSI = Thermal System Insulation
^H NOTE: 1) No window putty.
^I NAD = No Asbestos Detected.
^J NOTE: 1) No window putty.

POLARIZED LIGHT MICROSCOPY (PLM) ANALYSIS DATA

Encinita Elementary School
4515 Encinita Avenue
Rosemead, California 91770

Homogeneous Material #	Material Description	Material Location	Estimated Quantity	Condition ^K	Type ^L	Friable	Percent Damaged	Sample Number	Sample Location	Analytical Results
Building E (Classrooms 7 thru 10/Restroom) ^M										
5	Stucco	Throughout exterior walls and Breezeway ceilings	2,500 Square Feet	G	Surf.	No	0	2002060027RK-23	East wall, north end	NAD ^N
								2002060027RK-24	South wall	NAD
								2002060027RK-25	West wall of Student restroom	NAD
								2002060027RK-26	Breezeway ceiling, northwest	NAD
								2002060027RK-27	North wall, west end	NAD
Building F (Classrooms 11 thru 14) ^O										
6	Stucco	Throughout exterior walls	2,000 Square Feet	G	Surf.	No	0	2002070027RK-28	East wall, north end	NAD
								2002070027RK-29	South wall, east end	NAD
								2002070027RK-30	South wall	NAD
								2002070027RK-31	West wall, south end	NAD
								2002070027RK-32	North wall, west end	NAD

Note: This table must be used in conjunction with the entire report. This document is not to be used for contract bidding and is intended to be used to identify asbestos-containing materials and their locations only.

- ^K G = Good; D = Damaged; SD = Severely Damaged
^L Misc. = Miscellaneous; Surf. = Surfacing; TSI = Thermal System Insulation
^M NOTE: 1) No window putty.
^N NAD = No Asbestos Detected.
^O NOTE: 1) No window putty.

Executive Environmental
Limited Asbestos Inspection Report

Encinita ES – Exterior Painting Project
Project Number EE 20-Z0046-0027
February 26, 2020

POLARIZED LIGHT MICROSCOPY (PLM) ANALYSIS DATA

Encinita Elementary School
4515 Encinita Avenue
Rosemead, California 91770

Homogeneous Material #	Material Description	Material Location	Estimated Quantity	Condition ^P	Type ^Q	Friable	Percent Damaged	Sample Number	Sample Location	Analytical Results
Building G (Classrooms 15 thru 18/Restroom) ^R										
7	Stucco	Throughout exterior walls and Breezeway ceilings	2,500 Square Feet	G	Surf.	No	0	2002070027RK-33	East wall, north end	NAD ^S
								2002070027RK-34	South wall, east end	NAD
								2002070027RK-35	West wall of Student restroom	NAD
								2002070027RK-36	Breezeway ceiling, southeast	NAD
								2002070027RK-37	West wall of Room, 18, north end	NAD
Building H (Classrooms 19 thru 20)										
8	Stucco	Throughout exterior walls	1,500 Square Feet	G	Surf.	No	0	2002070027RK-38	South wall, west end	NAD
								2002070027RK-39	West wall, south end	NAD
								2002070027RK-40	West	NAD
								2002070027RK-41	North wall, west end	NAD
9	Window putty	Throughout exterior windows	330 Linear Feet	G	Misc.	No	<1	2002070027RK-42	East wall, north end	NAD
								2002070027RK-43	West	NAD
								2002070027RK-44	West wall, south end	NAD
								2002070027RK-45	North	NAD

Note: This table must be used in conjunction with the entire report. This document is not to be used for contract bidding and is intended to be used to identify asbestos-containing materials and their locations only.

^P G = Good; D = Damaged; SD = Severely Damaged
^Q Misc. = Miscellaneous; Surf. = Surfacing; TSI = Thermal System Insulation
^R NOTE: 1) No window putty.
^S NAD = No Asbestos Detected.

Executive Environmental
Limited Asbestos Inspection Report

Encinita ES – Exterior Painting Project
Project Number EE 20-Z0046-0027
February 26, 2020

POLARIZED LIGHT MICROSCOPY (PLM) ANALYSIS DATA

Encinita Elementary School
4515 Encinita Avenue
Rosemead, California 91770

Homogeneous Material #	Material Description	Material Location	Estimated Quantity	Condition ^T	Type ^U	Friable	Percent Damaged	Sample Number	Sample Location	Analytical Results
Staff Restroom Building ^V										
9	Stucco	Throughout exterior walls and overhangs	700 Square Feet	G	Surf.	No	0	2002070027RK-46	West	NAD ^W
								2002070027RK-47	North	NAD
								2002070027RK-48	Overhang, southeast	NAD
Covered Walkways ^X										
10	Stucco	Covered walkway no. 2 ceilings	450 Square Feet	G	Surf.	No	0	2002070027RK-49	Northwest	NAD
								2002070027RK-50	West	NAD
								2002070027RK-51	Southwest	NAD
10	Stucco	Covered walkway no. 3 ceilings	900 Square Feet	G	Surf.	No	0	2002070027RK-52	Northwest	NAD
								2002070027RK-53	West	NAD
								2002070027RK-54	Southwest	NAD
11	Stucco	Covered walkway no. 9 ceilings	470 Square Feet	G	Surf.	No	0	2002070027RK-55	Southwest	NAD
								2002070027RK-56	South	NAD
								2002070027RK-57	Southeast	NAD
Portables ^Y										
No suspect asbestos-containing materials were identified on the exterior walls or windows of the Portables P21, P22, P23, P24, P25, P26, P27, P28, P29, P30 and P40.										

Note: This table must be used in conjunction with the entire report. This document is not to be used for contract bidding and is intended to be used to identify asbestos-containing materials and their locations only

^T G = Good; D = Damaged; SD = Severely Damaged

^U Misc. = Miscellaneous; Surf. = Surfacing; TSI = Thermal System Insulation

^V NOTE: 1) No window putty.

^W NAD = No Asbestos Detected.

^X NOTE: 1) Covered walkways no. 1, 4, 5, 6, 7, 8 and 10 have wood ceilings and metal poles.

^Y NOTE: 1) Portables P21, P22, P23, P24, P25, P26, P27, P28, P29, P30 and P40 have exterior wood walls and no window putty.

Executive Environmental
Limited Asbestos Inspection Report

Encinita ES – Exterior Painting Project
Project Number EE 20-Z0046-0027
February 26, 2020

IV. FINDINGS

EE conducted a limited asbestos inspection of the permanent buildings, portables and covered walkways at Encinita Elementary School located at 4515 Encinita Avenue, Rosemead, California.

Eleven (11) homogeneous material groups were identified during the visual property inspection. Fifty-seven (57) samples of suspect asbestos-containing materials were collected and delivered to AmeriSci of Carson, for analysis. The homogeneous area and sampling results are listed on the table in Section III.

The analytical data revealed that the sampled materials do not contain asbestos.

V. CONCLUSIONS/RECOMMENDATIONS

No asbestos-containing materials were identified during this inspection. Activities involving the inspected materials may proceed as normal construction actions. If suspect asbestos materials that were not sampled are to be disturbed, additional sampling will be required

If you have any questions, please call Mr. Tim Galeana at 626-441-7050. We are glad we could be of service to you.

VI. DISCLAIMER/REPORT LIMITATIONS

All reports and recommendations are based on conditions and practices observed and information made available to Executive Environmental (EE) by the client and the designated sites/facilities on the days sampling was conducted. This report does not purport to set forth all hazards, nor to indicate that other hazards do not exist. No responsibility is assumed by EE for the control or correction of conditions or practices existing at the facilities, or at any other premises surveyed by EE, for and on the behalf of the client. Services provided by EE shall be governed by the standard of practice for professional services measured at the time those services are rendered.

All information contained in this report is proprietary and limited to the scope of services, parameters of the analytical methods used and the conditions present at the time of this inspection. Any references to quantities are considered estimates and are not to be construed as actual.

APPENDIX A – LABORATORY ANALYSIS REPORT



Please Reply To:

AmeriSci Los Angeles

24416 S. Main Street, Ste 308
Carson, California 90745
TEL: (310) 834-4868 • FAX: (310) 834-4772

FACSIMILE TELECOPY TRANSMISSION

To: Yesenia Galeana Executive Environmental Services Corporation	From: Wesene Sebhat
Fax #:	AmeriSci Job #: 920021185
	Subject: PLM 5 day Results
Email: info@execenv.com,ygaleana@execenv.com	Client Project: 20-Z0046-0027; A Administration, B Classroom Bldg Rooms 1-3, C MPR, D Classroom

Date: Saturday, February 15, 2020

Time: 07:22:20

Comments:

Number of Pages:

22
(including cover sheet)

CONFIDENTIALITY NOTICE: Unless otherwise indicated, the information contained in this communication is confidential information intended for use of the individual named above. If the reader of this communication is not the intended recipient, you are hereby notified that any dissemination, distribution or copying of this communication is prohibited. If you have received this communication in error, please immediately notify the sender by telephone and return the original message to the above address via the US Postal Service at our expense. Samples are disposed of in 60 days or unless otherwise instructed by the protocol or special instructions in writing. Thank you.

Certified Analysis Service 24 Hours A Day • 7 Days A Week Competitive Prices
visit our web site - www.amerisci.com

Boston • Los Angeles • New York • Richmond

**AmeriSci Los Angeles**

24416 S. Main Street, Ste 308

Carson, California 90745

TEL: (310) 834-4868 • FAX: (310) 834-4772

PLM Bulk Asbestos Report

Executive Environmental Services Corp
Attn: Yesenia Galeana
310 East Foothill Blvd.
Suite 200
Arcadia, CA 91006

Date Received 02/10/20 **AmeriSci Job #** 920021185
Date Examined 02/13/20 **P.O. #**
Page 1 **of** 10

RE: 20-Z0046-0027; A Administration, B Classroom Bldg Rooms 1-3, C MPR, D Classroom Bldg Rooms 4-6, E Classroom Bldg Rooms 7-10, F Classroom Bldg Rooms 11-14, G Classroom Bldg Rooms 15-18, H Classroom Bldg Rooms 19-20, Staff Restroom Bldg, Covered Walkways

Client No. / HGA	Lab No.	Asbestos Present	Total % Asbestos
2002060027RK-01	920021185-01	No	NAD
Location: Exterior, North Wall - East End / Exterior Stucco / To Exterior Walls			(by CVES) by Wesene Sebhat on 02/13/20
Analyst Description: Grey/White, Heterogeneous, Non-Fibrous, Cementitious, Stucco			
Asbestos Types:			
Other Material: Non-fibrous 100 %			
2002060027RK-02	920021185-02	No	NAD
Location: Exterior, West Wall / Exterior Stucco			(by CVES) by Wesene Sebhat on 02/13/20
Analyst Description: Off-White, Heterogeneous, Non-Fibrous, Cementitious, Stucco			
Asbestos Types:			
Other Material: Non-fibrous 100 %			
2002060027RK-03	920021185-03	No	NAD
Location: Exterior, South Wall-West End / Exterior Stucco			(by CVES) by Wesene Sebhat on 02/13/20
Analyst Description: Off-White, Heterogeneous, Non-Fibrous, Cementitious, Stucco			
Asbestos Types:			
Other Material: Non-fibrous 100 %			
2002060027RK-04	920021185-04	No	NAD
Location: Exterior, West Wall-South End			(by CVES) by Wesene Sebhat on 02/13/20
Analyst Description: Off-White, Heterogeneous, Non-Fibrous, Cementitious, Stucco			
Asbestos Types:			
Other Material: Non-fibrous 100 %			
2002060027RK-05	920021185-05	No	NAD
Location: Exterior, South Wall-East End			(by CVES) by Wesene Sebhat on 02/13/20
Analyst Description: Off-White, Heterogeneous, Non-Fibrous, Cementitious, Stucco			
Asbestos Types:			
Other Material: Non-fibrous 100 %			

PLM Bulk Asbestos Report

20-Z0046-0027; A Administration, B Classroom Bldg Rooms
1-3, C MPR, D Classroom Bldg Rooms 4-6, E Classroom Bldg
Rooms 7-10, F Classroom Bldg Rooms 11-14, G Classroom
Bldg Rooms 15-18, H Classroom Bldg Rooms 19-20, Staff
Restroom Bldg, Covered Walkways

Client No. / HGA	Lab No.	Asbestos Present	Total % Asbestos
2002060027RK-06	920021185-06	No	NAD
Location: Exterior, South Wall-East End / Exterior Stucco / T-O Exterior Walls And Breezeway Ceiling			(by CVES) by Wesene Sebhat on 02/13/20
Analyst Description: Grey/White, Heterogeneous, Non-Fibrous, Cementitious, Stucco			
Asbestos Types:			
Other Material: Non-fibrous 100 %			
2002060027RK-07	920021185-07	No	NAD
Location: Exterior, West Wall / Exterior Stucco			(by CVES) by Wesene Sebhat on 02/13/20
Analyst Description: Grey, Heterogeneous, Non-Fibrous, Cementitious, Stucco			
Asbestos Types:			
Other Material: Non-fibrous 100 %			
2002060027RK-08	920021185-08	No	NAD
Location: Exterior, Breezeway Ceiling / Exterior Stucco			(by CVES) by Wesene Sebhat on 02/13/20
Analyst Description: Off-White, Heterogeneous, Non-Fibrous, Cementitious, Stucco			
Asbestos Types:			
Other Material: Non-fibrous 100 %			
2002060027RK-09	920021185-09	No	NAD
Location: Exterior, West Wall Of Student Restroom / Exterior Stucco			(by CVES) by Wesene Sebhat on 02/13/20
Analyst Description: Grey/White, Heterogeneous, Non-Fibrous, Cementitious, Stucco			
Asbestos Types:			
Other Material: Non-fibrous 100 %			
2002060027RK-10	920021185-10	No	NAD
Location: Exterior, East Wall / Exterior Stucco			(by CVES) by Wesene Sebhat on 02/13/20
Analyst Description: Grey/White, Heterogeneous, Non-Fibrous, Cementitious, Stucco			
Asbestos Types:			
Other Material: Non-fibrous 100 %			
2002060027RK-11	920021185-11	No	NAD
Location: Exterior, NE Overhang Ceiling / Exterior Stucco / T-O Exterior Walls And Overhangs			(by CVES) by Wesene Sebhat on 02/13/20
Analyst Description: Grey/White, Heterogeneous, Non-Fibrous, Cementitious, Stucco			
Asbestos Types:			
Other Material: Non-fibrous 100 %			

Client Name: Executive Environmental Services Corporation

PLM Bulk Asbestos Report

20-Z0046-0027; A Administration, B Classroom Bldg Rooms
1-3, C MPR, D Classroom Bldg Rooms 4-6, E Classroom Bldg
Rooms 7-10, F Classroom Bldg Rooms 11-14, G Classroom
Bldg Rooms 15-18, H Classroom Bldg Rooms 19-20, Staff
Restroom Bldg, Covered Walkways

Client No. / HGA	Lab No.	Asbestos Present	Total % Asbestos
2002060027RK-12	920021185-12	No	NAD
Location: Exterior, East Wall Of Kitchen / Exterior Stucco			(by CVES) by Wesene Sebhat on 02/13/20
Analyst Description: Grey/White, Heterogeneous, Non-Fibrous, Cementitious, Stucco			
Asbestos Types:			
Other Material: Non-fibrous 100 %			
2002060027RK-13	920021185-13	No	NAD
Location: Exterior, East Upper Wall At Roof / Exterior Stucco			(by CVES) by Wesene Sebhat on 02/13/20
Analyst Description: Grey/White, Heterogeneous, Non-Fibrous, Cementitious, Stucco			
Asbestos Types:			
Other Material: Non-fibrous 100 %			
2002060027RK-14	920021185-14	No	NAD
Location: Exterior, South Wall Near SE Entry			(by CVES) by Wesene Sebhat on 02/13/20
Analyst Description: Grey/White, Heterogeneous, Non-Fibrous, Cementitious, Stucco			
Asbestos Types:			
Other Material: Non-fibrous 100 %			
2002060027RK-15	920021185-15	No	NAD
Location: Exterior, South Wall / Exterior Stucco			(by CVES) by Wesene Sebhat on 02/13/20
Analyst Description: Grey/White, Heterogeneous, Non-Fibrous, Cementitious, Stucco			
Asbestos Types:			
Other Material: Non-fibrous 100 %			
2002060027RK-16	920021185-16	No	NAD
Location: Exterior, West Wall-South End / Exterior Stucco			(by CVES) by Wesene Sebhat on 02/13/20
Analyst Description: Grey/White, Heterogeneous, Non-Fibrous, Cementitious, Stucco			
Asbestos Types:			
Other Material: Non-fibrous 100 %			
2002060027RK-17	920021185-17	No	NAD
Location: Exterior, West Wall-North End			(by CVES) by Wesene Sebhat on 02/13/20
Analyst Description: White, Heterogeneous, Non-Fibrous, Stucco			
Asbestos Types:			
Other Material: Non-fibrous 100 %			

Client Name: Executive Environmental Services Corporation

PLM Bulk Asbestos Report

20-Z0046-0027; A Administration, B Classroom Bldg Rooms
1-3, C MPR, D Classroom Bldg Rooms 4-6, E Classroom Bldg
Rooms 7-10, F Classroom Bldg Rooms 11-14, G Classroom
Bldg Rooms 15-18, H Classroom Bldg Rooms 19-20, Staff
Restroom Bldg, Covered Walkways

Client No. / HGA	Lab No.	Asbestos Present	Total % Asbestos
2002060027RK-18	920021185-18	No	NAD
Location: Exterior, East Wall-South End / Exterior Stucco/ T-O Exterior			(by CVES) by Kristina Martinez on 02/14/20
Analyst Description: White/Grey, Heterogeneous, Non-Fibrous, Cementitious, Stucco			
Asbestos Types:			
Other Material: Non-fibrous 100 %			
2002060027RK-19	920021185-19	No	NAD
Location: Exterior, South Wall / Exterior Stucco			(by CVES) by Kristina Martinez on 02/14/20
Analyst Description: White/Grey, Heterogeneous, Non-Fibrous, Cementitious, Stucco			
Asbestos Types:			
Other Material: Non-fibrous 100 %			
2002060027RK-20	920021185-20	No	NAD
Location: Exterior, West Wall-South End / Exterior Stucco			(by CVES) by Kristina Martinez on 02/14/20
Analyst Description: Grey, Heterogeneous, Non-Fibrous, Cementitious, Stucco			
Asbestos Types:			
Other Material: Non-fibrous 100 %			
2002060027RK-21	920021185-21	No	NAD
Location: Exterior, North Wall-West End / Exterior Stucco			(by CVES) by Kristina Martinez on 02/14/20
Analyst Description: Grey, Heterogeneous, Non-Fibrous, Cementitious, Stucco			
Asbestos Types:			
Other Material: Non-fibrous 100 %			
2002060027RK-22	920021185-22	No	NAD
Location: Exterior, East Wall / Exterior Stucco			(by CVES) by Kristina Martinez on 02/14/20
Analyst Description: Grey, Heterogeneous, Non-Fibrous, Cementitious, Stucco			
Asbestos Types:			
Other Material: Non-fibrous 100 %			
2002060027RK-23	920021185-23	No	NAD
Location: Exterior, East Wall-North End / Exterior Stucco / T-O Exterior Walls And Breezeway Ceiling			(by CVES) by Kristina Martinez on 02/14/20
Analyst Description: Grey, Heterogeneous, Non-Fibrous, Cementitious, Stucco			
Asbestos Types:			
Other Material: Non-fibrous 100 %			

PLM Bulk Asbestos Report

20-Z0046-0027; A Administration, B Classroom Bldg Rooms
1-3, C MPR, D Classroom Bldg Rooms 4-6, E Classroom Bldg
Rooms 7-10, F Classroom Bldg Rooms 11-14, G Classroom
Bldg Rooms 15-18, H Classroom Bldg Rooms 19-20, Staff
Restroom Bldg, Covered Walkways

Client No. / HGA	Lab No.	Asbestos Present	Total % Asbestos
2002060027RK-24	920021185-24	No	NAD
Location: Exterior, South Wall / Exterior Stucco			(by CVES) by Kristina Martinez on 02/14/20
Analyst Description: Grey, Heterogeneous, Non-Fibrous, Cementitious, Stucco			
Asbestos Types:			
Other Material: Non-fibrous 100 %			
2002060027RK-25	920021185-25	No	NAD
Location: Exterior, West Wall-South End / Exterior Stucco			(by CVES) by Kristina Martinez on 02/14/20
Analyst Description: Grey, Heterogeneous, Non-Fibrous, Cementitious, Stucco			
Asbestos Types:			
Other Material: Non-fibrous 100 %			
2002060027RK-26	920021185-26	No	NAD
Location: Exterior, Breezeway Ceiling, NW / Exterior Stucco			(by CVES) by Kristina Martinez on 02/14/20
Analyst Description: Grey, Heterogeneous, Non-Fibrous, Cementitious, Stucco			
Asbestos Types:			
Other Material: Non-fibrous 100 %			
2002060027RK-27	920021185-27	No	NAD
Location: Exterior, North Wall-West End / Exterior Stucco			(by CVES) by Kristina Martinez on 02/14/20
Analyst Description: Grey, Heterogeneous, Non-Fibrous, Cementitious, Stucco			
Asbestos Types:			
Other Material: Non-fibrous 100 %			
2002070027RK-28	920021185-28	No	NAD
Location: Exterior, East Wall-North End / Exterior Stucco / T-O Exterior Walls			(by CVES) by Arturo A. Aldana on 02/15/20
Analyst Description: Grey, Heterogeneous, Non-Fibrous, Cementitious, Stucco			
Asbestos Types:			
Other Material: Non-fibrous 100 %			
2002070027RK-29	920021185-29	No	NAD
Location: Exterior, South Wall- East End / Exterior Stucco			(by CVES) by Arturo A. Aldana on 02/15/20
Analyst Description: Grey, Heterogeneous, Non-Fibrous, Cementitious, Stucco			
Asbestos Types:			
Other Material: Non-fibrous 100 %			

Client Name: Executive Environmental Services Corporation

PLM Bulk Asbestos Report

20-Z0046-0027; A Administration, B Classroom Bldg Rooms
1-3, C MPR, D Classroom Bldg Rooms 4-6, E Classroom Bldg
Rooms 7-10, F Classroom Bldg Rooms 11-14, G Classroom
Bldg Rooms 15-18, H Classroom Bldg Rooms 19-20, Staff
Restroom Bldg, Covered Walkways

Client No. / HGA	Lab No.	Asbestos Present	Total % Asbestos
2002070027RK-30	920021185-30	No	NAD
Location: Exterior, South Wall / Exterior Stucco			(by CVES) by Arturo A. Aldana on 02/15/20
Analyst Description: Grey, Heterogeneous, Non-Fibrous, Cementitious, Stucco			
Asbestos Types:			
Other Material: Non-fibrous 100 %			
2002070027RK-31	920021185-31	No	NAD
Location: Exterior, West Wall- South End / Exterior Stucco			(by CVES) by Arturo A. Aldana on 02/15/20
Analyst Description: Grey, Heterogeneous, Non-Fibrous, Cementitious, Stucco			
Asbestos Types:			
Other Material: Non-fibrous 100 %			
2002070027RK-32	920021185-32	No	NAD
Location: Exterior, North Wall-West End / Exterior Stucco			(by CVES) by Arturo A. Aldana on 02/15/20
Analyst Description: Off-White, Heterogeneous, Non-Fibrous, Cementitious, Stucco			
Asbestos Types:			
Other Material: Non-fibrous 100 %			
2002070027RK-33	920021185-33	No	NAD
Location: Exterior, East Wall-North End / Exterior Stucco / T-O Exterior Walls And Breezway Ceiling			(by CVES) by Arturo A. Aldana on 02/15/20
Analyst Description: Grey, Heterogeneous, Non-Fibrous, Cementitious, Stucco			
Asbestos Types:			
Other Material: Non-fibrous 100 %			
2002070027RK-34	920021185-34	No	NAD
Location: Exterior, South Wall-East / Exterior Stucco			(by CVES) by Arturo A. Aldana on 02/15/20
Analyst Description: Grey, Heterogeneous, Non-Fibrous, Cementitious, Stucco			
Asbestos Types:			
Other Material: Non-fibrous 100 %			
2002070027RK-35	920021185-35	No	NAD
Location: Exterior, West Wall Of Student Restroom / Exterior Stucco			(by CVES) by Arturo A. Aldana on 02/15/20
Analyst Description: White/Grey, Heterogeneous, Non-Fibrous, Cementitious, Stucco			
Asbestos Types:			
Other Material: Non-fibrous 100 %			

Client Name: Executive Environmental Services Corporation

PLM Bulk Asbestos Report

20-Z0046-0027; A Administration, B Classroom Bldg Rooms
1-3, C MPR, D Classroom Bldg Rooms 4-6, E Classroom Bldg
Rooms 7-10, F Classroom Bldg Rooms 11-14, G Classroom
Bldg Rooms 15-18, H Classroom Bldg Rooms 19-20, Staff
Restroom Bldg, Covered Walkways

Client No. / HGA	Lab No.	Asbestos Present	Total % Asbestos
2002070027RK-36	920021185-36	No	NAD
Location: Exterior Breezeway Ceiling, SE / Exterior Stucco			(by CVES) by Arturo A. Aldana on 02/15/20
Analyst Description: White/Grey, Heterogeneous, Non-Fibrous, Cementitious, Stucco			
Asbestos Types:			
Other Material: Non-fibrous 100 %			
2002070027RK-37	920021185-37	No	NAD
Location: Exterior, West Wall Of Room 18-North End / Exterior Stucco			(by CVES) by Arturo A. Aldana on 02/15/20
Analyst Description: Grey, Heterogeneous, Non-Fibrous, Cementitious, Stucco			
Asbestos Types:			
Other Material: Non-fibrous 100 %			
2002070027RK-38	920021185-38	No	NAD
Location: Exterior, South Wall-West End / Exterior Stucco / T-O Exterior Walls			(by CVES) by Arturo A. Aldana on 02/15/20
Analyst Description: Grey, Heterogeneous, Non-Fibrous, Cementitious, Stucco			
Asbestos Types:			
Other Material: Non-fibrous 100 %			
2002070027RK-39	920021185-39	No	NAD
Location: Exterior, West Wall-South End / Exterior Stucco			(by CVES) by Arturo A. Aldana on 02/15/20
Analyst Description: Grey, Heterogeneous, Non-Fibrous, Cementitious, Stucco			
Asbestos Types:			
Other Material: Non-fibrous 100 %			
2002070027RK-40	920021185-40	No	NAD
Location: Exterior, West Wall / Exterior Stucco			(by CVES) by Arturo A. Aldana on 02/15/20
Analyst Description: Grey, Heterogeneous, Non-Fibrous, Cementitious, Stucco			
Asbestos Types:			
Other Material: Non-fibrous 100 %			
2002070027RK-41	920021185-41	No	NAD
Location: Exterior, North Wall-West End / Exterior Stucco			(by CVES) by Arturo A. Aldana on 02/15/20
Analyst Description: Grey, Heterogeneous, Non-Fibrous, Cementitious, Stucco			
Asbestos Types:			
Other Material: Non-fibrous 100 %			

Client Name: Executive Environmental Services Corporation

PLM Bulk Asbestos Report

20-Z0046-0027; A Administration, B Classroom Bldg Rooms
1-3, C MPR, D Classroom Bldg Rooms 4-6, E Classroom Bldg
Rooms 7-10, F Classroom Bldg Rooms 11-14, G Classroom
Bldg Rooms 15-18, H Classroom Bldg Rooms 19-20, Staff
Restroom Bldg, Covered Walkways

Client No. / HGA	Lab No.	Asbestos Present	Total % Asbestos
2002070027RK-42	920021185-42	No	NAD
Location: Exterior, East Wall-North End / Exterior Stucco			(by CVES) by Arturo A. Aldana on 02/15/20
Analyst Description: Grey, Heterogeneous, Non-Fibrous, Cementitious, Stucco			
Asbestos Types:			
Other Material: Non-fibrous 100 %			
2002070027RK-43	920021185-43	No	NAD
Location: Exterior, West Wall / Exterior Window Putty / T-O Exterior Windows			(by CVES) by Arturo A. Aldana on 02/15/20
Analyst Description: White, Homogeneous, Non-Fibrous, Window Putty			
Asbestos Types:			
Other Material: Non-fibrous 100 %			
2002070027RK-44	920021185-44	No	NAD
Location: Exterior, West Wall-South End / Exterior Window Putty / T-O Exterior Windows			(by CVES) by Arturo A. Aldana on 02/15/20
Analyst Description: White, Homogeneous, Non-Fibrous, Window Putty			
Asbestos Types:			
Other Material: Non-fibrous 100 %			
2002070027RK-45	920021185-45	No	NAD
Location: Exterior, North Wall / Exterior Window Putty			(by CVES) by Arturo A. Aldana on 02/15/20
Analyst Description: Beige, Homogeneous, Non-Fibrous, Window Putty			
Asbestos Types:			
Other Material: Non-fibrous 100 %			
2002070027RK-46	920021185-46	No	NAD
Location: Exterior, West Wall / Exterior Stucco / T-O Exterior Walls And Overhang			(by CVES) by Arturo A. Aldana on 02/15/20
Analyst Description: White/Grey, Heterogeneous, Non-Fibrous, Cementitious, Stucco			
Asbestos Types:			
Other Material: Non-fibrous 100 %			
2002070027RK-47	920021185-47	No	NAD
Location: Exterior, North Wall / Exterior Stucco			(by CVES) by Arturo A. Aldana on 02/15/20
Analyst Description: White/Grey, Heterogeneous, Non-Fibrous, Cementitious, Stucco			
Asbestos Types:			
Other Material: Non-fibrous 100 %			

Client Name: Executive Environmental Services Corporation

PLM Bulk Asbestos Report

20-Z0046-0027; A Administration, B Classroom Bldg Rooms
1-3, C MPR, D Classroom Bldg Rooms 4-6, E Classroom Bldg
Rooms 7-10, F Classroom Bldg Rooms 11-14, G Classroom
Bldg Rooms 15-18, H Classroom Bldg Rooms 19-20, Staff
Restroom Bldg, Covered Walkways

Client No. / HGA	Lab No.	Asbestos Present	Total % Asbestos
2002070027RK-48	920021185-48	No	NAD
Location: Exterior Overhang, SE / Exterior Stucco			(by CVES) by Arturo A. Aldana on 02/15/20
Analyst Description: White/Grey, Heterogeneous, Non-Fibrous, Cementitious, Stucco			
Asbestos Types:			
Other Material: Non-fibrous 100 %			
2002070027RK-49	920021185-49	No	NAD
Location: Covered Walkway 2 Ceiling, NW / Exterior Stucco / Covered Walkway 2 Ceiling			(by CVES) by Arturo A. Aldana on 02/15/20
Analyst Description: Green/Grey, Heterogeneous, Non-Fibrous, Cementitious, Stucco			
Asbestos Types:			
Other Material: Non-fibrous 100 %			
2002070027RK-50	920021185-50	No	NAD
Location: Covered Walkway 2 Ceiling, West / Exterior Stucco			(by CVES) by Arturo A. Aldana on 02/15/20
Analyst Description: Green/Grey, Heterogeneous, Non-Fibrous, Cementitious, Stucco			
Asbestos Types:			
Other Material: Non-fibrous 100 %			
2002070027RK-51	920021185-51	No	NAD
Location: Covered Walkway 2 Ceiling, SW / Exterior Stucco			(by CVES) by Arturo A. Aldana on 02/15/20
Analyst Description: Green/Grey, Heterogeneous, Non-Fibrous, Cementitious, Stucco			
Asbestos Types:			
Other Material: Non-fibrous 100 %			
2002070027RK-52	920021185-52	No	NAD
Location: Covered Walkway 3 Ceiling, NW / Exterior Stucco			(by CVES) by Arturo A. Aldana on 02/15/20
Analyst Description: Green/Grey, Heterogeneous, Non-Fibrous, Cementitious, Stucco			
Asbestos Types:			
Other Material: Non-fibrous 100 %			
2002070027RK-53	920021185-53	No	NAD
Location: Covered Walkway 3 Ceiling, West / Exterior Stucco			(by CVES) by Arturo A. Aldana on 02/15/20
Analyst Description: Green/Grey, Heterogeneous, Non-Fibrous, Cementitious, Stucco			
Asbestos Types:			
Other Material: Non-fibrous 100 %			

Client Name: Executive Environmental Services Corporation

PLM Bulk Asbestos Report

20-Z0046-0027; A Administration, B Classroom Bldg Rooms
1-3, C MPR, D Classroom Bldg Rooms 4-6, E Classroom Bldg
Rooms 7-10, F Classroom Bldg Rooms 11-14, G Classroom
Bldg Rooms 15-18, H Classroom Bldg Rooms 19-20, Staff
Restroom Bldg, Covered Walkways

Client No. / HGA	Lab No.	Asbestos Present	Total % Asbestos
2002070027RK-54	920021185-54	No	NAD
Location: Covered Walkway 3 Ceiling, SW / Exterior Stucco			(by CVES) by Arturo A. Aldana on 02/15/20
Analyst Description: Grey, Heterogeneous, Non-Fibrous, Cementitious, Stucco			
Asbestos Types:			
Other Material: Non-fibrous 100 %			
2002070027RK-55	920021185-55	No	NAD
Location: Covered Walkway 9, SW / Exterior Stucco / Covered Walkway 9 Ceiling			(by CVES) by Arturo A. Aldana on 02/15/20
Analyst Description: White/Grey, Heterogeneous, Non-Fibrous, Cementitious, Stucco			
Asbestos Types:			
Other Material: Non-fibrous 100 %			
2002070027RK-56	920021185-56	No	NAD
Location: Covered Walkway 9, South / Exterior Stucco			(by CVES) by Arturo A. Aldana on 02/15/20
Analyst Description: Green/Grey, Heterogeneous, Non-Fibrous, Cementitious, Stucco			
Asbestos Types:			
Other Material: Non-fibrous 100 %			
2002070027RK-57	920021185-57	No	NAD
Location: Covered Walkway 9, SE / Exterior Stucco			(by CVES) by Arturo A. Aldana on 02/15/20
Analyst Description: White/Green/Grey, Heterogeneous, Non-Fibrous, Cementitious, Stucco			
Asbestos Types:			
Other Material: Non-fibrous 100 %			

Reporting Notes:Analyzed By: Wesene Sebat at aal; Date Analyzed: 2/13/2020 2/15/20

*NAD = no asbestos detected; Detection Limit <1%; Reporting Limits: CVES = 1%, 400 Pt Ct = 0.25%, 1000 Pt Ct = 0.1%; NA = not analyzed; NA/PS = not analyzed / positive stop; NVA = No Visible Asbestos; PLM (polarized light microscopy) Bulk Asbestos Analysis by EPA 600/R-93/116, including requirements for EPA 600/M4-82-020 per 40 CFR 763 (NVLAP Lab #200346-0); Note: PLM is not consistently reliable in detecting asbestos in floor coverings and similar NOB materials. TEM is currently the only method that can be used to determine if this material can be considered or treated as non-asbestos-containing in New York State (also see EPA Advisory for floor tile, FR 59, 146, 38970, 8/1/94). NIST Accreditation requirements mandate that this report must not be reproduced except in full with the approval of the laboratory. This PLM report relates ONLY to the items tested.

Reviewed By: at aal



**Industrial Hygiene Laboratory Submittal
Asbestos -- PLM**

Originating Office ☒ 310 E. Foothill Blvd., Suite 200 Arcadia, CA 91006 Phone: 626.441.7050 Fax: 626.441.0016	Lab Submitted to: ☒ AmeriSci ☐ EMLab (Glendale) ☐ LA Testing
--	--

☐ Routine (5 Working Days)	☐ RUSH (surcharges may apply) Circle 6 24 48 One hours hours hours	Project #: 20-Z0046-0027	Sampled by: Rhys Kuzmich	Site Zip Code: 91770	Sample Date: 02/06/2003	Page 1 of 14
--	---	-----------------------------	-----------------------------	-------------------------	----------------------------	--------------

The receiving Laboratory is required to complete the following:

1. All invoices are to be sent to: 310 E. Foothill Blvd., Suite 200, Arcadia, CA 91006 with a copy of the lab report.
2. Analyze all samples by PLM by EPA 600/R-93/116.
3. Stop analysis of homogeneous groups at first positive that is greater than or equal to 1.0%
4. All lab reports and invoices are to contain the Project Number from above.
5. Unsigned and reports marked draft are unacceptable.
6. Report to the attention of: Yesenia Galeana, Phone: (562) 889-1327

Building Name: Administration

☒ **Optional items to be completed by the laboratory (if check marked):**

☒ US Mail Report to: ☒ Originating office check marked above ☐ Other: ☐ Alternate billing address:

Sample No.:	Sample Location - Include Room information where appropriate	Material Description	Homogeneous Location	No.	Quantity	Percent Damaged
-01	Exterior, North Wall - east end	Exterior stucco	T-O exterior wall	1	2,500 sq	0
-02 *	Exterior, West wall					
-03	Exterior, South wall - west end					
-04	Exterior, West wall - south end					
-05	Exterior, South wall - east end					

Prefix: 2002060027RK

Notes:

[illegible]

920061185



Industrial Hygiene Laboratory Submittal
Asbestos -- PLM

Originating Office
☒ 310 E. Foothill Blvd., Suite 200
Arcadia, CA 91006
Phone: 626.441.7050
Fax: 626.441.0016

Lab Submitted to:
☒ AmeriSci
☐ EMLab (Glendale)
☐ LA Testing

☐ Routine (5 Days) ☐ RUSH (surcharges may apply) Circle 6 24 48 3 to 5 hours hours days

Project #: 20-Z0046-0027

Sampled by: Rhys Kuzmic

Site Zip Code: 91770

Sample Date: 02/06/2020

Page 3 of 41

Building Name: C MPR

The receiving Laboratory is required to complete the following:

1. All invoices to be sent to: 310 E. Foothill Blvd., Suite 200, Arcadia, CA 91006 with a copy of the lab report.
2. Analyze all samples by PLM by EPA 600/R-93/116.
3. Stop analysis of homogeneous groups at first positive that is greater than or equal to 1.0%

Optional Items to be completed by the laboratory (if check marked): ☒ Email Report to: info@execenv.com ☒ Other: vgaleana@execenv.com;
☒ US Mail Report to: ☒ Originating office check marked above ☐ Other: ☐ Alternate billing address:

Sample No.:	Sample Location - Include Room information where appropriate	Material Description	Homogeneous Location	No.	Quantity	Percent Damaged
-11	Exterior, NE overhang ceiling	Exterior stucco	To exterior walls and overhangs	3	5,000 SF	0
-12	Exterior, east wall of kitchen					
-13	Exterior, east wall of kitchen					
-14	Exterior, south wall near SE entry					
-15	Exterior, south wall					
-16	Exterior, west wall - south end					
-17	Exterior, west wall - north end					

Prefix: 2002060027RK

Notes:

Released By Date: 02/10/2020 11:06 AM
Received By Date: 02/10/2020 11:06 AM

Released By Date: 02/10/2020 11:06 AM
Received By Date: 02/10/2020 11:06 AM

Form: AL-006PLM



**Industrial Hygiene Laboratory Submittal
Asbestos -- PLM**

☒	☐	310 E. Foothill Blvd., Suite 200 Arcadia, CA 91006 Phone: 626.441.7050 Fax: 626.441.0016	☒ AmeriSci ☐ EMLab (Glendale) ☐ LA Testing
-------------------------------------	--------------------------	---	--

☐ Routine (5 Working Days)	☐ RUSH (surcharges may apply) Circle 6 24 48 One hours hours hours	Project #: 20-Z0046-0027	Sampled by: Rhys Kuzmich	Site Zip Code: 91770	Sample Date: 02/06/2020	Page 4 of 11
--	---	-----------------------------	-----------------------------	-------------------------	----------------------------	--------------

The receiving Laboratory is required to complete the following:

1. All invoices are to be sent to: 310 E. Foothill Blvd., Suite 200, Arcadia, CA 91006 with a copy of the lab report.
2. Analyze all samples by PLM by EPA 600/R-93/116.
3. Stop analysis of homogeneous groups at first positive that is greater than or equal to 1.0%
4. All lab reports and invoices are to contain the Project Number from above.
5. Unsigned and reports marked draft are unacceptable.
6. Report to the attention of: Yesenia Galeana, Phone: (562) 889-1327

Optional items to be completed by the laboratory (if check marked): ☒ Email Report to: ☒ Info@execenv.com
☒ Other: vgaleana@execenv.com

☒ US Mail Report to: ☒ Originating office check marked above ☐ Other: ☐ Alternate billing address:

Sample No.:	Sample Location - Include Room information where appropriate	Material Description	Homogeneous Location	No.	Quantity	Percent Damaged
-18	Exterior, east wall - south end	Exterior stucco	To exterior walls	4	2,000 SF	0
-19	Exterior, south wall					
-20	Exterior, west wall - south end					
-21	Exterior, north wall - west end					
-22*	Exterior, east wall					

Prefix: 2002060027Rk	
----------------------	--

Notes:

Released By: Date: & Time:	Received By: Date: & Time:	Released By: Date: & Time:
P. Jones 2/10/2011 11:00 AM 02/10/2011 11:00 AM		

Form: AL-006 (Rev. 11-01-00)



**Industrial Hygiene Laboratory Submittal
Asbestos -- PLM**

Originating Office	Lab Submitted to:
☒ 310 E. Foothill Blvd., Suite 200 Arcadia, CA 91006 Phone: 626.441.7050 Fax: 626.441.0016	☒ AmeriSci ☐ EMLab (Glendale) ☐ LA Testing

☐ Routine (5 Working Days)		☐ RUSH (surcharges may apply) Circle 6 24 48 hours One 3 to 5 days		Project #: 20-Z0046-0027	Sampled by: Rhys Kuzmic	Site Zip Code: 91770	Sample Date: 07/07/2020
Page 6 of 14							

The receiving Laboratory is required to complete the following:

1. All invoices are to be sent to: 310 E. Foothill Blvd., Suite 200, Arcadia, CA 91006 with a copy of the lab report.
2. Analyze all samples by PLM by EPA 600/R-93/116.
3. Stop analysis of homogeneous groups at first positive that is greater than or equal to 1.0%
4. All lab reports and invoices are to contain the Project Number from above.
5. Unsigned and reports marked draft are unacceptable.
6. Report to the attention of: Yesenia Galeana, Phone: (562) 889-1327

Building Name: F Classy H Bldg Rm 11-14

3. ☒ Group analysis of homogeneous groups at most per test result.

Optional items to be completed by the laboratory (if check marked): ☒ Email Report to: Info@execenv.com

☒ Other: vgaleana@execenv.com

☒ US Mail Report to: ☒ Originating office check marked above ☐ Other: ☐ Alternate billing address:


Sample No.:	Sample Location - Include Room Information where appropriate	Material Description	Homogeneous Location	No.	Quantity	Percent Damaged
-28	Exterior, east wall - north end	Exterior Stucco	TD exterior walls	6	2,000 SF	0
-29	Exterior, south wall - east end					
-30	Exterior, south wall					
-31	Exterior, west wall - south end					
-32*	Exterior, north wall - west end					

Prefix: 2002070027R1c

Notes:

Released By Date: & Time:	P. Jones	2/10/90	11:00
Received By Date: & Time:	R. K. W.	02/10/2020	11:00 AM

Form: AI-006P1 M



5817207.6

☒ 310 E. Foothill Blvd., Suite 200
Arcadia, CA 91006
Phone: 626.441.7050
Fax: 626.441.0016

☒	AmeriSci
☐	EMLab (Glendale)
☐	LA Testing

Sample Date:

☒ Other: vgaleana@execeniv.com;

☒ k marked):

Alternate billing address:

Prefix: 2002070027Rk

Released
By Date
& Time:

Form: AL-006PLM

920041185



Industrial Hygiene Laboratory Submittal
Asbestos -- PLM

Originating Office
☒ 310 E. Foothill Blvd., Suite 200
Arcadia, CA 91006
Phone: 626.441.7050
Fax: 626.441.0016

Lab Submitted to:
☒ AmeriSci
☐ EMLab (Glendale)
☐ LA Testing

☐ Routine (5 Days) ☐ RUSH (surcharges may apply) 3 to 5 days
Circle 6 24 48 hours hours hours

Project #: 20-Z0046-0027

Sampled by: Rhys Kuzmic

Site Zip Code: 91770

Sample Date: 02/07/2020

Pages of 11

Building Name: H Classroom Bldg Rooms 19-20

The receiving Laboratory is required to complete the following:

- All invoices are to be sent to: 310 E. Foothill Blvd., Suite 200, Arcadia, CA 91006 with a copy of the lab report.
- Analyze all samples by PLM by EPA 600/R-93/116.
- Stop analysis of homogeneous groups at first positive that is greater than or equal to 1.0%

Optional Items to be completed by the laboratory (if check marked): ☒ Email Report to: info@excecenv.com ☒ Other: vgaleana@excecenv.com

☒ US Mail Report to: ☒ Originating office check marked above ☐ Other: ☐ Alternate billing address:

Sample No.:	Sample Location - Include Room information where appropriate	Material Description	Homogeneous Location	No.	Quantity	Percent Damaged
-38 *	Exterior, South wall - west end	Exterior stucco	T-0 exterior walls	8	1,500 SF	0
-39	Exterior, West Wall - south end					
-40	Exterior, West Wall					
-41	Exterior, North Wall - West end					
-42	Exterior, east wall - north end					
-43	Exterior, West wall	Exterior window putty	T-0 exterior windows	9	330 LF	<1
-44	Exterior, West Wall - south end					
-45 *	Exterior, North wall					

Prefix: 2002070027RK

Notes:

Received By: Date: 02/07/2020 11:00 AM

Released By: Date: 2/10/2020 11:00 AM

Received By: Date: 2/10/2020 11:00 AM

Released By: Date: 2/10/2020 11:00 AM

 EXECUTIVE ENVIRONMENTAL HEALTH & SAFETY SIMPLIFIED		Industrial Hygiene Laboratory Submittal Asbestos -- PLM		Originating Office ☒ 310 E. Foothill Blvd., Suite 200 Arcadia, CA 91006 Phone: 626.441.7050 Fax: 626.441.0016		Lab Submitted to: ☒ AmeriSci ☐ EMLab (Glendale) ☐ LA Testing	
☐ Routine (5 Working Days)		☐ RUSH (surcharges may apply) Circle 6 24 48 hours One hours hours days		Project #: 20-Z0046-0027		Sampled by: Rhys Kuzmich	
		Site Zip Code: 91770		Sample Date: 02/07/2020		Page 9 of 11	
The receiving laboratory is required to complete the following:				Building Name: Staff Restroom Bldg			

1. All invoices are to be sent to: 310 E. Foothill Blvd., Suite 200, Arcadia, CA 91006 with a copy of the lab report.
2. Analyze all samples by PLM by EPA 600/R-93/116.
3. Stop analysis of homogeneous groups at first positive that is greater than or equal to 1.0%
4. All lab reports and invoices are to contain the Project Number from above.
5. Unsigned and reports marked draft are unacceptable.
6. Report to the attention of: Yesenia Galeana, Phone: (562) 889-1327

Optional items to be completed by the laboratory (if check marked): ☒ Info@excecenv.com ☒ Other: ygaleana@excecenv.com;
☒ US Mail Report to: ☒ Originating office check marked above ☐ Alternate billing address:
☒ US Mail Report to: ☐ Other:

[illegible]

Notes:		Received		Received	
By Date	& Time	By Date	& Time	By Date	& Time
Run Va	02/18/2020 11:00 AM			P. Jones	2/10/20 11:00

Form: AL-006PLM ©Copyright 2019 All Rights Reserved

9/2007 1185



Industrial Hygiene Laboratory Submittal
Asbestos -- PLM

Originating Office
☒ 310 E. Foothill Blvd., Suite 200
Arcadia, CA 91006
Phone: 626.441.7050
Fax: 626.441.0016

Lab Submitted to:
☒ AmeriSci
☐ EMLab (Glendale)
☐ LA Testing

☐ Routine (5 Days)
☐ RUSH (surcharges may apply)
Circle 6 24 48 hours hours hours days

Project #: 20-Z0046-0027

Sampled by: Rhys Kuzmick

Site Zip Code: 91770

Sample Date: 02/07/2000

Page 1 of 14

The receiving Laboratory is required to complete the following:

4. All lab reports and invoices are to contain the Project Number from above.
5. Unsigned and reports marked draft are unacceptable.
6. Report to the attention of: Yesenia Galeana, Phone: (562) 889-1327

Building Name: Covered Walkways

Optional Items to be completed by the laboratory (if check marked): ☒ Email Report to: Info@execenv.com ☒ Other: ygaleana@execenv.com

☒ US Mail Report to: ☒ Originating office check marked above ☐ Other: ☐ Alternate billing address:

Sample No.:	Sample Location - Include Room Information where appropriate	Material Description	Homogeneous Location	No.	Quantity	Percent Damaged
-49	Covered Walkway 2 ceiling, NW	Exterior studs	Covered Walkway 2 ceiling	11	450 SF	0
-50	Covered Walkway 2 ceiling, West	↓		↓	↓	↓
-51	Covered Walkway 2 ceiling, SW	↓		↓	↓	↓
-52	Covered Walkway 3 ceiling, NW	Exterior studs	Covered Walkway 3 ceiling	12	900 SF	0
-53	Covered Walkway 3 ceiling, West	↓		↓	↓	↓
-54	Covered Walkway 3 ceiling, SW	↓		↓	↓	↓

Prefix: 2002070027

Notes:

Received By Date & Time: 02/07/2000 11:00 AM

Received By Date & Time: 02/07/2000 11:00 AM

Released By Date & Time: 02/07/2000 11:00 AM

Form: AL-006PLM



**Industrial Hygiene Laboratory Submittal
Asbestos -- PLM**

Originating Office

☒ 310 E. Foothill Blvd., Suite 200
Arcadia, CA 91006
Phone: 626.441.7050
Fax: 626.441.0016

☒ AmerSci

☐ EMLab (Glendale)

☐ LA Testing

Lab Submitted to:

☐ Routine (5 Days)
☐ Rush (surcharges may apply) (3 to 5 days)

Project #:
20-Z0046-0027

Sampled by:
Rhys Kuzmich

Site Zip Code: 91770	Sample Date: 02/07/2020
--------------------------------	-----------------------------------

The receiving Laboratory is required to complete the following:

1. All invoices are to be sent to: 310 E. Foothill Blvd., Suite 200, Arcadia, CA 91006 with a copy of the lab report.
2. Analyze all samples by PLM by EPA 600/R-93/116.
3. Stop analysis of homogeneous groups at first positive that is greater than or equal to 1.0%
4. All lab reports and invoices are to contain the Project Number from above.
5. Unsigned and reports marked draft are unacceptable.
6. Report to the attention of: Yesenia Galeana, Phone: (562) 889-1327

Building Name: Covered Walkways

Optional items to be completed by the laboratory (if check marked): ☒ Email Report to: ☒ Info@execenv.com ☒ Other: ygalearna@execenv.com


☒ US Mail Report to: ☒ Originating office check marked above ☐ Other: ☐ Alternate billing address:

[illegible]

Notes:

[illegible]


APPENDIX B – SAMPLE/ACM LOCATIONS DRAWING

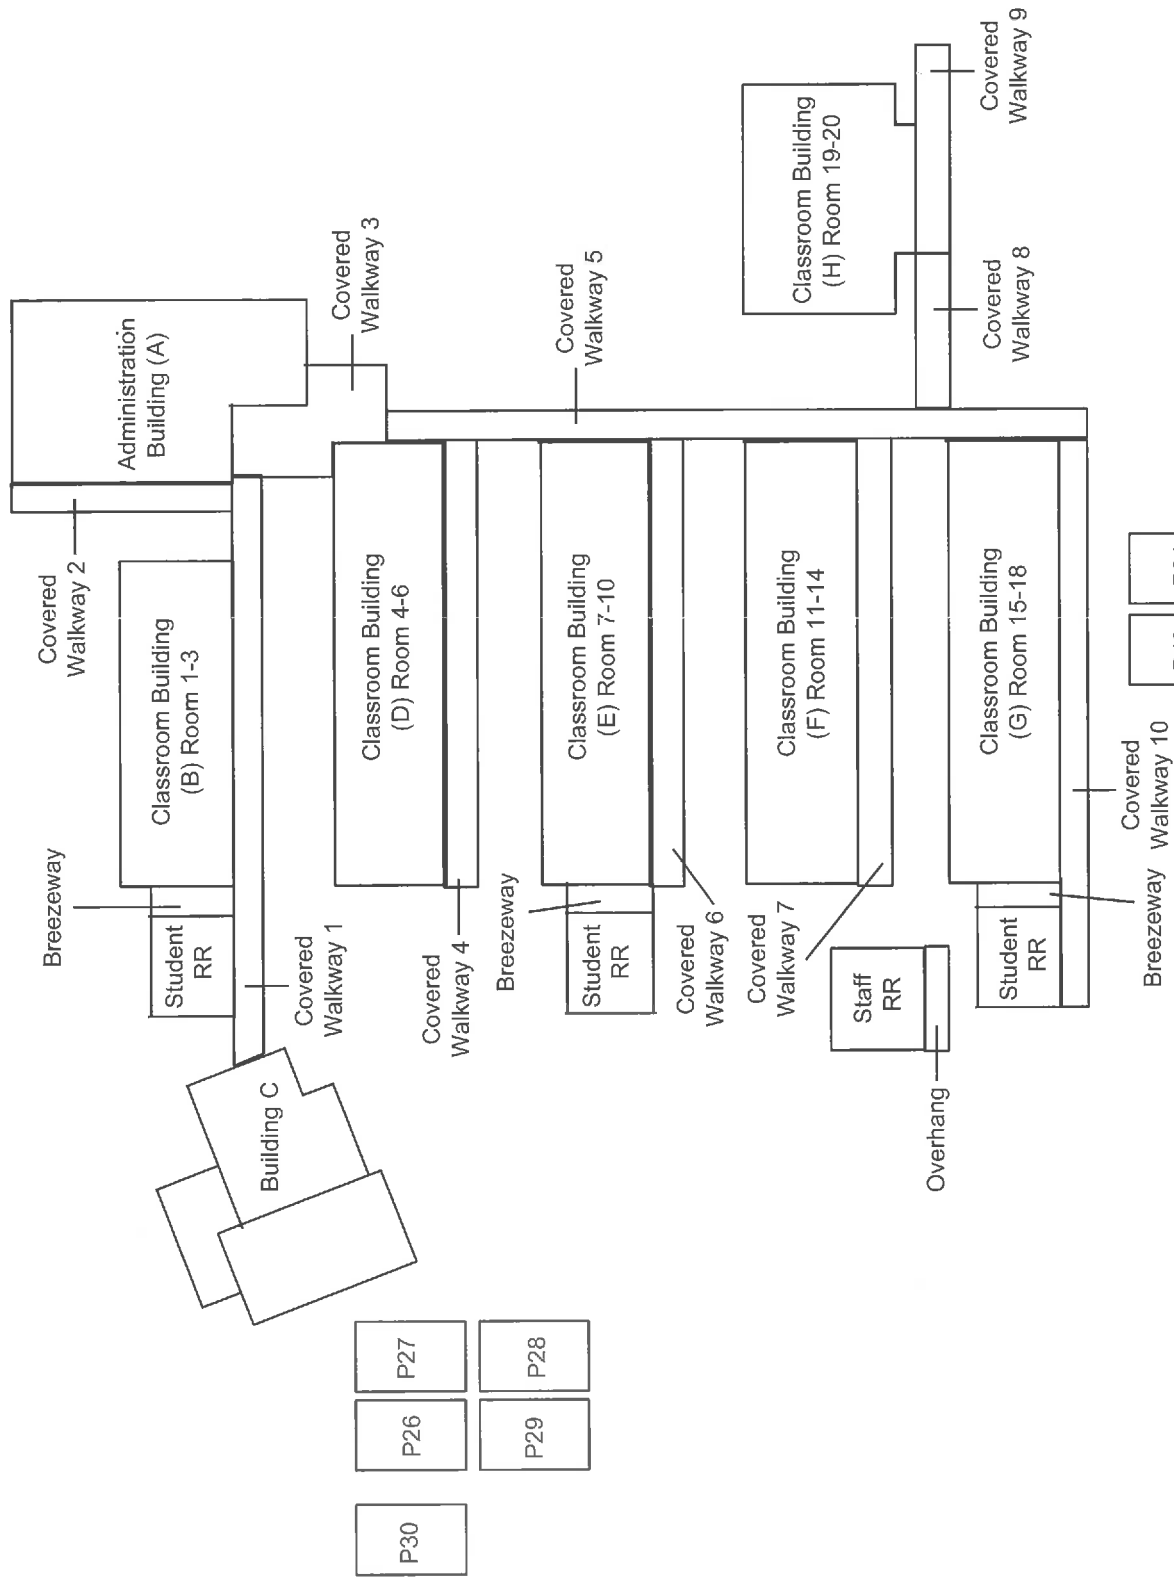

SIDE=D
SIDE=A
SIDE=C
SIDE=B

Client: Rosemead School District	Project #: 20-Z0046-0027	Info: Site Map
 EXECUTIVE ENVIRONMENTAL HEALTH & SAFETY SIMPLIFIED		
Site: Encinita Elementary School - Painting Project Address: 4515 Encinita Avenue Rosemead, California 91770		

Covered Walkway

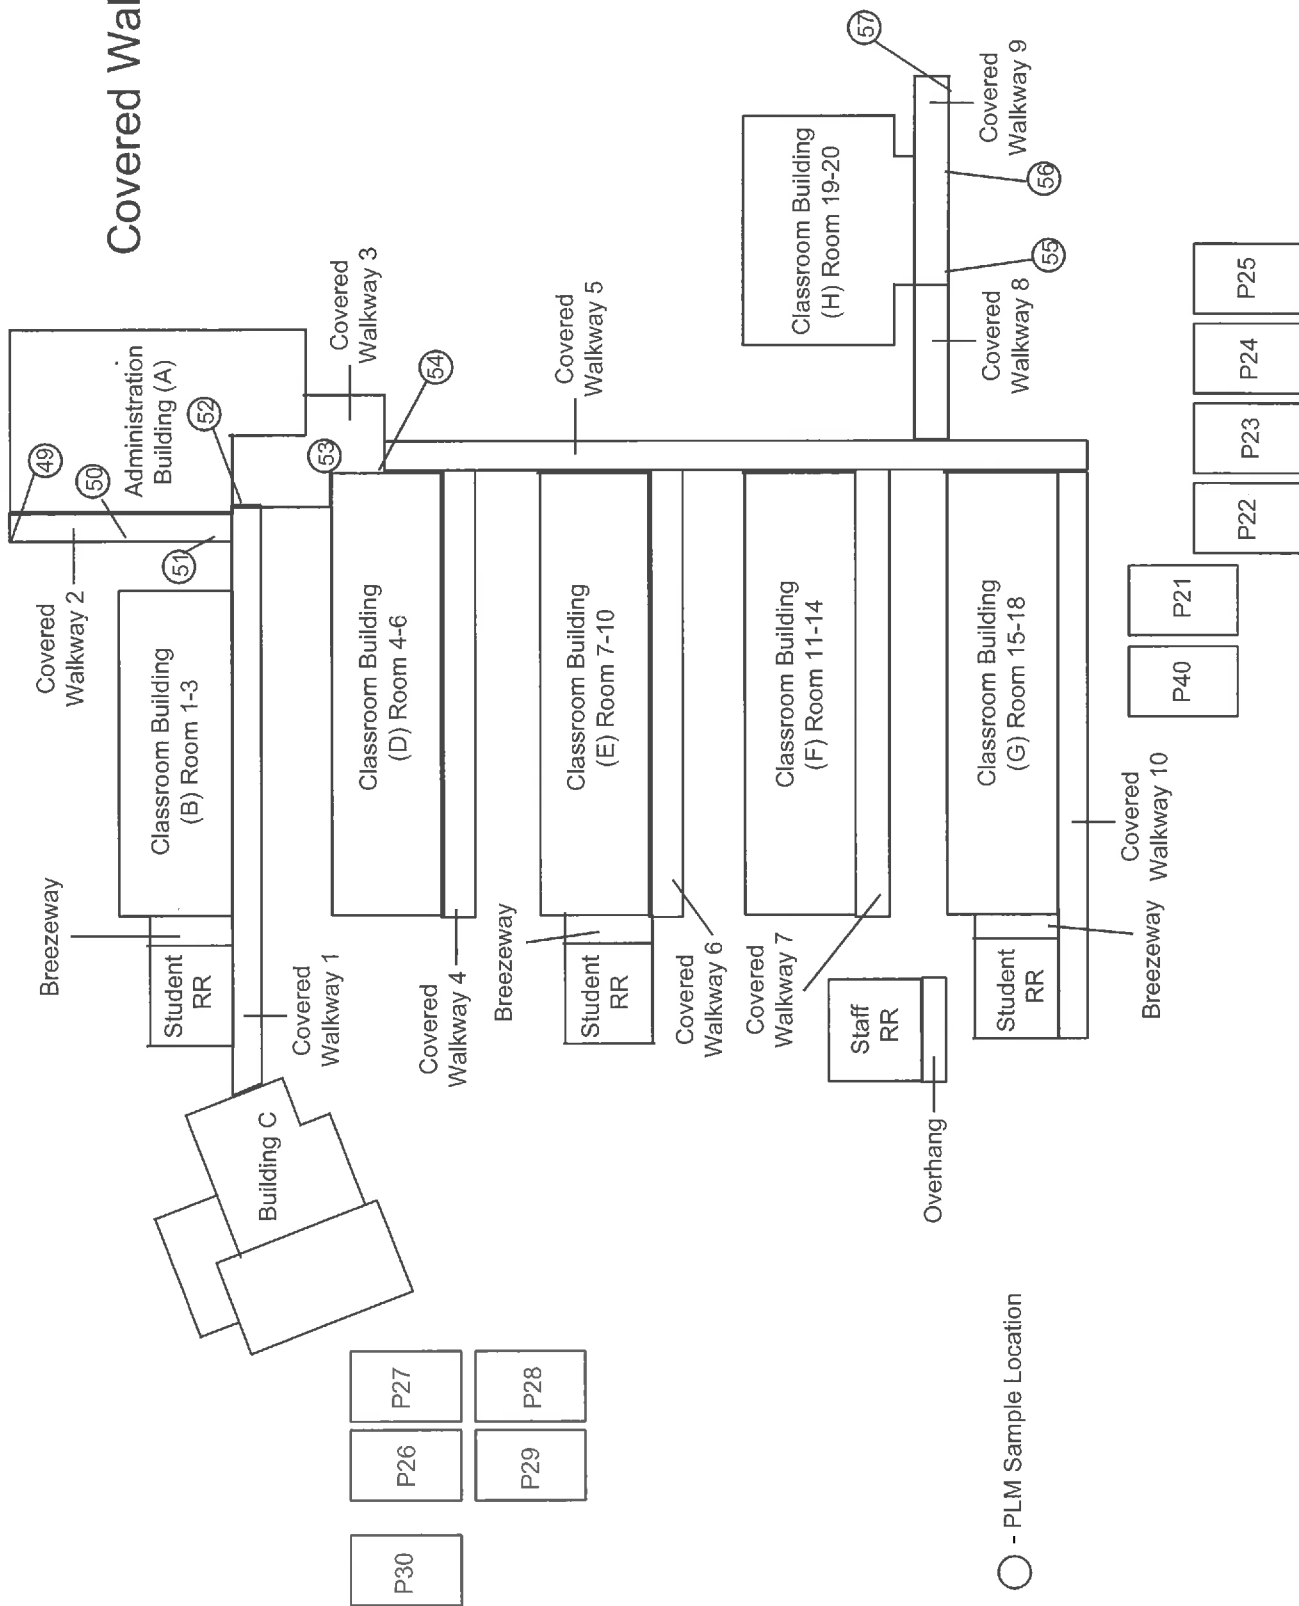


Client: Rosemead School District	Project #: 20-Z0046-0027	Info: PLM Sample Locations
Site: Encinita Elementary School - Painting Project Address: 4515 Encinita Avenue Rosemead, California 91770		



EXECUTIVE ENVIRONMENTAL
HEALTH & SAFETY SIMPLIFIED

Administration
Building (A)

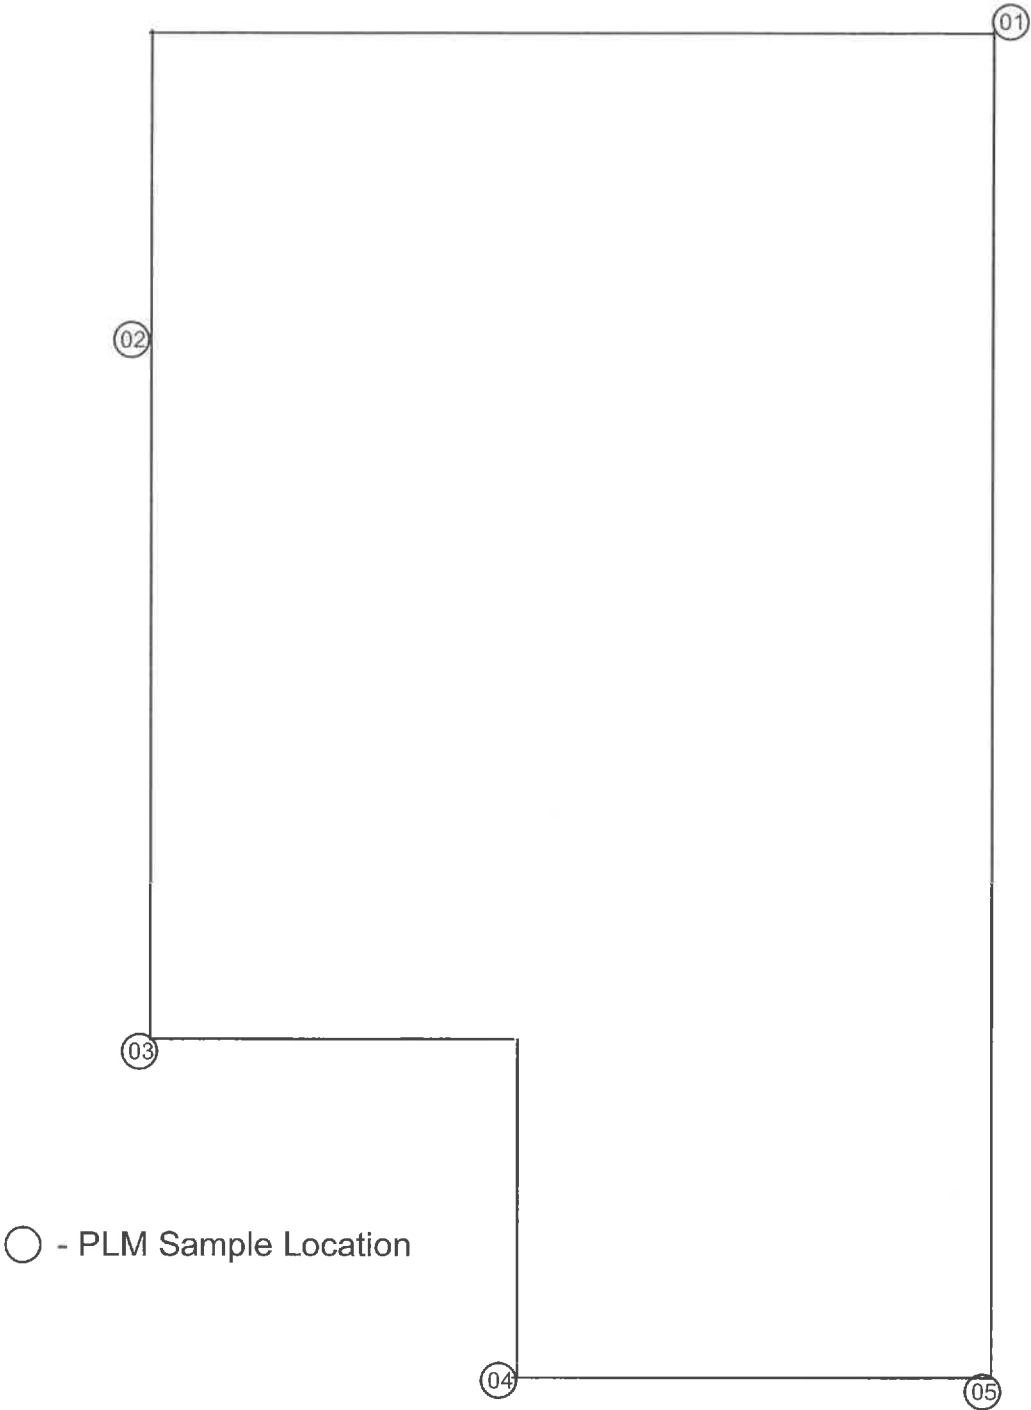

Client: Rosemead School District

Project#: 20-Z0046-0027

Info: PLM Sample Locations




EXECUTIVE ENVIRONMENTAL
HEALTH & SAFETY SIMPLIFIED

Site: Encinita Elementary School - Roofing Project
Address: 4515 Encinita Avenue
Rosemead, California 91770

Drawing Not to Scale - © 2012

Classroom Building (B) Room 1-3

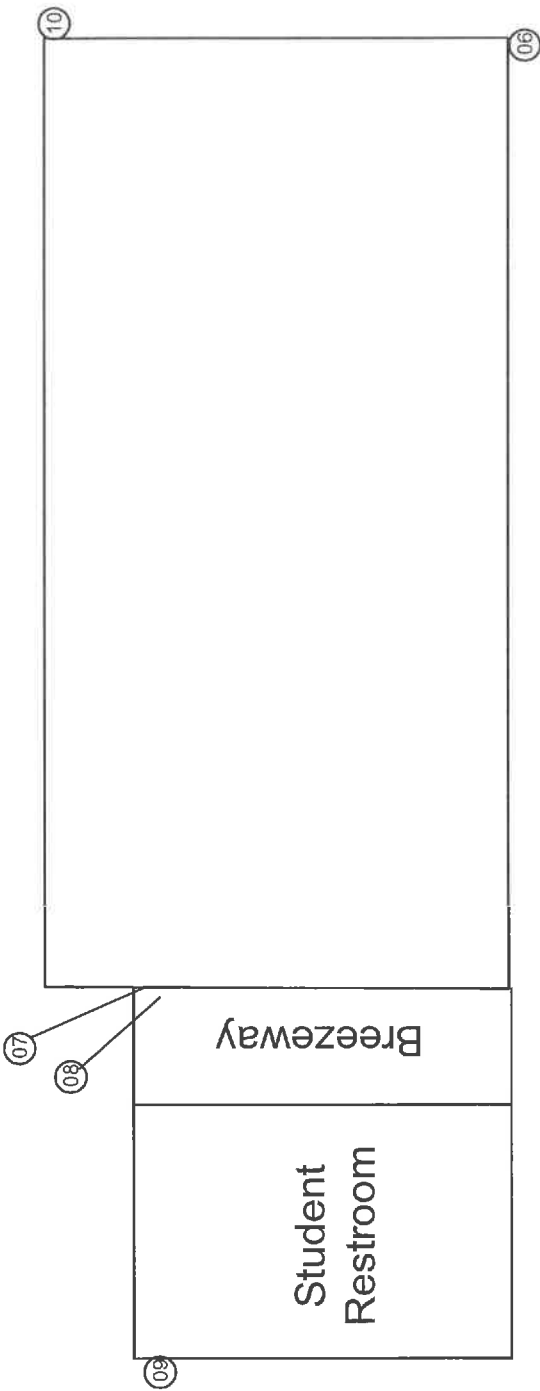


○ - PLM Sample Location



Client: Rosemead School District	Project #: 20-Z0046-0027	Info: PLM Sample Location
 EXECUTIVE ENVIRONMENTAL HEALTH & SAFETY SIMPLIFIED		
Site: Encinita Elementary School - Painting Project Address: 4515 Encinita Avenue Rosemead, California 91770		
Drawing Not to Scale - © 2012		

Building C (Multi-Purpose Building)

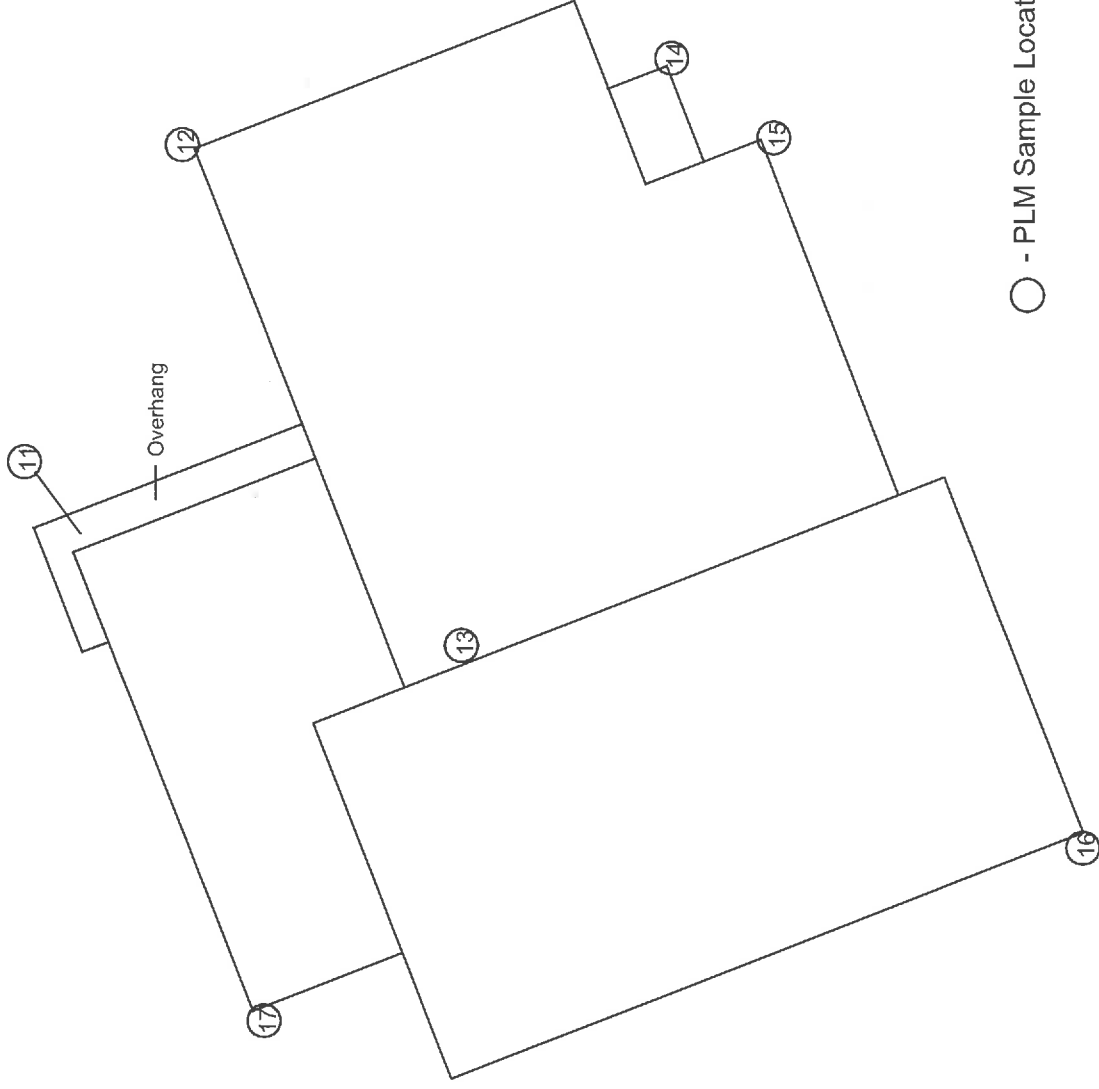


○ - PLM Sample Location



SIDE=D
SIDE=C
SIDE=B
SIDE=A



Client: Rosemead School District	Project #: 20-Z0046-0027	Info: PLM Sample Locations
		
EXECUTIVE ENVIRONMENTAL HEALTH & SAFETY SIMPLIFIED		
Site: Encinita Elementary School - Painting Project Address: 4515 Encinita Avenue Rosemead, California 91770		
Drawing Not to Scale - © 2012		

Classroom Building (D) Room 4-6

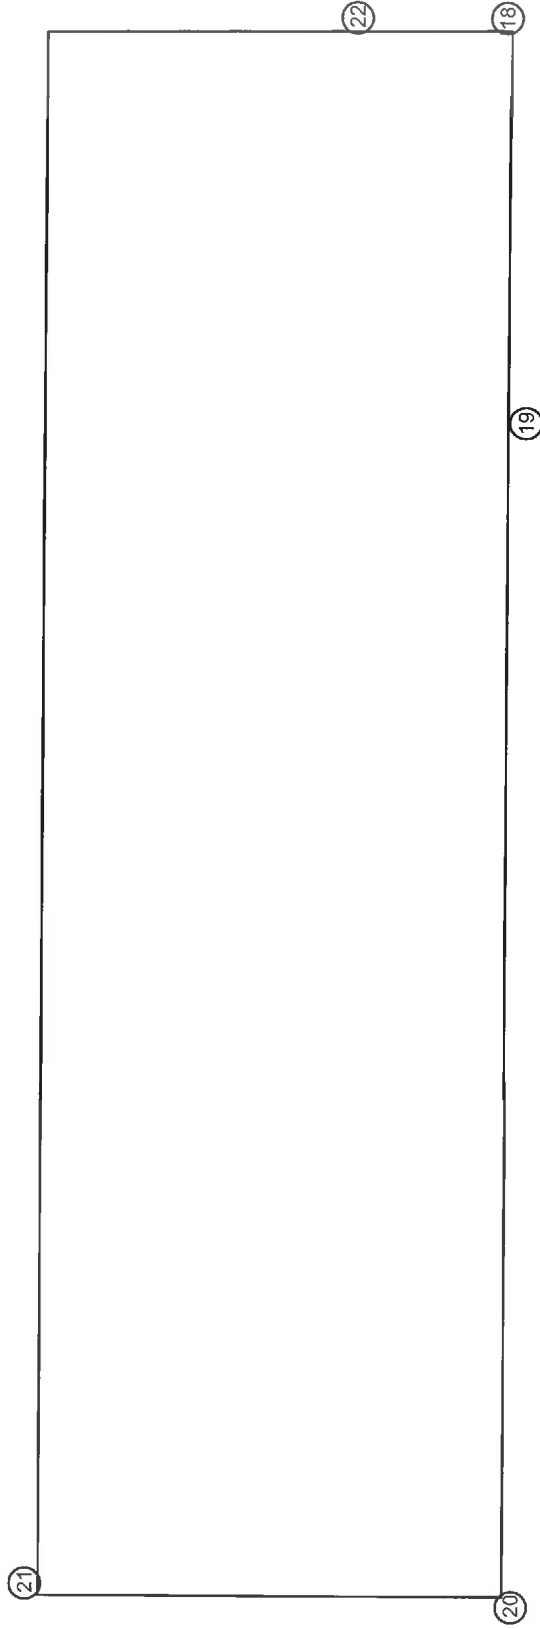

Client: Rosemead School District	Project #: 20-Z0046-0027	Info: PLM Sample Locations
 EXECUTIVE ENVIRONMENTAL HEALTH & SAFETY SIMPLIFIED Site: Encinita Elementary School - Painting Project Address: 4515 Encinita Avenue Rosemead, California 91770		

Classroom Building (E) Room 7-10

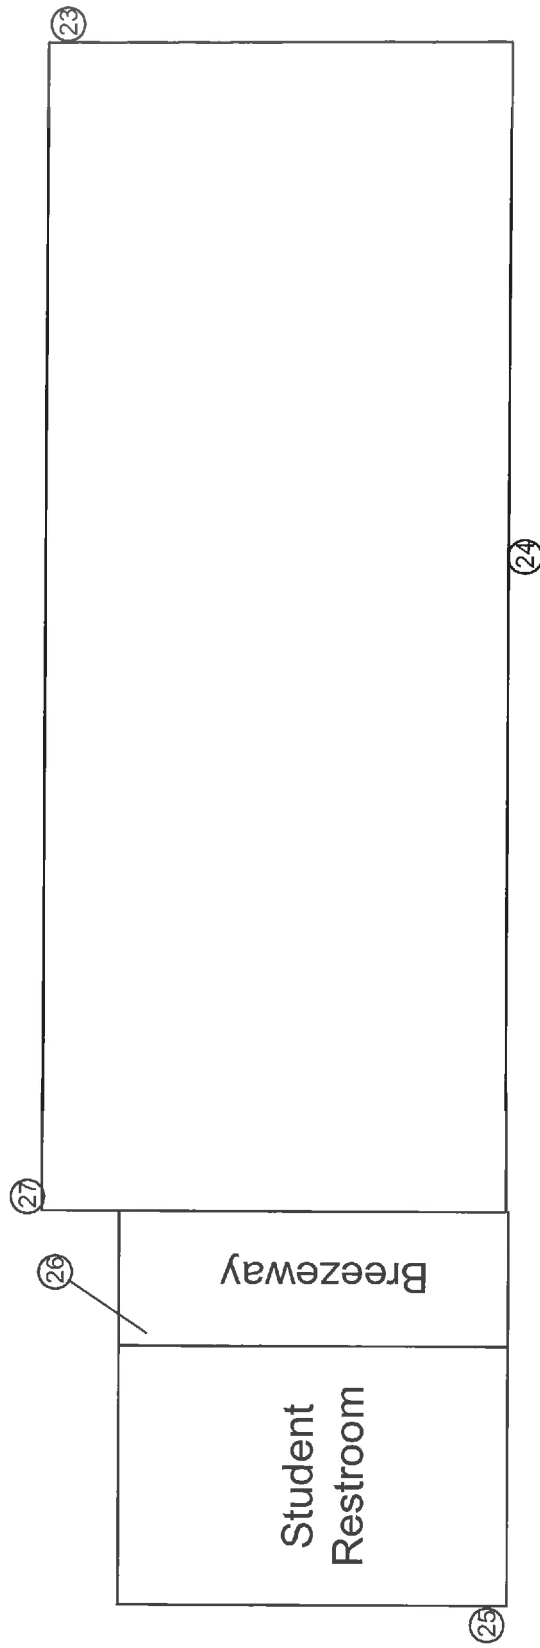


○ - PLM Sample Location



Client: Rosemead School District	Project #: 20-Z0046-0027	Info: PLM Sample Locations
Site: Encinita Elementary School - Painting Project Address: 4515 Encinita Avenue Rosemead, California 91770 Drawing Not to Scale - © 2012		


Classroom Building (F) Room 11-14

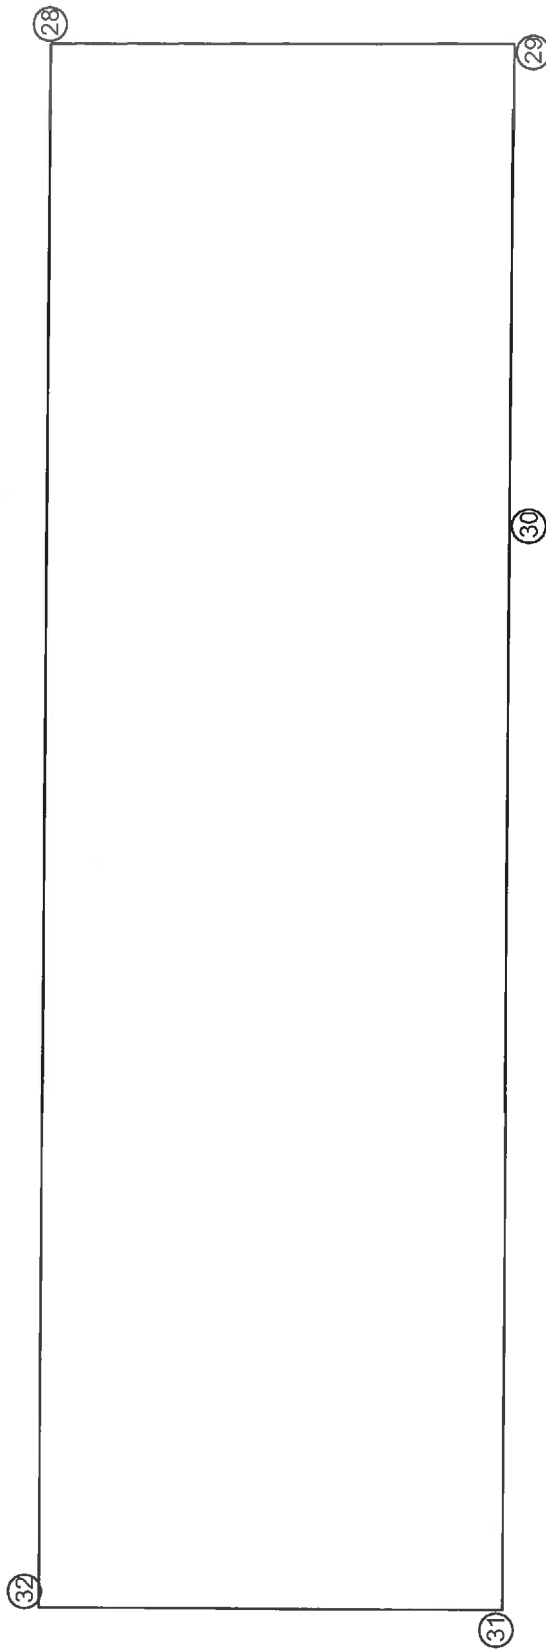

○ - PLM Sample Location

Client: Rosemead School District	Project #: 20-Z0046-0027	Info: PLM Sample Locations
		
Site: Encinita Elementary School - Painting Project Address: 4515 Encinita Avenue Rosemead, California 91770		

Classroom Building (G) Room 15-18

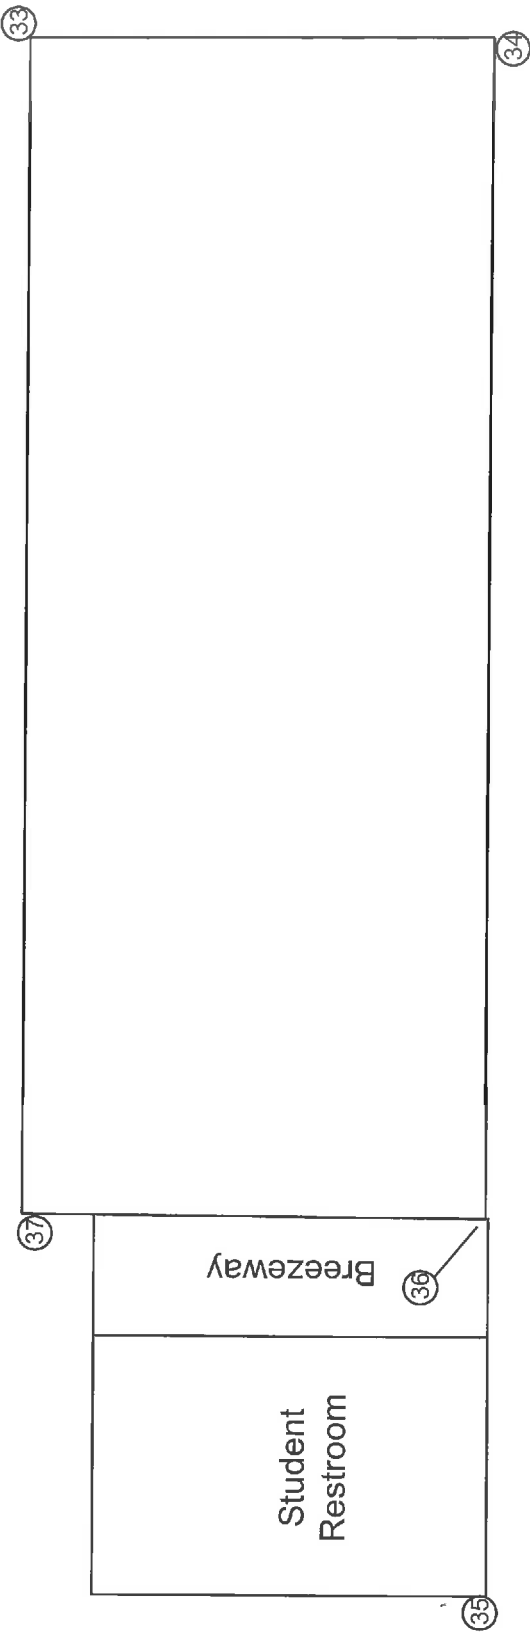


○ - PLM Sample Location



Client: Rosemead School District	Project #: 20-Z0046-0027	Info: PLM Sample Locations
		
Site: Encinita Elementary School Address: 4515 Encinita Avenue Rosemead, California 91770		


Classroom Building (H) Room 19-20

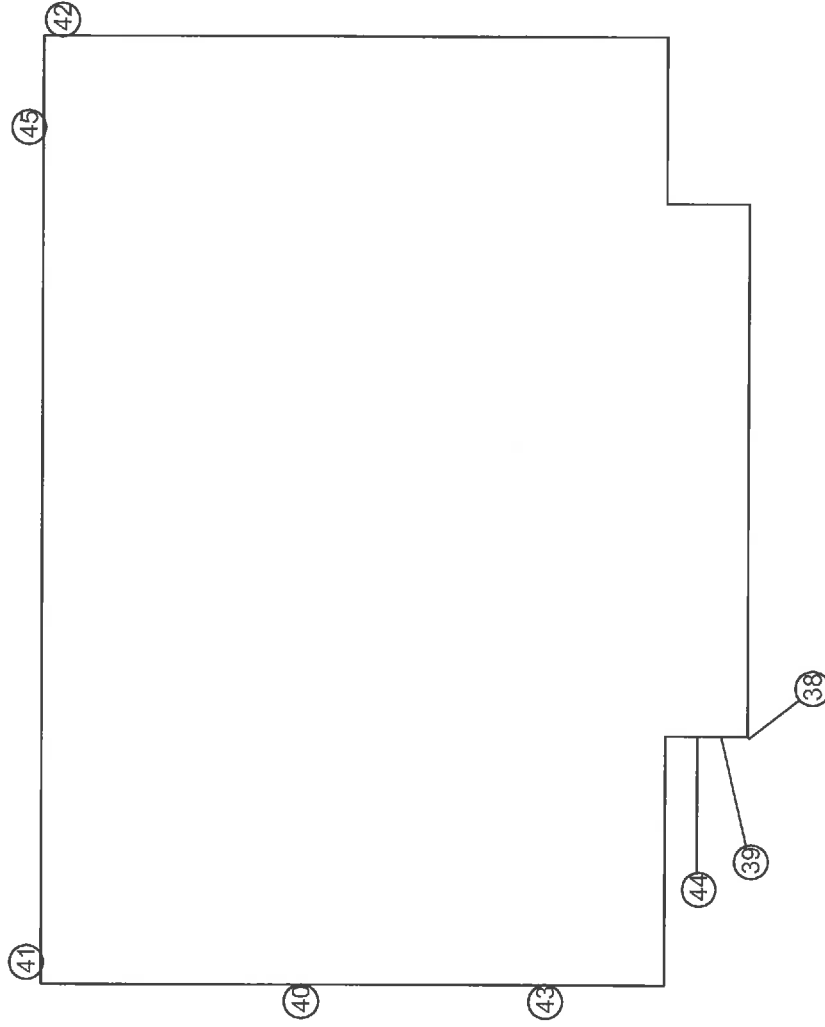

○ - PLM Sample Location

Client: Rosemead School District	Project #: 20-Z0046-0027	Info: PLM Sample Location
 EXECUTIVE ENVIRONMENTAL HEALTH & SAFETY SIMPLIFIED		
Site: Encinita Elementary School - Painting Project Address: 4515 Encinita Avenue Rosemead, California 91770		

Staff Restroom





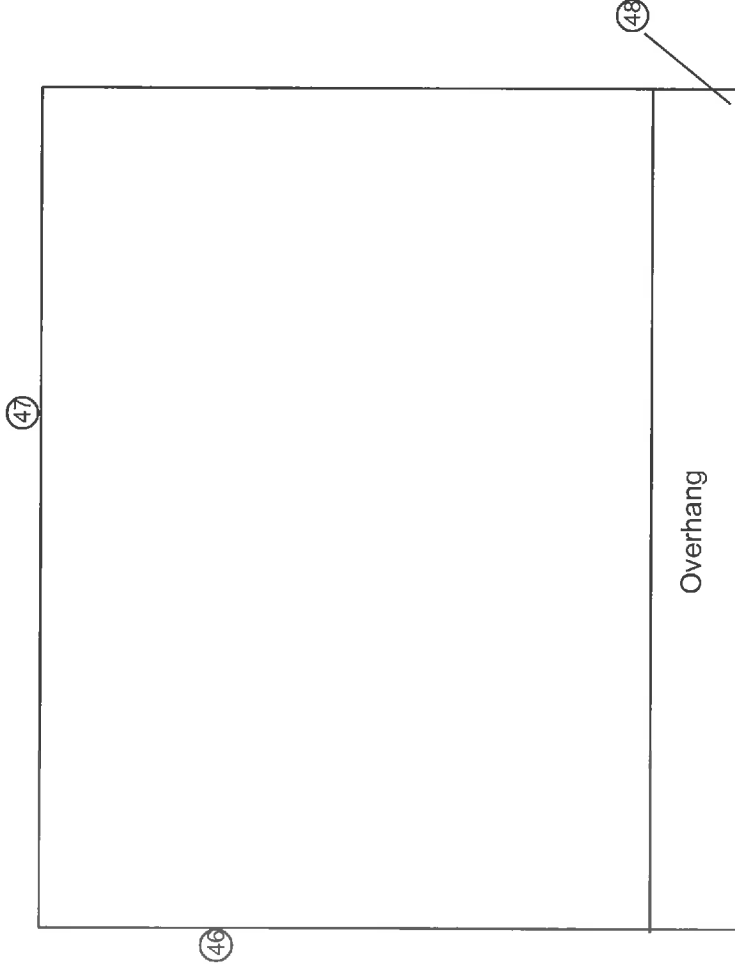


○ - PLM Sample Location



Client: Rosemead School District	Project #: 20-Z0046-0027	Info: PLM Sample Locations
		
Site: Encinita Elementary School - Painting Project Address: 4515 Encinita Avenue Rosemead, California 91770		

Portables

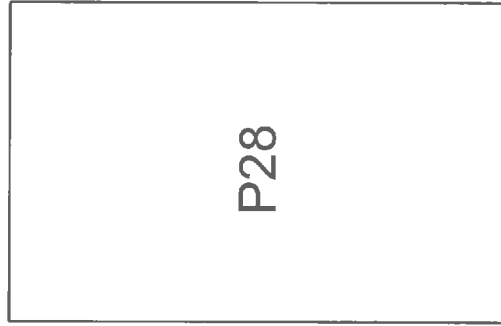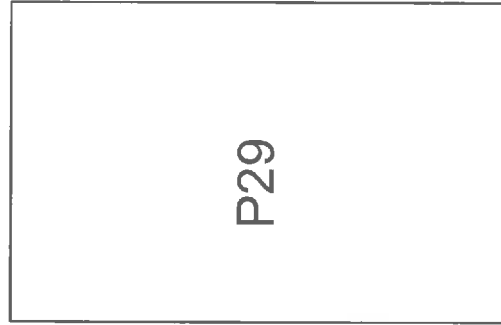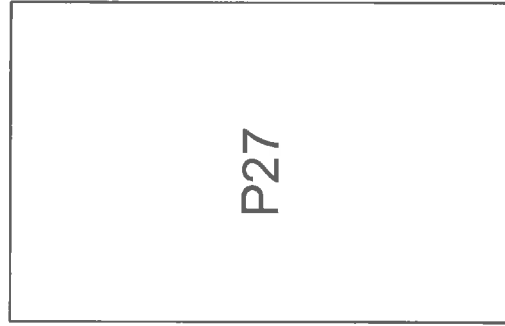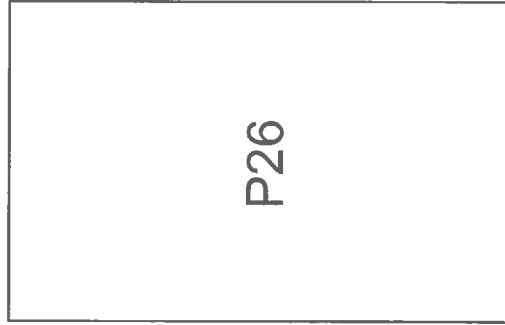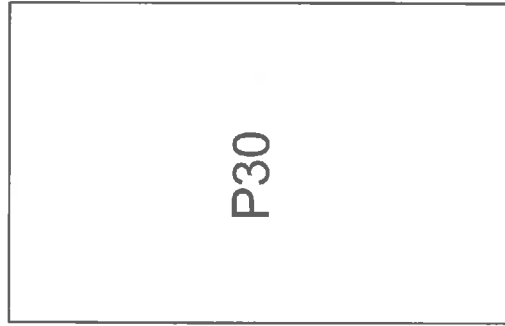

Client: Rosemead School District

Project #: 20-Z0046-0027


Info: Non-Suspected Materials Identified


EXECUTIVE ENVIRONMENTAL
HEALTH & SAFETY SIMPLIFIED

Site: Encinita Elementary School - Painting Project
Address: 4515 Encinita Avenue
Rosemead, California 91770

Drawing Not to Scale - © 2012

Portables

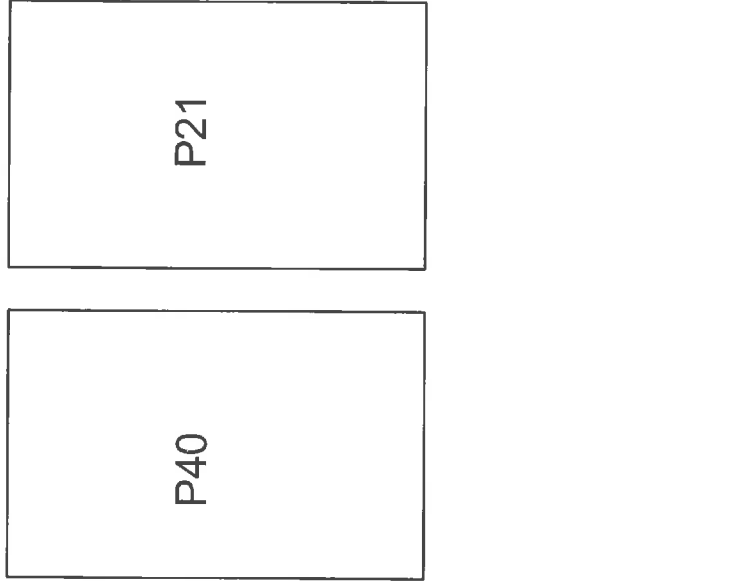

Client: Rosemead School District	Project #: 20-Z0046-0027	Info: Non-Suspected Materials Identified
		
EXECUTIVE ENVIRONMENTAL HEALTH & SAFETY SIMPLIFIED		
Site: Encinita Elementary School - Painting Project Address: 4515 Encinita Avenue Rosemead, California 91770		Drawing Not to Scale • © 2012